



VILLAGE OF HARRISON HOT SPRINGS

NOTICE OF MEETING AND AGENDA

SPECIAL COUNCIL MEETING

Date: Thursday, December 08, 2011
Time: 8:00 a.m.
Location: Harrison Hot Springs Resort and Spa
 100 Esplanade Avenue, Harrison Hot Springs
 Coronet Room

1. CALL TO ORDER		
	(a)	Meeting called to order by Mayor Facio
2. INTRODUCTION OF LATE ITEMS		
3. APPROVAL OF AGENDA		
4. ADOPTION OF COUNCIL MINUTES		
		Item 4.1
5. BUSINESS ARISING FROM THE MINUTES		
		Item 5.1
6. CONSENT AGENDA		
i. Bylaws		Item 6.i
ii. Agreements		Item 6.ii
iii. Committee/ Commission Minutes		Item 6.iii
iv. Correspondence	Letter from BC Water & Waste Association - November 18, 2011 UBCM In The House – November 24, 2011	Item 6 iv Page 1 Page 3

7. DELEGATIONS AND PETITIONS		
<input type="checkbox"/>	None	
8. CORRESPONDENCE		
		Item 8.1
9. BUSINESS ARISING FROM CORRESPONDENCE		
10. REPORTS OF COMMITTEES, COMMITTEE OF THE WHOLE AND COMMISSIONS		
11. REPORTS FROM MAYOR		
L. Facio – verbal		
12. REPORTS FROM COUNCILLORS		
13. REPORTS FROM STAFF		
<input type="checkbox"/> Water System Supply and Treatment	Report of Operations Manager – September 12, 2011 Re: Water System Supply and Treatment	Item 13.1 Page 7
<input type="checkbox"/> Relay for Life Event	Report of Community Economic Development Officer – December 5, 2011 Re: Relay for Life Event Recommendation: THAT Council authorize staff to issue a Special Event Park Permit for the Canadian Cancer Society to host the Relay for Life.	Item 13.2 Page 97
<input type="checkbox"/> Sasquatch Days - An Intercultural Celebration	Report of Community Economic Development Officer – December 5, 2011 Re: Sasquatch Days – An Intercultural Celebration Recommendation: THAT Council authorize staff to engage the Sts'ailes Indian Band in hosting the Sasquatch Days with a commitment of a contribution from the RMI of \$10,000 towards the event in 2012.	Item 13.3 Page 101

<input type="checkbox"/> Road Reserve Transfer	Report of Director of Finance – December 6, 2011 Re: Road Reserve Transfer Recommendation: THAT Council approves the transfer of one hundred thousand dollars (\$100,000) from the Road Reserve towards the construction of the McCombs Drive Bridges Replacement Program.	Item 13.4 Page 113
<input type="checkbox"/> Interim Audit Report	Report of McConnell, Voelkl, Village Auditor – December 12, 2011 Re: Interim Audit Report – Verbal	Item 13.5 Page 115

14. BYLAWS

<input type="checkbox"/> Bylaw No. 995, Community Works Reserve Fund	Recommendation: THAT Bylaw No. 995, Community Works Fund Reserve be read for a first, second and third time.	Item 14.1 Page 117
<input type="checkbox"/> Bylaw No. 996, Capital Works, Machinery and Equipment Reserve Fund	Recommendation: THAT Bylaw No. 996, Capital Works, Machinery and Equipment Reserve Fund be read for a first, second and third time.	Item 14.2 Page 119

15. QUESTIONS FROM THE PUBLIC (PERTAINING TO AGENDA ONLY)

16. ADJOURNMENT

RESOLVE to close the meeting to the public pursuant to *Section 90 (1) (a) (c) (d) (g) (i) of the Community Charter*



Safeguarding public health and the environment
through the sharing of skills, knowledge, education and experience,
and providing a voice for the water and waste community

1000 West Broadway

Vancouver, BC

Canada V6C 3K7

Dear Mr. Tisdale, Chief Administrative Officer

Re: Start planning now for Drinking Water Week 2012 – May 13th to 19th

Drinking Water Week is a campaign organized by the BC Water & Waste Association and endorsed by the Province of BC to raise awareness of the value of water.

BCWWA is inviting every community in BC to participate in Drinking Water Week, May 13-19, 2012. Our goal is for the public to develop a better understanding of where their water comes from, where it ends up, and the many people and processes involved along the way. Through this program, we also hope to instill public confidence in the individuals whose job it is to provide us with safe drinking water, manage wastewater and protect the environment.

This year, we are forming a network of "Drinking Water Week Community Liaisons." These are individuals in communities across the province who will receive information, updates and resources from BCWWA. We would also like for these individuals to champion awareness in their communities during Drinking Water Week. We kindly ask that you appoint a person to be this contact within your organization. Please supply this to us by Nov. 30, 2011.

We hope you will take part in the campaign. BCWWA will provide a variety of resources and materials that can be customized with your local logo and messaging.

The following are a few ways you can participate:

- Proclaim Drinking Water Week in your community (sample proclamation wording available).
- Hold an event to engage your community and declare your commitment.
- Host tours of local watersheds and water treatment facilities.
- Customize an advertorial supplied by BCWWA and Black Press, our print media sponsor, with your own logo and content to print in your local Black Press community newspaper.
- Make use of customizable advertising templates for print and bus shelters.
- Take part in and promote the 'Community Water Challenge' (details to be announced soon!).
- Distribute children's activities and informational postcards provided by BCWWA (also customizable).
- Link to the Drinking Water Week website, which includes water stats, conservation tips, and downloadable resources: www.drinkingwaterweek.org.

For more information, and to provide us with a Community Liaison, please contact Afana Tees, BCWWA Communications Coordinator at atees@bcwwa.org or 604-630-5548.

Our goal is to reach as many communities as possible with these vital messages. Let's work together to make it happen. With your help, we look forward to a successful Drinking Water Week 2012.

Please pass this letter on to other decision makers in your community, water and wastewater managers and staff.

Yours sincerely,

Daisy Foster, CEO
BC Water & Waste Association

Drinking Water Week 2012 Committee Contacts

Name	Region	Position/Organization	E-mail	Phone
Amy Wakeford	Fraser Valley	Water Conservation Program Coordinator, City of Abbotsford	awakeford@abbotsford.ca	604-853-2281 ext. 5286
Carolyn Stewart	South Okanagan	City of Penticton	carolyn.stewart@penticton.ca	250-490-2562
Corinne Jackson	South Okanagan	Communications & Research Coordinator, Okanagan Basin Water Board	corinne.jackson@obwb.ca	250-469-6271
Deborah Walker	Capital Regional District	Demand Management Coordinator, Capital Region District	dwalker@crd.bc.ca	604-474-9697
Gil Bogaard	Kootenays	Utilities Supervisor, City of Nelson	gbogaard@nelson.ca	250-352-8245
Gina Layte-Liston	Northern BC	Env./Utility Div., City of Prince George	glaytelliston@city.pg.bc.ca	250-561-7600
Heather Mitchell	Kootenays	Program Manager, Water Initiatives, Columbia Basin Trust	hmitchell@cbt.org	250-344-2445
Jennifer Bailey	Metro Vancouver	Water Conservation Programs, City of Vancouver	jennifer.bailey@vancouver.ca	604-873-7351
Jalmi Garbutt	Interior	Environmental Educator, City of Kamloops	jgarbutt@kamloops.ca	250-828-3377
Jeremy Sagebiel	Sunshine Coast	Engineering Technologist, Water & Roads, City of Powell River	jsagebiel@cdpr.bc.ca	604-485-8658
Karen Prentice	Sunshine Coast	Draftsperson/Survey Assistant, City of Powell River	kprentice@cdpr.bc.ca	604-485-8606
Kevin Reilly	Capital Regional District	Demand Management Coordinator, Capital Regional District	kreilly@crd.bc.ca	250-474-9689
Koreen Gurak	Mid Island	Communications Manager, Comox Valley Regional District	kgurak@comoxvalleyrd.ca	250-334-6066
Luisa Richardson	Northern Island	Water Conservation & Watershed Awareness	lu_rich@shaw.ca	250-923-9918
Margaret Birch	Metro Vancouver	Environmental Services Coordinator, City of Coquitlam	mbirch@coquitlam.ca	604-927-3483
Neal Klassen	South Okanagan	Water Smart Coordinator, H2Okanagan Water Conservation	neal@getwatersmart.com	250-868-3339
Sharon Peters	Metro Vancouver	Superintendent SCFP, Metro Vancouver	sharon.peters@metrovancover.org	604-314-4739
Renee Clark	North Okanagan	Water Quality Manager, Regional District of North Okanagan	renee.clark@rdno.ca	250-550-3747
Virginia Serrazin	Yukon	Project Manager, Water & Wastewater Treatment, Yukon Engineering Services	vserrazin@yes-group.ca	867-668-2000



Provincial Legislation 2011

Auditor General for Local Government Act (Bill 20, 2011) Introduced

Summary and Timing

Minister Ida Chong introduced the *Auditor General for Local Government Act* (Bill 20, 2011) in the Legislative Assembly today.

The Bill is available at:

http://www.leg.bc.ca/39th4th/1st_read/gov20-1.htm

The Bill provides the mandate, powers and duties of the Auditor General for Local Government (AGLG), establishes an audit council, and sets out an administrative and accountability structure for both.

If enacted, the audit mandate for the AGLG would consist of performance audits of the operations (see definitions) of municipalities, regional districts, greater boards (i.e., Greater Vancouver Water District and Greater Vancouver Sewerage and Drainage District), and any organization that, under generally accepted accounting principles, is controlled by a municipality, regional district or greater board. Additional entities may be added to this audit mandate by Cabinet regulation.

The Bill was introduced on the last day of the current Legislative Session, and as a result, is not expected to receive Royal Assent this Session. UBCM's understanding is that the Legislature will adjourn at the end of the day, and any Bills currently in process, including Bill 20, will be considered in the Spring Session, which we expect will begin in February, 2012.

Key Provisions in the Bill

The following is a summary of key provisions in the Bill, and it is not intended to be exhaustive. For certainty with respect to the proposed provisions, please refer to the Bill.

AUDITOR GENERAL, EMPLOYEES AND DELEGATION (SECTIONS 2, 5-7, 11, 12)

- The AGLG is appointed by Cabinet on the Minister's recommendation, after the Minister has considered the recommendations of audit council; only a qualified individual (see definitions) may be appointed; appointment term is 5 years and an AGLG may not be appointed for more than 2 consecutive terms; a similar process to suspend or remove the AGLG in limited circumstances and appoint an acting AGLG is set out; and
- The AGLG may appoint a deputy and other employees, retain other persons, and delegate most powers or duties.

AGLG MANDATE AND PERFORMANCE AUDITS (SECTIONS 3, 4, 13-17, 23, 24)

- The AGLG's mandate and powers are focussed on performance audits and recommendations;
- Performance audits are conducted "to provide local governments with objective information and relevant advice that will assist them in their accountability to their communities for the stewardship of public assets and the achievement of value for money in their operations";
- The AGLG decides what performance audits are to be conducted, but these must be in accordance with the annual service plan;

- Performance audits consist of a review of specific operations of a local government to evaluate such things as the extent to which: operations are undertaken economically, efficiently and effectively; or procedures to monitor economy, efficiency and effectiveness are sufficient;
- Performance audit reports must provide recommendations arising from the review to the local government; the local government is given an opportunity to comment on the proposed audit report, and a summary of the local government's comments must be included in the final audit report, which must be published by the AGLG;
- The AGLG may provide information about recommended practices arising from performance audits that may be applicable or useful to other local governments;
- If permitted by regulation, and if this does not interfere with other audits, the AGLG may undertake a performance audit for a local government upon its request;
- The AGLG may not call into question the merits of policy decisions or objectives of a local government;
- The AGLG may not act as a financial/attest auditor for a local government;
- The AGLG must be provided access to things like records and information needed to conduct a performance audit and may compel persons to answer questions or produce records;
- Confidentiality provisions are included for audit information, proposed reports and proposed comments.

AUDIT COUNCIL (SECTIONS 18-21)

- At least 5 audit council members are appointed by Cabinet for terms of up to 3 years, on the Minister's recommendation, after the Minister has consulted with UBCM, and representatives of business, taxpayers and local government professionals; members must have knowledge, skills, education or experience in one or more

of: accounting, auditing, or local, regional or provincial governance; and

- The role of the audit council is to: make recommendations for the AGLG appointment, suspension or removal and appointment of an acting AGLG; comment on and recommend changes to the annual service plan; comment on AGLG reports, including performance audit and annual reports; disseminate information about performance audit report recommendations and recommended practices; and review and monitor the performance of the AGLG, including having a statement on the AGLG's performance included in the annual report.

ANNUAL SERVICE PLAN, ANNUAL REPORT, ANNUAL AUDIT AND BUDGET PROVISIONS (SECTIONS 8, 9, 10, 22, 25, 26)

- AGLG must submit to Treasury Board an annual estimate of costs; Treasury Board may adjust the estimate before approving it;
- AGLG must annually prepare financial statements, which must be audited by an independent auditor appointed by the Minister;
- AGLG must prepare an annual service plan, including at least: the approved estimate; for each of the current and two future years, its goals and objectives, and measures to determine progress respecting these, general criteria to determine the need for and priority of performance audits, and themes on which performance audits may be based;
- AGLG must prepare, in respect of the previous year, an annual report, including at least: the activities of the AGLG; the audited financial statements; and progress in relation to the goals, objectives and measures established for that year in the annual service plan;
- AGLG may prepare other specified reports; and
- Reports must be distributed to audit council, and in some cases, the Minister, and all must be published.

Consistency with Policy Paper principles

The UBCM membership considered a Municipal Auditor General Policy Paper at the 2011 Convention, and endorsed the following resolution:

THEREFORE BE IT RESOLVED that UBCM, while disagreeing on the necessity to create an office of the Municipal Auditor General, due to the fact that requirements of such an office are already met under existing local government legislation and regulations, endorse in principle the policy paper and instruct the UBCM Executive to continue negotiations with the provincial government.

The Policy Paper set out a number of principles intended to guide policy development for this initiative. The following identifies how key elements of the Bill relate to these principles.

Consultation between the province and local governments is critical

- UBCM has been consulted on the drafting of the legislation.
- UBCM must be consulted prior to audit council appointments.

Changes should build on existing systems, avoid duplication and meet specific objectives

- The AGLG is specifically precluded from undertaking audits currently required under local government legislation (i.e., financial audits now performed by independent auditors).

System changes should maximize public accountability benefits while respecting local autonomy and recognizing local capacity

- Performance audit provisions treat each local government as a separate government entity, thereby respecting local autonomy.
- The legislation requires the Province to pay the cost of the AGLG, which recognizes the limited financial capacity of some local governments to support these additional costs.

Legislative empowerment of a MAG should not exceed that typical of a federal or provincial AG

- The legislation prohibits the AGLG from calling into question the merits of policy decisions or objective of a local government.
- Performance audit provisions and powers in relation to this do not appear to exceed those provided to the Provincial Auditor General.

Administrative and governance structures should strike a balance between auditor independence and auditor accountability to the governments within its audit mandate

- Auditor independence is provided through provisions such as fixed terms of office and providing AGLG the sole discretion to choose which audits to undertake.
- Auditor accountability is provided through the annual service plan and report requirements, as well as audit council responsibility to monitor the AGLG's performance.
- Composition of the audit council is not consistent with the Policy Paper's recommendation that the AGLG be accountable to the local governments within the audit mandate. The Policy Paper recommended this be achieved through appointment of audit council representatives from the local government system, which is also consistent with existing Canadian precedent for Municipal Auditors' General.
- Instead, the legislation provides for audit council appointments by Cabinet, upon the recommendation of the Minister, after consultation with a range of interests. Appointees must have knowledge or expertise in at least one of a number of specific areas, but there is no requirement that appointees be representatives of the local government system. Consequently, the approach taken in the legislation is both inconsistent with existing precedent, and inconsistent with the Policy Paper's principle that the AGLG be accountable to local governments within its audit mandate.

The risk of contamination by outside influences is extremely higher in a Lake surface water source than in a Deep Well ground water source. The Ministry of Health has historically shown preference to a Deep Well Ground Source over a Surface Water Source. This was indicated by the Ministry of Health's Senior Engineer Tin Tun at a Council meeting of July 11, 2011.

Positives and Negatives of Lake Supply and Treatment vs. Ground Water Supply and Treatment;

Lake Water Supply (Surface) and Treatment

Positives (pros)	Negatives (cons)
<ul style="list-style-type: none"> ◦ Abundant supply of source water to meet demand ◦ Will have excellent water quality after Treatment 	<ul style="list-style-type: none"> ◦ High contamination risk of water source from outside influences ◦ Treatment needed for removal of viruses, Giardia, Cryptosporidium and Turbidity. ◦ Higher Operation and Maintenance costs ◦ Interruption of water supply during construction ◦ Higher project cost

Ground Water Supply (Deep Well) and Treatment

Positives (pros)	Negatives (cons)
<ul style="list-style-type: none"> ◦ Abundant supply of source water to meet demand ◦ Will have excellent water quality after treatment ◦ Very low contamination risk of water source from outside influences ◦ Lower Operation and Maintenance costs ◦ No interruption of water supply during construction ◦ Lower project cost 	<ul style="list-style-type: none"> ◦ Treatment needed for removal of Manganese and Sulfide

Since July it has been determined that, the operating costs for the Lake Source Treatment will exceed the operating costs for the Ground Water Source

Treatment by approximately 25% TO 35%. The life expectancy for each treatment plant option is 25 years.

The Hydrology report indicates that, the quality and quantity of water in the aquifer is acceptable as a source for water supply and will meet the requirements needed. If a second well is needed in the future to supplement the primary well for community growth needs, there is capacity in the aquifer to accommodate the requirement.

On Monday August 22, 2011 the Fraser Health Authority informed us, via email, they are taking extra Water Distribution samples to test for THMs. THM (Trihalomethane) is a byproduct produced from the combination of Chlorine and organic matter primarily found in Chlorinated water systems with high turbidity levels, such as our system is currently experiencing and has for several years. We also sent samples in for testing by our independent Laboratory for analysis. Chlorine dosage was increased to help offset the effects of higher Turbidity.

On Wednesday August 24, 2011, the Fraser Health Authority Inspector visited the Village to do an onsite system check. She requested we post a Water Quality Advisory, because of the continuous high turbidity levels in our Distribution system. This Advisory will remain in place until we have dealt with the turbidity issue.

During our discussion the Inspector was asked about Chlorination if we went to a Ground Water Deep Well Supply source. The Inspector indicated we would have to still Chlorinate the system until, the Village, could prove to the Ministry that, the Village has thoroughly cleaned the entire Water Distribution system due to the ongoing Turbidity issues and the fact the older distribution lines have never been cleaned properly by 'pigging' the lines. This would entail cleaning from the Reservoir through the entire Distribution system. During the Line cleaning process we would also install water sampling stations. These would be above ground stand-alone sampling pedestals at various locations throughout the water distribution system. This will eliminate obtaining samples from house taps and Fire Hydrants, both of which are undesirable sources. Approximately 10 units would be needed. The estimated cost to do this is \$131,000.00 for Line and Reservoir cleaning and \$15,000 for water sampling pedestals. These costs would apply to both Treatment options.

It was also learned from the Inspector that, if treatment of a Surface Water Supply does not meet the 4-3-3 log removal, Ultraviolet Light (UV) disinfection has to be installed as an addition to Chlorination. As stated in Civic Consultants report in July the Treatment option, A-C Water Treatment Plant, for the Lake Water Supply will only achieve 4-2.5-2.5 log removal. Therefore, a UV Disinfection system will have to be added to this option. Estimated cost is \$50,000 - \$70,000.

The following is to summarize the cost estimates of the two Supply and Treatment options, taking into consideration all the information provided.

Lake Water supply and Treatment

o Intake extension	\$850,000
o Upgrade of Pumps	\$150,000
o Treatment Plant	\$702,000
o UV Disinfection	\$ 70,000
o Cleaning of Reservoir and Lines	\$ 131,000
o Water sampling Pedestals	\$ 15,000

Total	<u>\$1,918,000</u>
-------	--------------------

Ground Water supply and Treatment

o Well and Pumping system	\$ 130,000
o Treatment Plant	\$ 931,000
o Cleaning of Reservoir and Lines	\$ 131,000
o Water sampling Pedestals	\$ 15,000

Total	<u>\$1,207,000</u>
-------	--------------------

POLICY CONSIDERATIONS: (if any)

RECOMMENDATION: THAT Council approves proceeding with the Ground Water Supply and Treatment option.

Respectfully submitted for your consideration;


 Ian Gardner
 Operations Manager

DIRECTOR OF FINANCE COMMENTS:


Either option will involve a significant portion of the costs to be funded by borrowing.



Dale Courtice
Director of Finance

CHIEF ADMINISTRATIVE OFFICER COMMENTS:

I concur with the recommendation.



Ted Tisdale
Chief Administrative Officer



Village of Harrison Hot Springs Water Treatment Plant Report

Project Description

The Ministry of Health has directed the Village of Harrison Hot Springs to provide treatment to the Village water system. This directive was issued in a letter dated Nov. 6th, 2009, from Ms. Jeniene Lutz, C.P.H.I. stating;

As a follow up to the Village of Harrison Hot Springs Council resolution of April 19, 2007 regarding the treatment of the Village's water supply, the following terms and conditions were added to the operating permit:

On or before December 31, 2010, the finished water supplied by the Village of Harrison Hot Springs water system must have undergone treatment that achieves the following:

- o At least a 4-log (99.99%) reduction and/or inactivation of viruses
- o At least a 3-log (99.9%) reduction and/or inactivation of *Giardia* cysts and oocysts
- o At least a 3-log (99.9%) reduction and/or inactivation of *Cryptosporidium* cysts and oocysts

Please advise Fraser Health in writing as to how the Village of Harrison Hot Springs intends to meet the above terms and conditions.

Village staff was unaware of the extent of the works and the cost that this would entail until they tried to implement the objectives. The deadline to have this work done has passed and the Village and the Ministry are anxious to have the works completed.

The removal and/or inactivation of *Giardia* cysts and *Cryptosporidium* oocysts from raw water are complicated by their small size and resistance to commonly used oxidants such as chlorine. *Cryptosporidium* oocysts are harder to eliminate but are fortunately much less common in Canadian surface waters.

It is possible to reduce the viability of *Giardia* cysts by 99.9% using chlorination alone but long contact times are required. Ozone and chlorine dioxide are much better disinfectants but both are expensive and result in the formation of unwanted by-products (particularly chlorite formation in the case of chlorine dioxide). Ozone is a better choice but is unreliable when turbidity is high (as can be the case for the Village's Lake supply) or variable because cysts are protected in flocculated particles.

Inactivation of *Cryptosporidium* oocysts by chlorination alone is impractical but ozonation can be effective when used properly.

Filtration followed by chlorination is a practical and cost effective answer to solve the problem. The estimate for this solution is in the range of \$450,000 (BI Purewater). Based on this estimate, the Village set a budget for this solution at \$450,000.

However, upon further investigation, it was determined that the TSS (total suspended solids) of the Lake supply runs from 3 - 5 mg/l (during normal periods) to 15 mg/l (or higher) during storms or periods when the Lake turns over. The filtration of water with a TSS of 4 - 5 mg/l and above, is complicated by the need to backwash and/or replace filters too often. The higher levels of TSS result in a large increase in the operations and maintenance costs which negates the cost advantages for this solution.

The next choice is filtration with the aid of coagulation/flocculation. This is the most practical method to achieve high removal/inactivation rates of cysts and oocysts in turbid water to meet the requirements of the Ministry of Health and the Canadian Drinking Water Guidelines.

Reverse osmosis (RO) plants are the high end solution. Not only do they remove cysts and oocysts, they also remove a wide variety of impurities and bacteria. However, the cost for this solution is too exorbitant for a small community.

The Village therefore continued on with the investigation of the mid priced treatment systems.

Project Details

Civic Consultants provided the Village with a study to determine their present and future water requirements. The present maximum daily water demand (MDD) is 30 l/sec at 565 kPa and is borne out by the Village records. This is without any effort at water conservation. With water conservation policies in place, it is estimated that the current capacity could be maintained to the year 2018.

The Village asked three manufactures (BI Purewater, Corix and Timbro) to provide concept and Class C budgets for solutions to the problem.

BI Purewater, the company that provided the initial estimates, did not provide a proposal. Their primary treatment product is cartridge filtration plants. Once they were informed of the level of TSS in the Lake, they decided not to submit a quote. The problem with TSS was discussed previously in this Brief.

The proposals received were as follows;

1. A-C (Absorbent Clarifier) Water Treatment Plant by Corix Water Systems.
The AC water treatment plants use a combination of hydraulic “tortuous path” flocculation/clarification filtration and rapid rate filtration to produce a superior quality of potable water. They are suitable for stable, well or surface waters where turbidity levels seldom exceed 50 NTU.

The final water quality is

- less than 0.1 NTU final turbidity.
- 2.5 log, multi-barrier protection against Giardia and Cryptosporidium.

Enclosed are conceptual design drawings for the AC System. For more information go to www.keywin.mb.ca/files/CWS_AC%20Water%20Treatment%20Plant.pdf

2. Trident Model TR-210 A by Siemens Water Technologies
3. Culligan Hi-Flo 50 Series Industrial Water Filter System
4. Z-Box S-18 Ultrafiltration Water Treatment System by GE



Estimate of Costs (including breakdown)

Optional Treatment Plants

1	A-C Water Treatment Plant by Corix Water Systems	\$518,000
	Miscellaneous 10%	\$51,800
	Engineering 10%	\$56,980
	HST 12%	<u>\$75,214</u>
		\$701,994
2	Trident Model TR-210 A by Siemens Water Technologies	\$1,089,717
	Miscellaneous 10%	\$108,972
	Engineering 10%	\$119,869
	HST 12%	<u>\$158,227</u>
		\$1,476,784
3	Culligan Hi-Flo 50 Series Industrial Water Filter System	\$656,880
	Miscellaneous 10%	\$65,688
	Engineering 10%	\$72,257
	HST 12%	<u>\$95,379</u>
		\$890,204
4	Z-Box S-18 Ultrafiltration Water Treatment System by GE	\$1,092,063
	Miscellaneous 10%	\$109,206
	Engineering 10%	\$120,127
	HST 12%	<u>\$158,568</u>
		\$1,479,964

Based on the above, the cost to provide treatment of the Lake supplied water should be \$700,000. which includes HST.

The initial quote from IDL of \$483,415 included exceptions. I have gone back to them to get them to remove the exceptions.

The new estimate is \$518,000.

The changes to the previous proposal include

- a) Added dry chlorination system
- b) location of plant moved to flat area next to old reservoir up steep access road.
- c) 3 phase power is located at the site and no additional power pole is required to connect power to building
- d) cut into raw water forcemain to new reservoir and connect raw water line from lake pumps to raw water intake
- e) connect plant treated water line and back wash line to the forcemain section going to the new reservoir
- f) connect plant backwash waste line to existing reservoir overflow line to rock pit.

The above works assumes that no rock blasting or removal is required and the existing forceman and overflow pipe are within 50ft of the location of the plant



As well as the requirements for treatment by the Ministry of Health, the Village water supply intake is also a concern. The intake is located approximately 1 km off shore in about 3.5 meters of water at low levels. It poses a risk for purposeful or accidental contamination. However, to date, no problems have occurred.

The two solutions to reduce or eliminate the risk are;

- to move the inlet further out into deeper water (more than 18 meters) which will reduce the risk, or
- change the supply of water from the Lake to a protected groundwater source which will eliminate the risk.

1. Civic Consultants provided the Village with a report entitled “Harrison Hot Springs Water Study Nov 2007”. This Report looked at relocating the inlet out to deeper water to reduce the risk of contamination. The cost was estimated to be about \$850,000 for the relocation of the inlet and an additional \$150,000 to change the pumps to obtain the same capacity. As well, the water would still require treatment to achieve the Ministry of Health requirements.

To reduce the risk of Lake Water contamination and to meet the Ministry of Health requirements the estimated cost would be approximately \$1,715,000 (relocated inlet plus treatment).

2. Providing a ground water supply and incorporating a ground water protection plan, the risk of purposeful or accidental contamination is virtually eliminated.

The new requirements from the Ministry of Health apply to surface water or groundwater under the direct influence of surface water (GUDI). If the source of supply was changed from Harrison Lake to a ground water supply that was not under the direct influence of surface water, these new requirements would not apply. GUDI wells are generally less than 18 meters deep.

The cost to switch over to a ground water supply, if an adequate supply of ground water meeting the Guidelines for Canadian Drinking Water Quality were found, would be approximately;

Well Drilling	\$15,000
Hydrology Report	\$7,000
Capacity Testing	\$5,000
Chemical Testing	\$500
Well Construction	\$60,000
Pipe Work	\$50,000
Well Protection Plan	<u>\$25,000</u>
	\$162,500
Contingencies 20%	\$32,500
HST 12%	<u>\$23,400</u>
	\$218,400

This solution would obviously be the least expensive solution if an adequate supply of ground water meeting the Guidelines for Canadian Drinking Water Quality could be found. The Village explored this option by drilling a 200 mm test well. Sufficient water was found but unfortunately, the water did not meet the Canadian Guidelines. The water is high in manganese and hydrogen sulphide (H₂S).



The Village conducted a demonstration treatment project to determine if there was an adequate solution for the parameters not meeting the Guidelines. A "green sand" filtration plant was provided by Corix and a three day testing program undertaken. The manganese and the H₂S were successfully removed to acceptable limits.

The Village obtained conceptual estimates for a "green sand" treatment plant with the following results.

1 Corix PF-485-3 WTP	\$629,415
Miscellaneous 20%	\$125,883
Engineering 10 %	\$75,530
HST 12%	<u>\$99,699</u>
	\$930,527
2 Aeralater Type II Plant by Siemens	\$878,577
Miscellaneous 10%	\$87,858
Engineering 10%	\$96,643
HST 12%	<u>\$127,569</u>
	\$1,190,648
3 Hi-Flo 50 Cullsorb Filter System by Culligan	\$998,589
Miscellaneous 10%	\$199,718
Engineering 10%	\$119,831
HST 12%	<u>\$158,176</u>
	\$1,476,314

In total, the cost to convert the Lake Supply to a Ground Water Supply would be approximately \$1,148,927. This would meet the Ministry of Health requirements and eliminate the risk of contamination.

I have enclosed a copy of the estimate for the PF - 485-3. As with the AC Plant, there are exceptions with the quotation. I have made allowance for these by adding a 20% miscellaneous amount.

Another major factor that will affect the decision is the cost of operations and maintenance. As can be seen from the initial concept of applying a straight forward filtering system, the costs for labour and filters would be excessive. BI Purewater's primary treatment plants are cartridge filter plants. Due to the high levels of turbidity, they decided not to provide a quote for their plants.

The effect of the turbidity problem is demonstrated in the existing water lines. When the public works crews flush the lines, the mains run extremely dirty until most of the settled solids are flushed out. The muck in the lines also causes problems with the chlorine residual values and can lead to failing test results in the water system.



Alum is the coagulant that is generally added to the raw water to precipitate dissolved contaminants and encourage suspended particles to group together in the form of “flocs”. As the water passes upward through the upflow clarifier filter, these grow and are removed by the coarse media. The clarified water then passes on to the downflow rapid gravity filter for final polishing. Solids that accumulate within both the upflow and downflow filters are periodically removed by automatically controlled air/water backwashing.

The more turbid the water is, the more frequent the backwashing program will be. Manual operation of the backwashing process may be required due to fluctuating levels of TSS. Manual operations require labour which can be expensive. As well, backwashing also requires energy demand and is a negative for water conservation.

The ground water supply does not have the TSS or turbidity problem that the Lake supply does. What is being filtered out is the excessive manganese. This is in much lower concentrations than the TSS and therefore requires much less backwashing than the AC plants does. The backwashing can generally be done on an automatic schedule to reduce operational labour costs.

The regeneration of the potassium permanganate does add costs but it mostly done on an automatic basis.

To this point, we have not done a detailed analysis of the labour costs for each process.



Village of Harrison Hot Springs
Water Treatment Plant Report
Supplemental Information

There are other works that will be required for water supply that will be necessary either for a Lake Supply or a Ground Water Supply. The existing water mains have an excess of sands/silts built up over the years due to the use of the turbid Lake Supply. These mains need to be cleaned. Treating the water at the source will not protect the users from the sands or silts already in the system.

To clean out the lines properly requires a process known as "pigging" the lines. A series of small polyethylene foam cleaning devices are put into the pipe line through a fire hydrant barrel. They are also retrieved from another fire hydrant barrel down the line. A short video of this process can be seen at www.youtube.com/watch?v=alij-Ts61Tw.

We have contacted ABC Pipe Cleaning for a rough budget estimate. Their response was that it would be in the range of \$_____/m. The Village has _____ m of mains for an estimate of \$80,000 (temporary guesstimate) for this work. A contingency amount of 35% should be added for a total estimate of \$121,000 (which includes HST). The total should be added to either the Lake Supply Grant application or the Groundwater Supply Grant application.

Before an application for a Grant is made, a more detailed estimate for the pigging process should be obtained.

If the lines are cleaned, the Ministry of Health has stated that they would consider not requiring chlorination of the groundwater supply. The Lake Water Supply would need chlorination in either case.

As well, the Ministry of Health would like to see proper sampling ports on the water system. Currently samples are being taken from individual home taps and or fire hydrants. This methodology is not acceptable.

The proposed sampling ports would be similar to those used in the District of Kent. For budgetary purposes, I have estimated that 10 sampling ports should be installed at a cost of \$1,000 each for a total of \$10,000 plus contingencies plus HST.

Comments from Corix on the comparison between an AC plant and Cartridge filter plants.

To meet GCDWQ guidelines a 1 micron cartridge filter must be installed. We know of one plant up north in which the owners specified and ordered a cartridge filter plant. The data they presented indicated the turbidity was <2 NTU. However there were incidences this spring in which the turbidity went much higher. The town was changing filters every day at great expense. It is our experience that anything over 2 NTU for a 1 micron filter will greatly increase cartridge filter replacement.

The AC plant on the other hand will handle turbidity up to 25 with normal operation. Higher turbidities are possible however backwashing will increase considerable as will operator attention. This gives the Village a significant safety factor from turbidity increases. Under 25 NTU, one essentially pays only for extra chemicals as the turbidity increases. It is difficult to predict how much the chemical use will increase with higher turbidity, but it's probably in the neighborhood of 20%.



Tin Tun, the Ministry of Health Regional Engineer stated at the last meeting that the Harrison Hotel had provided a cartridge filtration system for their treatment. It became so plugged up that they had to disconnect it.

Civic is aware of a cartridge plant that was supplied for a small water system on Shuswap Lake. The filters had to be changed two or three times a day. The Owners had to purchase a different type of plant to cope with the turbidity.

The estimate for the groundwater supply included an estimate for the construction of a well and the installation of a well pump. We have since obtained a more detailed estimate from Corix. Their estimate is as follows;

The scope for the well pump equipment includes:

- o Well pump and cables, c/w leak detection and overload protection
- o low water level detector
- o Well pipe
- o pitless adaptor
- o Pump controls and starter added to WTP PLC
- o Local well disconnect (equipment will be in the WTP building)
- o 60m power and instrumentation cable (WTP to well)

Grundfos Pump information

Pump to handle 486 usgpm water at (149.8 psig) 346 ft TDH at the worst case scenario (i.e. filter is plugged); pump will deliver 550 usgpm water at (125 psig) 289 ft TDH when filter is completely clean.

The system will require a modulating valve at discharge to keep flow rate constant at 400 usgpm. (More is available if needed in the future)

One only Grundfos model 475S600-G all stainless steel submersible well pump end, 8" dia. pump with 6" FNPT connection; ship wt. 107 lbs

One only Grundfos 6" dia. 60 hp, 304SS motor for above pump, 3450rpm, 575v, 3ph, 60hz, 13000 lbs maxi. thrust capable, std. 312" long motor lead; ship wt. 390 lbs

Note 1: TWU6-4 pump cable good for 550 ft continuous run on 60hp, 575 volt application; Nema 4 starter required, A/B J45 heater for overload relays or equal, overload relay amp sets at 67.0 to maxi. of 72.8 (60hp, 575v motor rated at 64.4 amps)

Note 2: Pumps specs to be fine tuned upon detail design

Installation scope:

- o Install force main from well to WTP 50m
 - o Install well pump, cable and sensors
 - o Install 50m of u/g cable and local disconnect
 - o install well head protection 1m deep, 5 meter radius, plastic sheet, bentonite seal
- Total cost of well pump, cables, installation, well head protection, etc. is \$45,000



The cost for a well would be;

Well drilling	\$12,000	complete
Hydrology Report	\$ 3,000	underway
Capacity testing	\$ 5,000	complete
Chemical Testing	\$ 500	complete
3 phase power to well head	\$20,000	
Well Construction	<u>\$45,000</u>	
	\$85,500	
Contingencies 20%	\$30,200	
HST 12%	<u>\$13,884</u>	
	\$129,584	

Previous estimate was \$218,400

In Summary the Lake Supply Treatment System should cost approximately;

Treatment Plant (including contingencies and HST)	\$702,000
Cleaning the lines (including contingencies and HST)	\$121,000
Sampling Ports (including contingencies and HST)	<u>\$ 15,000</u>
Total	\$838,000

The Groundwater Supply and Treatment System should cost approximately

Treatment Plant (including contingencies and HST)	\$931,000
Well and pumping system (including contingencies and HST)	\$130,000
Cleaning the lines (including contingencies and HST)	\$121,000
Sampling Ports (including contingencies and HST)	<u>\$ 15,000</u>
Total	\$1,197,000

Operating Costs

1. Cartridge Filtration System was not estimated due to the unknown number of filter changes.

2. AC PLANT (assumes 10 NTU lake water)

Chemicals: Polymer, Alum, Soda Ash.	Total \$538.30/week
Power: Mostly due to pumping to WTP from primary pumps	Total \$381.92/week
Power: Due to pumping from WTP to reservoir	Total \$124.33/week
Operating Labour 2 hours/day. 4 hours/week for chemical replenishment.	
Total 14 hours/week Assume labour costs @ \$40/hour	<u>Total \$560.00/week</u>
	\$1,604.55/week
Total cost / m ³ (based on a MDD of 2,242 m ³ /day)	\$0.10/m ³

3. PRESSURE FILTER

Chemicals: KmnO ₄	Total \$164.50/week
Power: Mostly due to well pump	Total \$556.50/week
Labour hour/week 14 Assume labour costs @ \$40/hour	<u>Total \$560.00/week</u>
	\$1,281.00/week
Total cost / m ³ (based on a MDD of 2,242 m ³ /day)	\$0.08/m ³

Life Expectancy.

The life expectancy of the two systems is an average of 25 years. The tanks themselves should last for about 40 years.



We have asked Corix to provide some assurance that H₂S and Manganese will be removed

Their response;

The pilot test is our best assurance that sulphides (and Manganese will be removed)

The reported values and observations from the April pilot test were:

"Manganese Tests

GCDWQ aesthetic objective: <0.05 mg/l

Raw water average: 0.12 mg/l

Treated water average 0.008 mg/l

Average removal efficiency 93%

Sulphide Tests

GCDWQ aesthetic objective: <0.05 mg/l


Raw water average: 0.023 mg/l 400 gpm value 0.027 mg/l

Treated water average 0.007 mg/l

Average removal efficiency 70%

The results indicate that all measured treated water parameters were within GCDWQ by a safe margin. This result is indicative that the manganese green sand filter system would safely and economically meet VHHS's potable water objectives.

The pilot test operator also indicated that the water taste quality was good with only very faint odours before treatment and no odours following treatment. "



PITEAU ASSOCIATES
GEOTECHNICAL AND
HYDROGEOLOGICAL CONSULTANTS

215 - 260 WEST ESPLANADE
NORTH VANCOUVER, B.C.
CANADA - V7M 3S7
TEL: (604) 966-8551 / FAX: (604) 963-7266
www.piteau.com

Our file: 3127

September 2, 2011

Civic Consultants Ltd.
410 – 3rd Street
New Westminster, B.C.
V3L 2S2

Attention: Lorne Davidson, P.Eng.

Dear Sirs:

Re: Groundwater Supply Test Well, Harrison Hot Springs

In response to your recent request for comment on the groundwater supply test well installed in 2010 in the Village of Harrison Hot Springs, Piteau Associates Engineering Ltd. (Piteau) is pleased to provide the following letter to outline our opinions on well efficacy, water quality and development risks associated with use of this site for converting the communities water supply to a local groundwater source.


BACKGROUND

In March 2010, A & H Drilling Ltd. under contract to Corix Water Systems (Corix), completed installation and pump testing of a 31.7m (104') test well within a 41m (135') borehole on community property in the Village of Harrison Hot Springs (Fig. 1). Piteau understands that the objective was to test for local potential to convert the community water supply from a surface water source to a groundwater source to mitigate drinking water quality problems experienced by the community, including issues with turbidity and the potential for microbiological contamination associated with a surface water supply. The future water demand is 25 L/s (400 USgpm).

Based on apparent sulphide odours noted during drilling and subsequent exceedance of Canadian Drinking Water Guidelines aesthetic objectives for manganese from water quality testing, a field filtration test was conducted by Corix in 2011 (Corix, 2011) to test the effectiveness of Greensand and activated carbon filter media for removing these ions. They reported that manganese tests showed 93% average removal efficiency and 70% average removal efficiency for sulphide, reducing concentrations of the respective ions to well below water quality guidelines at a pilot plant scale.

WELL HYDROGEOLOGY AND CONSTRUCTION

A test well was drilled to 41m (135') depth into an unconfined sand and gravel aquifer. This composition is consistent with the highly productive Agassiz – Seabird Island Aquifer which has been mapped to extend from below the Fraser River, through Agassiz and below Harrison Hot Springs and Harrison Lake (Fig. 1). This aquifer comprises generally coarse-grained alluvial



Civic Consultants Ltd.

Attention: Lorne Davidson, P.Eng.

- 2 -

September 2, 2011

sediments and overbank deposits associated with the Quaternary path of the Fraser River and its local tributaries extending as far north as Harrison Lake.

The driller's log for the test well is included as Appendix A. The well consists of 200mm (8") casing with a 4.9m (16'2") length of stainless steel well wire-wound screen exposed to sand and gravel between depths of 26.8 and 31.7m (87.8 and 104'). The screen slot size used was 0.5mm (0.020"). The static water level at the time of well construction was 3.4m (11') below ground.


REVIEW OF PUMP TEST DATA

Corix Water Systems conducted a variable-rate aquifer pumping test on the test well on April 13 and 14, 2010. According to the well test record (Appendix B), the well was pumped at rates of 5.0, 8.3, 13.6, 17.9, and 25.5 L/s (80, 131, 216, 284, and 404 USgpm) for intervals each lasting 20 minutes, and the final interval was extended provide a total test duration of 1,180 minutes (19.7 hours). Although not indicated in the well test record, it is understood that the pumping rate was increased to 31.5 L/s (500 USgpm) during the initial "constant-rate" portion step of the test, between about 90 and 200 minutes after pumping began.

The pumping test results are illustrated on Fig. 2. Drawdown is plotted versus the logarithm of time from the beginning of the test. The aquifer transmissivity estimated from the portion of the drawdown curve between 90 and 200 minutes using the Cooper-Jacob (1946) method is estimated at $5.3 \times 10^{-3} \text{ m}^2/\text{s}$. This was calculated using the recorded flow rate of 25.5 L/s. The actual rate recorded during this portion of the test may have been greater, which would result in a higher value of transmissivity. Water level recovery data was insufficient to provide a reliable estimate of transmissivity.

Extrapolating the portion of the drawdown curve between 90 and 200 minutes to 100 days yields a projected drawdown of 12.9m (42.3'). Using this value in a calculation of safe yield based on an allowable drawdown after 100 days equivalent to 70% of the available drawdown (Table I) results in a value of 28.4 L/s (450 USgpm).

A commonly accepted design concept is that water wells should be constructed with sufficient open area within the well screen so that during pumping the calculated entrance velocity will not exceed 0.1 feet per second (ft/second). The basis for this is that it is believed to maintain friction losses to a minimum, and to minimize potential for chemical encrustation and/or corrosion of the screens. The maximum capacity of the test well based on this limiting criteria (Table I) would be 15 L/s (241 USgpm). However, as the scientific basis for this 0.1 ft/second threshold is unclear, and it is judged that pumping the test well at rates up to 25 L/s (400 USgpm) is unlikely to result in any noticeable decrease in long-term well performance. Nevertheless, it is recommended that any new production wells should be designed to achieve a 0.1 ft/second screen entrance velocity.



Civic Consultants Ltd.

Attention: Lorne Davidson, P.Eng.

- 3 -

September 2, 2011


REVIEW OF WATER QUALITY ANALYSIS

A summary of all available water quality analyses is provided in Table II, including two water quality samples taken in 2010 following well construction, and one during the filtration test in 2011. All analyte concentrations were found to be below Canadian Drinking Water Guideline maximum acceptable concentrations and aesthetic objectives, except for manganese, which ranged from 0.112 to 0.115 mg/L, versus the aesthetic objective of 0.05 mg/L. Sulphurous smells noted from water samples and the high total sulphur content suggests that dissolved sulphide (H_2S) may exceed aesthetic guidelines. Corix (2011) indicated that sulphide concentrations were elevated, but the average concentration of 0.023 mg/L does not exceed the 0.05 mg/L. The source of this analysis was not available at the time of this report. Olfactory indications of the presence of sulphide dissolved in the well water observed during drilling and filtration tests indicate the water is chemically reduced.

CONCLUSIONS AND RECOMMENDATIONS

Piteau has completed a review of available data from the Harrison Hot Springs test well program including a review of pump test and water quality data and offers the following conclusions:

1. The relatively high transmissivity and calculated sustainable yield indicate that the local aquifer below the test site will likely sustain a groundwater flow sufficient to meet a demand of 25 L/s (400 USgpm).
2. Preliminary water quality analyses of samples from the test well indicate most major element concentrations are below detectable limits or at concentrations well below the maximum allowable concentrations and aesthetic objectives outlined by the Canadian Drinking Water Quality Guidelines. Corix (2011) demonstrated that concentrations of those elements which exceed, or potentially exceed, the guidelines (manganese and sulphide, respectively) can be reduced to achieve levels below the water quality guidelines.
3. The test well is situated within a region utilized for residential and agricultural purposes, and is in close proximity to natural mineral springs. Groundwater quality analyses should therefore be expanded to include potential contaminants from these sources, which could include bacteria, nutrients (ammonia, nitrite, & nitrate), pesticides and herbicides, and radionuclides.
4. An analysis of the potential for groundwater to be under the direct influence of surface water should be undertaken before the groundwater is utilized for drinking water purposes. Providing that the well is more than 100m (330') from the nearest surface watercourse, and that there are no E.Coli or coliform bacteria present in the groundwater from the well, it is likely that a determination that the well is not under the direct influence of surface water can be made.



Civic Consultants Ltd.

Attention: Lorne Davidson, P.Eng.

- 4 -

September 2, 2011

5. It is recommended that the capture zone(s) for all new supply wells should be estimated to enable definition of a wellhead protection zone, and development of an aquifer protection plan.
6. Due to the apparent heavy utilization of the aquifer illustrated by the density of reported groundwater wells in the aquifer (Fig. 1), and the anticipated stress this well will apply to the aquifer, an analysis of the potential for local well interference in the vicinity of the test well is advisable to ensure that the abilities of other wells in the vicinity are not affected.

LIMITATIONS

This letter of opinion has been prepared using a standard of care consistent with that expected of scientific and engineering professionals undertaking similar work under similar conditions in B.C. No warranty is expressed or implied.

This letter of opinion is prepared for the sole use of Civic Consultants Ltd. and their client, the Village of Harrison Hot Springs. Any use, interpretation, or reliance on this information by any third party, is at the sole risk of that party, and Piteau accepts no liability for such unauthorized use.


CLOSURE

We trust these comments are sufficient for your present needs. Please contact the either of the undersigned if you require further assistance.


Yours truly,

PITEAU ASSOCIATES ENGINEERING LTD.

Martin L. Stewart, P.Geo.
Hydrogeologist

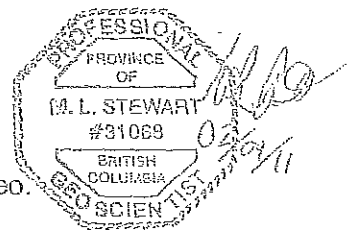

David J. Tiplady, P.Eng.
Principal Hydrogeologist
Vice President -- Groundwater



MLS/DJT/slc
Att.

REFERENCES

- Cooper, H.H. and Jacob, C.E., 1946. A generalized graphical method for evaluating formation constants and summarizing well field history. In American Geophysical Union transactions, V. 27, pp526-534.
- Corix Water Systems, 2011. Harrison Hot Springs pilot study. Report to the Village of Harrison Hot Springs, 13p.
- Health Canada, 2008. Guidelines for Canadian Drinking Water Quality. Prepared for by the Federal-Provincial-Territorial Committee on Drinking Water of the Federal-Provincial-Territorial Committee on Health and Environment. www.healthcanada.gc.ca/waterquality
- Theis, C.V., 1935. The relation between the lowering of the piezometric surface and the rate and duration of discharge of a well using groundwater storage, In American Geophysical Union transactions, V.16, pp519-524.

TABLES

TABLE I
TEST WELL YIELD CALCULATION

LEVELS AND RATES	UNIT	TEST WELL
CASING ELEVATION (ESTIMATE)	m-geod	10.97
STATIC WATER DEPTH ¹	m-bgl	4.27
STATIC WATER ELEVATION ²	m-geod	6.71
ESTIMATED INTERFERENCE FROM OTHER WELLS ²	m	
ALLOWANCE FOR SEASONAL WATER LEVEL REDUCTION	m	2.00
ESTIMATED MINIMUM STATIC DEPTH ³	m-bgl	6.27
DEPTH TO TOP OF WELL SCREEN	m-bgl	26.77
DEPTH TO PUMP INTAKE ⁴	m-bgl	24.77
RECOMMENDED LOWEST PUMPING DEPTH ⁵	m-bgl	22.77
AVAILABLE DRAWDOWN ⁶	m	20.50
FACTOR OF SAFETY	m	0.30
MAXIMUM ALLOWABLE DRAWDOWN ⁷	m	14.35
PUMP TEST LENGTH	min	1180
FINAL WATER DEPTH	m	13.87
DRAWDOWN AT END OF TEST	m	9.60
PROJECTED 100-DAY DRAWDOWN	m	12.90
PROJECTED 100-DAY SPECIFIC CAPACITY ⁸	L/s/m	1.98
TEST PUMPING RATE	L/s	25.5
	m ³ /day	2202
	USGPM	404
	IGPM	337
CALCULATED LINEAR YIELD ⁹	L/s	28.36
ESTIMATED SUSTAINABLE SAFE YIELD ¹⁰	L/s	>25.5
	m ³ /day	>2203
	USGPM	>404
	IGPM	>337
SCREEN LENGTH	m	4.9
OPEN AREA	cm ² / m	1016
TOTAL AREA	m ²	0.5
MAXIMUM SCREEN CAPACITY ¹¹	L/s	15
	m ³ /day	1311
	USGPM	241
	IGPM	200

H:\Project\3127\2011\Safe well yield Mar2010 production well-v2.xls\Well yield

- 1 Static water elevation at time of test.
- 2 No known well interference
- 3 Estimated minimum static depth is taken as measured static depth
- 4 Assumes pump intake is 2m above the base of lowest screen (i.e., motor 1m above bottom of screen and motor 1m in length).
- 5 Calculated as 2m above the pump intake
- 6 Difference between recommended lowest pumping level and estimated static elevation.
- 7 Allowable drawdown equals available times(1-factor of safety). No factor of safety used for dewatering design.
- 8 Specific capacity is pump test rate divided by drawdown at end of pump test.
- 9 Calculated linear yield is the allowable drawdown times the 100-day specific capacity.
- 10 Estimated sustainable yield is the calculated linear yield where this is less than the test pumping rate. For linear yields greater than the pump test flow rate, the sustainable yield may be nonlinear and therefore the pump test rate provides a minimum guideline sustainable safe yield.
- 11 Maximum screen capacity is calculated as screen opening area times recommended maximum entrance velocity of 0.1 ft/s.

**TABLE II
WATER QUALITY ANALYSES 2010/2011 AND DRINKING WATER GUIDELINES**


Sample ID	UNITS	WELL SAMPLE #1 ¹	WELL SAMPLE #2 ¹	SAMPLE AJ2988 ²	CDWQ ³ GUIDELINES MAC	CDWQ ⁴ GUIDELINES AO
Date Sampled		14-APR-10	14-APR-10	27-Apr-11		
Physical Tests						
Hardness ⁵ (as CaCO3)	mg/L	127	126		see below	see below
Total Metals						
Aluminum (Al)-Total	mg/L	<0.010	<0.010	<0.003		0.1
Antimony (Sb)-Total	mg/L	<0.00050	<0.00050	<0.0005	0.006	
Arsenic (As)-Total	mg/L	0.00453	0.00446	0.00570	0.01	
Barium (Ba)-Total	mg/L	0.033	0.032	0.036	1	
Boron (B)-Total	mg/L	<0.10	<0.10	<0.05	5	
Cadmium (Cd)-Total	mg/L	<0.00020	<0.00020	<0.0001	0.005	
Calcium (Ca)-Total	mg/L	36.9	36.7	39.1		
Chromium (Cr)-Total	mg/L	<0.0020	<0.0020	<0.001	0.05	
Copper (Cu)-Total	mg/L	<0.0010	0.0019	<0.0002		1
Iron (Fe)-Total	mg/L	0.062	0.103	0.076		0.3
Lead (Pb)-Total	mg/L	<0.00050	<0.00050	<0.0002	0.01	
Magnesium (Mg)-Total	mg/L	8.40	8.35	8.98		
Manganese (Mn)-Total	mg/L	0.112	0.115	0.115		0.05
Mercury (Hg)-Total	mg/L	<0.00020	<0.00020	<0.00005	0.001	
Molybdenum (Mo)-Total	mg/L			0.001		
Nickel (Ni)-Total	mg/L			0.001		
Potassium (K)-Total	mg/L	1.90	1.89	2.15		
Selenium (Se)-Total	mg/L	<0.0010	<0.0010	<0.0001	0.01	
Silver (Ag)-Total	mg/L			<0.00002		
Sodium (Na)-Total	mg/L	2.9	2.9	3.1		200
Sulfur (S)-Total ⁶	mg/L	0.97	0.96	<3		
Uranium (U)-Total	mg/L	<0.00010	<0.00010	<0.0001	0.02	
Vanadium (V)-Total	mg/L			<0.005		
Zinc (Zn)-Total	mg/L	<0.050	<0.050	<0.005		5

H:\Project\3127\2011\Water Quality Summary 30Aug11.xlsx\Results of Analysis

Notes:

1. Sample results from April 14, 2010 following well construction
2. Sample results from Corix (2011) pilot study
3. Canadian Drinking Water Quality Guidelines - Maximum acceptable concentrations (GCDWQ, 2010)
4. Canadian Drinking Water Quality Guidelines - Aesthetic objectives (GCDWQ, 2010)
5. "Generally, hardness levels between 80 and 100 mg/L (as CaCO3) are considered acceptable; levels greater than 200 mg/L are considered poor but can be tolerated; those in excess of 500 mg/L are normally considered unacceptable." (GCDWQ, 2010)
6. Canadian Drinking Water Quality Guidelines - Aesthetic objective for sulphide (H₂S) is 0.05 mg/L (GCDWQ, 2010)

FIGURES

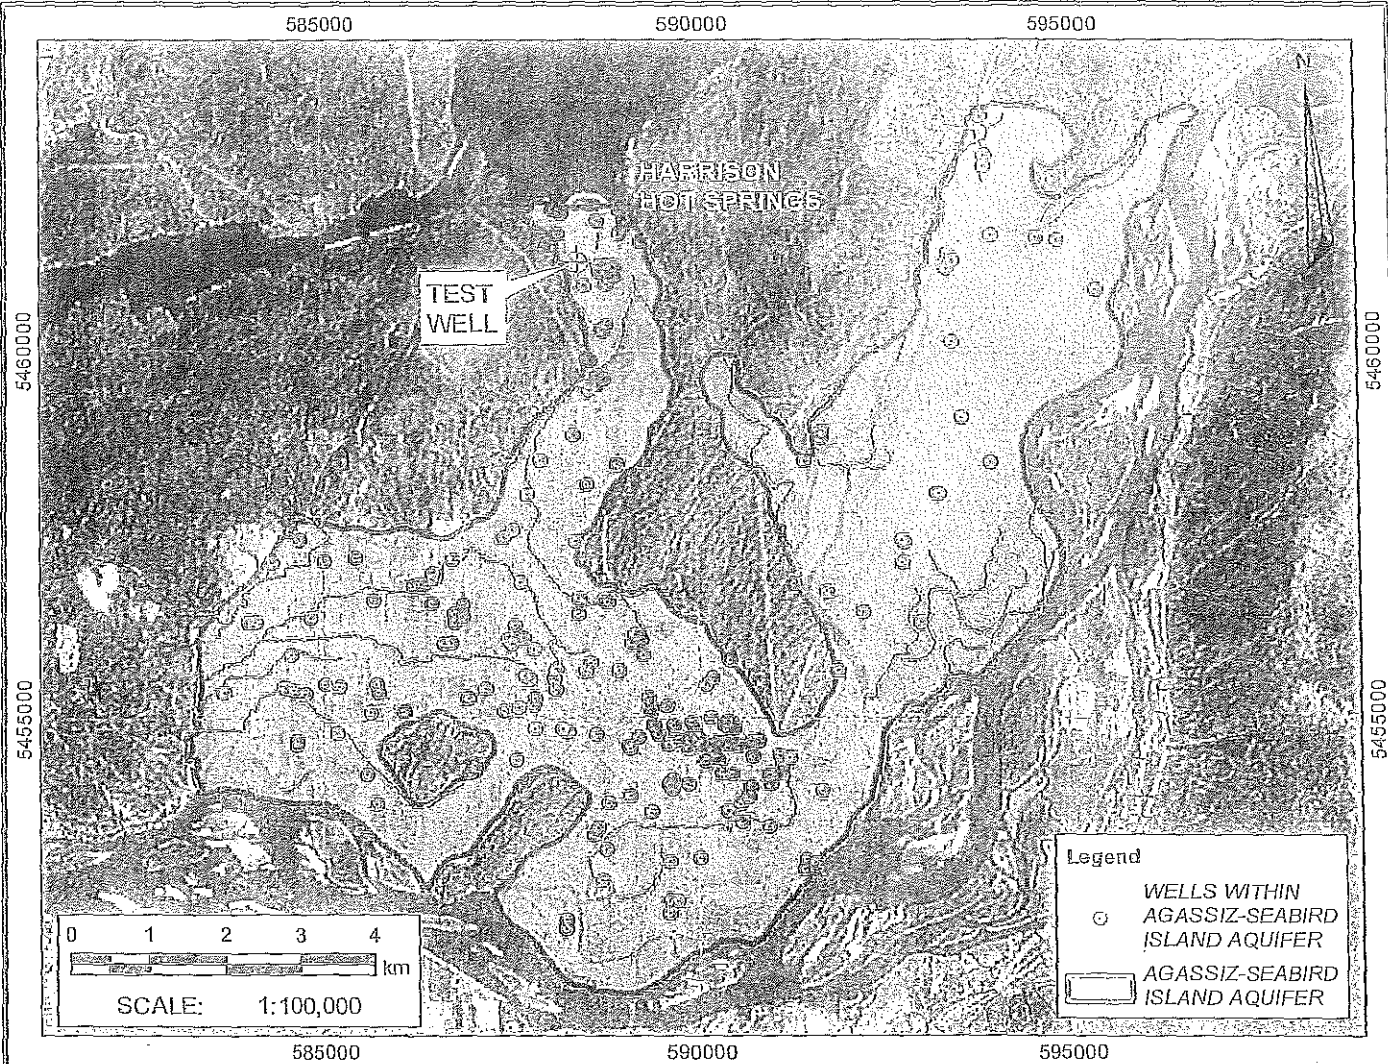

PREPARED SOLELY FOR THE USE OF OUR CLIENT AND NO REPRESENTATION OF ANY KIND IS MADE TO OTHER PARTIES WITH WHICH PITEAU ASSOCIATES ENGINEERING LTD. HAS NOT ENTERED INTO A CONTRACT.

VILLAGE OF HARRISON HOT SPRINGS
WELL WATER PILOT STUDY REVIEW



PITEAU ASSOCIATES
GEOTECHNICAL AND HYDROGEOLOGICAL CONSULTANTS

PLAN MAP AND OBLIQUE AERIAL VIEW OF HARRISON HOT SPRINGS
AND THE AGASSIZ -SEABIRD ISLAND AQUIFER

BY:	DATE:
MLS	AUG 11
APPROVED:	FIG:
DJT	1

APPENDIX A

A & H DRILLING WELL RECORD

APPENDIX B

CORIX UTILITIES WELL TEST REPORT



Harrison Hot Springs Pilot Study April 2011

Objective of the study

To determine if removal of unacceptable levels of Manganese and Hydrogen Sulphide from a well water source is possible using Greensand filter media at a pumped flow rate equivalent to what would be required to service the community's treated water needs.

Provide raw water analysis of the parameters required in the Canadian Drinking Water Guidelines (CDWG).

Description of water source

Harrison Hot Springs well head behind the fire hall. The well was drilled and tested for draw down characteristics in April, 2010 by Corix Utilities.

Source water testing parameters

Source flow rates for testing: 10 and 400 GPM

Time line: 3 days of testing with 2 samples taken per day.

The first 2 days at low flow, 3rd day at high flow

Filtering parameters

Filter Media used: 610 mm (24") of Greensand plus, 505 mm (12") of anthracite

The Pilot Plant flow rate for the testing: 1 Litre/min. (0.264 gal/min.)

Surface area of the filter: 12.57 sq.in. (0.087 sq.ft.)

Surface loading: 3.03 GPM/ sq.ft.

Batch regeneration of the media was accomplished using Potassium Permanganate powder. See the "Testing Methods" section at the end of the document for details.

Analysis

Analysis of the water samples was by Maxxam Analytical, Burnaby BC.

Results of lab analysis

A summary of the comparison of the Guidelines for Canadian Drinking Water Quality to the Maxxam lab results is as follows.

General Drinking Water Parameter Test:

All raw water measured parameters were below regulated and aesthetic limits except for Manganese.

Manganese Tests

GCDWQ aesthetic objective: <0.05 mg/l

Raw water average: 0.12 mg/l

Treated water average 0.008 mg/l

Average removal efficiency 93%

Sulphide Tests

GCDWQ aesthetic objective:	<0.05 mg/l		
Raw water average:	0.023 mg/l	400 gpm value	0.027 mg/l
Treated water average	0.007 mg/l		
Average removal efficiency	70%		

The results indicate that all measured treated water parameters were within GCDWQ by a safe margin. This result is indicative that the manganese green sand filter system would safely and economically meet VHHS's potable water objectives.

The pilot test operator also indicated that the water taste quality was good with only very faint odours before treatment and no odours following treatment.

Please see the test results below.

Pictures of the pilot equipment and site are included on the last page

Please note that the Mn and H₂SO₄ test results for the first day's tests are included as part of the CDWG spreadsheets.

A complete copy of the Maxxam Analytical analysis documents is available from Corix Water Systems on request.

Sample results

Day 1 - 10 GPM well flow rate.

One Raw Water sample taken at the same time as the first filtered (Filtered 1) sample.

Raw Water sample taken for CDWG analysis.




Maxam Job #: B131477
Report Date: 2011/04/27

Corix Water Systems Inc.

RESULTS OF CHEMICAL ANALYSES OF WATER

Maxam ID		AJ2988	AJ2089	AJ3007	AJ3006		
Sampling Date		2011/04/19 12:15	2011/04/19 12:15	2011/04/19 12:15	2011/04/19 15:00		
COCs		G033607	G033607	G033607	G033607	RDL	QC Batch
	Units	1L - CDWG, 240ML MICROBIOLOGY, 120ML METAL	120ML - RW MN/SULPHIDE	120ML - FILTERED 1 MN/SULPHIDE	120ML - FILTERED 2 MN/SULPHIDE		
ANIONS							
Nitrite (N)	mg/L	<0.005				0.005	4804541
Calculated Parameters							
Filter and HNO ₃ Preservation	N/A		FIELD	FIELD	FIELD	N/A	ONSITE
Total Hardness (CaCO ₃)	mg/L	146				0.5	4800416
Nitrate (N)	mg/L	<0.02				0.02	4800294
Misc. Inorganics							
Fluoride (F)	mg/L	0.07				0.01	4810203
Alkalinity (Total as CaCO ₃)	mg/L	140				0.5	4801188
Alkalinity (PP as CaCO ₃)	mg/L	<0.5				0.5	4801180
Bicarbonate (HCO ₃)	mg/L	170				0.5	4801188
Carbonate (CO ₃)	mg/L	<0.5				0.5	4801180
Hydroxide (OH)	mg/L	<0.5				0.5	4801188
Anions							
Dissolved Sulphate (SO ₄)	mg/L	1.9				0.5	4804400
Dissolved Chloride (Cl)	mg/L	3.5				0.5	4804405
MISCELLANEOUS							
True Colour	Col. Unit	<5				5	4802659
Sulphide	mg/L		0.017	0.007	<0.005	0.005	4802907
Nutrients							
Nitrate plus Nitrite (N)	mg/L	<0.02				0.02	4804492
Physical Properties							
Conductivity	uS/cm	273				1	4801186
pH	pH Units	8.10					4801179
Physical Properties							
Total Dissolved Solids	mg/L	170				10	4809605
Turbidity	NTU	0.2				0.1	4802366

N/A = Not Applicable
RDL = Reportable Detection Limit



Maxxam Job #: B101477
Report Date: 2011/04/27

Corix Water Systems Inc.

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Maxxam ID		AJ2956	AJ2959	AJ3007	AJ3008		
Sampling Date		2011/04/19 12:15	2011/04/19 12:15	2011/04/19 12:15	2011/04/19 15:00		
QOC#		G033607	G033607	G033607	G033607	ROL	QC Batch
Units		1L - CDWG, 240ML MICROBIOLOGY, 120ML METAL	120ML - RW MN/SULPHIDE	120ML - FILTERED 1 MN/SULPHIDE	120ML - FILTERED 2 MN/SULPHIDE		
Dissolved Metals by ICPMS							
Dissolved Manganese (Mn)	ug/L		111	5	2	1	4001040
Total Metals by ICPMS							
Total Aluminum (Al)	ug/L	<3				3	4006525
Total Antimony (Sb)	ug/L	<0.5				0.5	4006525
Total Arsenic (As)	ug/L	5.7				0.1	4006525
Total Barium (Ba)	ug/L	30				1	4006525
Total Boron (B)	ug/L	<50				50	4006525
Total Cadmium (Cd)	ug/L	<0.01				0.01	4006525
Total Chromium (Cr)	ug/L	<1				1	4006525
Total Cobalt (Co)	ug/L	<0.5				0.5	4006525
Total Copper (Cu)	ug/L	<0.2				0.2	4006525
Total Iron (Fe)	ug/L	70				5	4006525
Total Lead (Pb)	ug/L	<0.2				0.2	4006525
Total Manganese (Mn)	ug/L	115				1	4006525
Total Mercury (Hg)	ug/L	<0.05				0.05	4006525
Total Molybdenum (Mo)	ug/L	7				1	4006525
Total Nickel (Ni)	ug/L	<1				1	4006525
Total Selenium (Se)	ug/L	<0.1				0.1	4006525
Total Silver (Ag)	ug/L	<0.02				0.02	4006525
Total Uranium (U)	ug/L	<0.1				0.1	4006525
Total Vanadium (V)	ug/L	<5				5	4006525
Total Zinc (Zn)	ug/L	<5				5	4006525
Total Calcium (Ca)	mg/L	39.1				0.05	4001203
Total Magnesium (Mg)	mg/L	5.03				0.05	4001203
Total Potassium (K)	mg/L	2.15				0.05	4001203
Total Sodium (Na)	mg/L	3.11				0.05	4001203
Total Sulphur (S)	mg/L	<3				3	4001203

RDL = Reportable Detection Limit




Maxxam Job #: B131477
Report Date: 2011/04/27

Corix Water Systems Inc.

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Maxxam ID	AJ2988	AJ2989	AJ3007	AJ3008		
Sampling Date	2011/04/19 12:15	2011/04/19 12:15	2011/04/19 12:15	2011/04/19 15:00		
COC#	G033607	G033607	G033607	G033607		
Units	1L - CDWG, 240ML MICROBIOLOGY, 120ML METAL	120ML - RW MN/SULPHIDE	120ML - FILTERED 1 MN/SULPHIDE	120ML - FILTERED 2 MN/SULPHIDE	RDL	QC Batch
Dissolved Metals by ICPMS						
Dissolved Manganese (Mn)	ug/L	111	5	2	1	4801040
Total Metals by ICPMS						
Total Aluminum (Al)	ug/L	<0			3	4806825
Total Antimony (Sb)	ug/L	<0.5			0.5	4806825
Total Arsenic (As)	ug/L	5.7			0.1	4806825
Total Barium (Ba)	ug/L	36			1	4806825
Total Boron (B)	ug/L	<50			50	4806825
Total Cadmium (Cd)	ug/L	<0.01			0.01	4806825
Total Chromium (Cr)	ug/L	<1			1	4806825
Total Cobalt (Co)	ug/L	<0.5			0.5	4806825
Total Copper (Cu)	ug/L	<0.2			0.2	4806825
Total Iron (Fe)	ug/L	76			5	4806825
Total Lead (Pb)	ug/L	<0.2			0.2	4806825
Total Manganese (Mn)	ug/L	115			1	4806825
Total Mercury (Hg)	ug/L	<0.05			0.05	4806825
Total Molybdenum (Mo)	ug/L	1			1	4806825
Total Nickel (Ni)	ug/L	<1			1	4806825
Total Selenium (Se)	ug/L	<0.1			0.1	4806825
Total Silver (Ag)	ug/L	<0.02			0.02	4806825
Total Uranium (U)	ug/L	<0.1			0.1	4806825
Total Vanadium (V)	ug/L	<5			5	4806825
Total Zinc (Zn)	ug/L	<5			5	4806825
Total Calcium (Ca)	mg/L	39.1			0.05	4801203
Total Magnesium (Mg)	mg/L	8.88			0.05	4801203
Total Potassium (K)	mg/L	2.15			0.05	4801203
Total Sodium (Na)	mg/L	3.11			0.05	4801203
Total Sulphur (S)	mg/L	<3			5	4801203

RDL = Reportable Detection Limit



Maxxam Job #: B132044
Report Date: 2011/04/26

Corix Water Systems Inc.

RESULTS OF CHEMICAL ANALYSES OF WATER

Maxxam ID		AJ6404	AJ6405	AJ6406	AJ6407	AJ6408	AJ6409		
Sampling Date		2011/04/20 11:20	2011/04/20 11:20	2011/04/20 11:20	2011/04/20 11:20	2011/04/20 13:30	2011/04/20 13:30		
CO#		G033606	G033606	G033606	G033606	G033606	G033606	RDL	QC Batch
Units		120ML- FILTER 3 RW MN	120ML- FILTER 3 RW SULPHIDE	120ML- FILTERED 3 MN	120ML- FILTERED 3 SULPHIDE	120ML- FILTERED 4 MN	120ML- FILTERED 4 SULPHIDE		
Calculated Parameters									
Filler and HNO3 Preservation	N/A	FIELD		FIELD		FIELD		N/A	ONSITE
MISCELLANEOUS									
Sulphide	mg/L		0.017		0.007		0.007	0.005	4805406

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Maxxam ID		AJ6404	AJ6406	AJ6408		
Sampling Date		2011/04/20 11:20	2011/04/20 11:20	2011/04/20 13:30		
CO#		G033606	G033606	G033606	RDL	QC Batch
Units		120ML- FILTER 3 RW MN	120ML- FILTERED 3 MN	120ML- FILTERED 4 MN		
Dissolved Metals by ICPMS						
Dissolved Manganese (mn)	ug/L	114	<1	<1	1	#B07391


N/A = Not Applicable
RDL = Reportable Detection Limit

Sample results
Day 2 - 10 GPM well flow rate.
One Raw Water sample taken at the same time as the first filtered (Filtered 3) sample



Sample results

Day 3 - 400 GPM well flow rate.



Maxxam Job #: B182081
Report Date: 2011/04/28

Corix Water Systems Inc.
Client Project #: HARRISON WELL TEST
Site Reference: HARRISON HOT SPRINGS

RESULTS OF CHEMICAL ANALYSES OF WATER

Maxxam ID		AJ6663	AJ6664	AJ6665	AJ6666		
Sampling Date		2011/04/21 10:00	2011/04/21 10:00	2011/04/21 12:00	2011/04/21 12:00		
COC#		G033600	G033608	G033608	G033600		
	Units	FILTER 5 RW MN/SULPHIDE	FILTERED 5 MN/SULPHIDE	FILTERED 6 RW MN/SULPHIDE	FILTERED 6 MN/SULPHIDE	RDL	QC Batch
Calculated Parameters							
Filter and HNO ₃ Preservation	N/A	FIELD	FIELD	FIELD	FIELD	N/A	ONSITE
MISCELLANEOUS							
Sulphide	mg/L	0.024	0.007	0.027	0.007	0.005	4013393

ELEMENTS BY ATOMIC SPECTROSCOPY (WATER)

Maxxam ID		AJ6663	AJ6664	AJ6665	AJ6666		
Sampling Date		2011/04/21 10:00	2011/04/21 10:00	2011/04/21 12:00	2011/04/21 12:00		
COC#		G033600	G033608	G033608	G033606		
	Units	FILTER 5 RW MN/SULPHIDE	FILTERED 5 MN/SULPHIDE	FILTERED 6 RW MN/SULPHIDE	FILTERED 6 MN/SULPHIDE	RDL	QC Batch
Dissolved Metals by ICPMS							
Dissolved Manganese (Mn)	ug/L	126	22	121	10	1	4000118

N/A = Not Applicable
RDL = Reportable Detection Limit

One Raw Water sample was taken at the same time as each of the filtered samples (Filtered 5 & 6). This provides a direct comparison for the flow over time.



Testing method, details and notes

Monday, April 18th

I traveled to Harrison Hot Springs on the morning of April 18th. The pilot equipment was picked up from our yard by Corix Utilities and arrived at site shortly afterward. It was placed (and operated) outside near the well head at the back of the fire hall.

Corix Utilities installed a 10 GPM pump for the first set of tests. Power for the pump was provided from the distribution panel in the fire hall via our connection box. The first day was spent setting up the equipment and making the connections for power for the filter skid and 10 GPM pump. After set-up was completed the plant was run overnight.

Tuesday, April 19th

The plant ran all night without incident and the clearwell was full to allow for backwashing. The filter media was soaked in a 0.5% KMNO₄ solution for about an hour then backwashed until clear. The plant was put back on line and run continuously for the 2 days of testing at the 10 GPM flow rate.

Samples were taken as follows:

CDWG	12:15
Raw water - Mn	12:15
Raw water - Sulphide	12:15
Filtered water - Mn	12:15
Filtered water - Sulphide	12:15
Filtered water - Mn	15:00
Filtered water - Sulphide	15:00

The samples were delivered to UPS depot in Chilliwack for overnight shipping to Maxxam Analytical.

Wednesday, April 20th

Samples were taken as follows:

Pilot plant had run all night without incident.

Raw water - Mn	11:20
Raw water - Sulphide	11:20
Filtered water - Mn	11:20
Filtered water - Sulphide	11:20
Filtered water - Mn	13:30
Filtered water - Sulphide	13:30

The samples were delivered to UPS depot in Chilliwack for overnight shipping to Maxxam Analytical.

After the last samples were taken at 13:30 the Corix Utilities crew arrived with the 40 GPM pump and portable generator. The 10 GPM pump was removed and the 400 GPM pump installed and tested. The media was backwashed and soaked overnight in a 0.5% KMNO₄ solution.

Thursday, April 21st

The media was backwashed until clear then the generator and 400 GPM pump were started (8:30). The plant was run until about 13:00 and samples taken as follows:

Raw water - Mn	10:00
Raw water - Sulphide	10:00
Filtered water - Mn	10:00
Filtered water - Sulphide	10:00
Raw water - Mn	12:00
Raw water - Sulphide	12:00
Filtered water - Mn	12:00
Filtered water - Sulphide	12:00

The samples were delivered to UPS depot in Chilliwack for overnight shipping to Maxxam Analytical.

The water level in the well was measured when the Utilities crew arrived to remove the pump. Water level before starting the pump was approx 14' below the well casing. After 5 hours of pumping at 400 GPM the water level was 42.2 ' below the well casing.

Two raw water samples were taken to determine how pumping at the high flow rate will affect the amount of Mn and Sulphide in the water over time.



At 13:00 the pump and generator were stopped and the equipment disconnected, packed up and loaded on the Utilities truck for shipping.


The last set of samples were hand delivered to Maxxam Analytical in Burnaby at 16:00, as there was no delivery service available from Chilliwack due to the Easter Friday holiday.

Note

It was mentioned by Dave Harris that there was a strong Sulfur odor during the initial 400GPM draw down test when the well was bored in April of 2010. This was not the case during this testing. Although there was some odor present it was not overpowering. No odor or taste of Sulfur could be detected from the filtered water in the clearwell.

Report compiled by:
David MacKay
Corix Water Systems
Langley, BC
2011/4/29

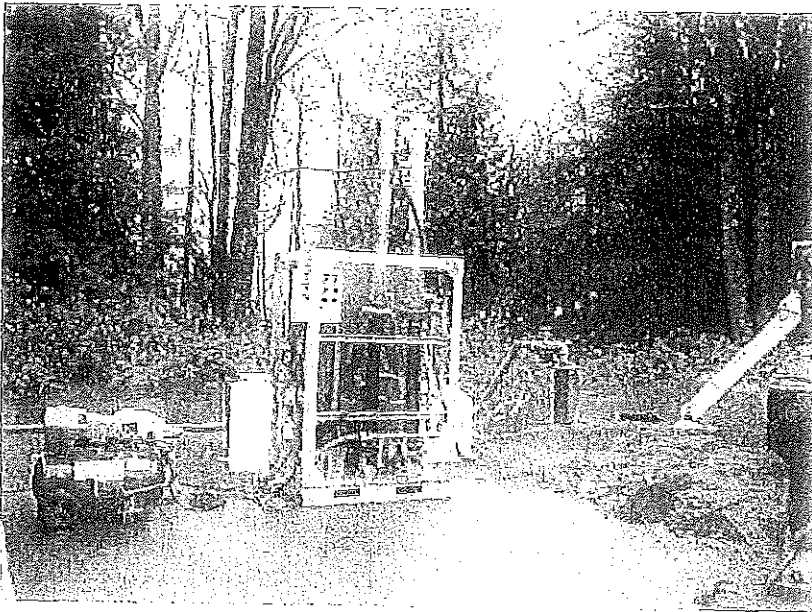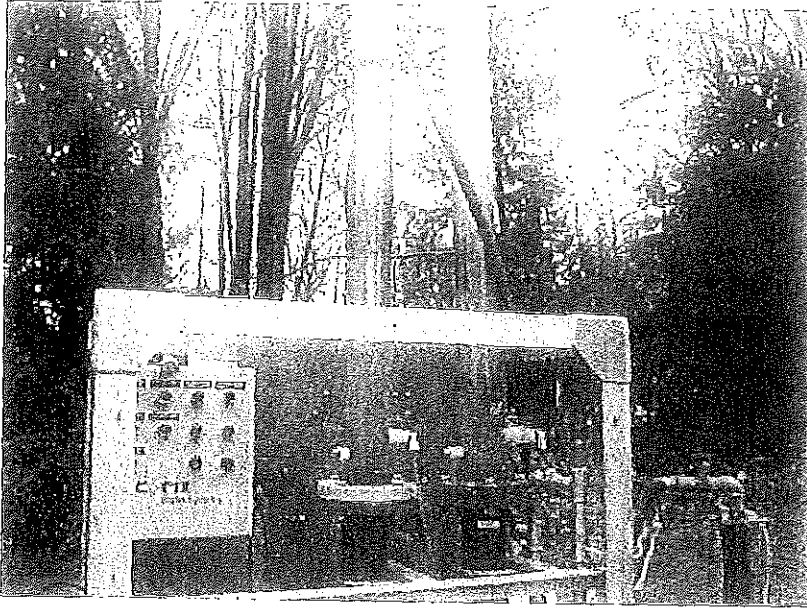

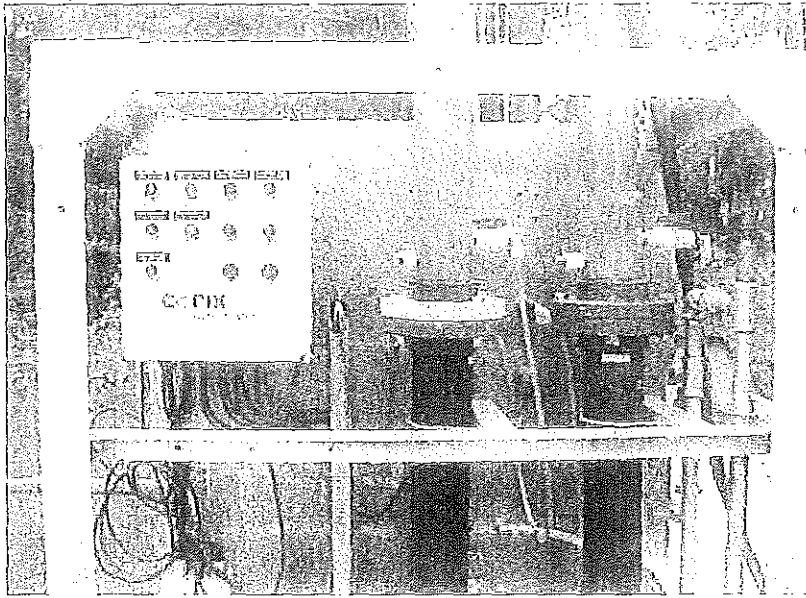

Turbidity

Guideline

Waterworks systems that use a surface water source or a groundwater source under the direct influence of surface water should filter the source water to meet the following health-based turbidity limits, as defined for specific treatment technologies. Where possible, filtration systems should be designed and operated to reduce turbidity levels as low as possible, with a treated water turbidity target of less than 0.1 NTU at all times. Where this is not achievable, the treated water turbidity levels from individual filters shall be:

1. *For chemically-assisted filtration, less than or equal to 0.3 NTU in at least 95% of the measurements made, or at least 95% of the time each calendar month and not exceed 1.0 NTU at any time.*
2. *For slow sand or diatomaceous earth filtration, less than or equal to 1.0 NTU in at least 95% of the measurements made, or at least 95% of the time each calendar month and not exceed 3.0 NTU at any time.*
3. *For membrane filtration, less than or equal to 0.1 NTU in at least 99% of the measurements made, or at least 99% of the time each calendar month and not exceed 0.3 NTU at any time. If membrane filtration is the sole treatment technology employed, some form of virus inactivation[†] should follow the filtration process.*

It is not expected that all water supplies will be able to meet this revised turbidity guideline immediately. Therefore, supplementary treatment should be considered in the interim to ensure delivery of a safe drinking water.

Executive Summary

Particles of matter are naturally suspended in water. These particles can be clay, silt, finely divided organic and inorganic matter, plankton and other microscopic organisms. Turbidity is a measurement of how light scatters when it is aimed at water and bounces off the suspended particles. It is not a measurement of the particles themselves. In general terms, the cloudier the water, the more the light scatters and the higher the turbidity.

The best means of reducing turbidity and safeguarding a drinking water supply is to apply a multiple-barrier approach (i.e., source to tap) to protect drinking water. The focus of this approach is to look at the entire drinking water supply, identify potential and existing hazards and then develop strategies to deal with each of the hazards.

Treatment plants can reduce turbidity by filtering particles out of the water. All filtration systems should be designed and operated to reduce turbidity levels as low as possible. The treated water turbidity target is 0.1 NTU at all times. However, even though effective filtration can be accomplished using any one of a number of technologies, the actual levels of turbidity

[†] Some form of virus inactivation is required for all technologies. The difference is that chemically-assisted, slow sand and diatomaceous earth filters are credited with log virus reductions and membrane filters receive no credit.

Turbidity (10/03)

achieved will vary from technology to technology. For this reason, the turbidity guideline is broken down by type of technology.

The most important consideration when dealing with turbidity is to make sure the levels remain low and fairly constant over time. Concerns are most likely to result from a spike in the level of turbidity, due either to an increase in the amount of particulate matter in the source water (e.g., from heavy rains) or to a breakdown in the treatment process (e.g., inadequate coagulation, a ruptured filter). Because it might otherwise be difficult to notice a spike in turbidity when only one filter in a plant is not be working properly, the guideline applies to each individual filter within a filtration system.

Health considerations

It is important to control turbidity in public water supplies for both health and aesthetic reasons. Suspended matter can contain toxins such as heavy metals and biocides and can also harbour microorganisms, protecting them from disinfection. Recent research has correlated turbidity levels with treated water supplies being contaminated with *Giardia* and *Cryptosporidium*. These microorganisms can cause outbreaks of illness. As such, turbidity may be used as a health parameter to indicate the safety of water leaving a filtration system. Because turbidity can affect the microbiological quality of drinking water, this guideline should be read in conjunction with the bacteriological guidelines. Excessive turbidity may also be associated with unpleasant tastes and odours.

In addition, high turbidity can lead to an increase in the amount of disinfection by-products that form in treated water. Trihalomethanes (THMs), for instance, are a group of chemical compounds that form when chlorine reacts with organic material in water. By filtering out the organic matter to reduce turbidity, treatment plants also reduce the amount of THMs that may form in the water. For more information on these disinfection by-products, see the THMs guideline and supporting document.

The nature of turbidity and its health implications vary with the type of source water. Turbidity in surface water and groundwater that comes into contact with surface water (referred to as groundwater under the direct influence of surface water), however, is generally organic in nature and may contain toxins, harbour pathogens, or lead to the formation of THMs. Turbidity in secure groundwater supplies (i.e., not under the influence of surface water) is generally non-organic and should pose no health threat. The health-based guideline and target for turbidity therefore only apply to surface water sources and groundwater under its influence.

Analytical and Treatment Considerations

Turbidity is easy and inexpensive to measure. In addition to being an indicator for determining the relative safety of drinking water, it is a useful tool for assessing the performance of water treatment processes.

Turbidity is measured in nephelometric turbidity units, or NTU, using a device called a turbidimeter. Modern turbidimeters can make measurements of 0.1 NTU or lower. Levels of turbidity in raw waters can range from 1.0 NTU to more than 1000.0 NTU. Levels vary at individual locations over time.

A number of studies indicate that properly designed and well-operated conventional, chemically-assisted and direct filtration water treatment plants can readily achieve a safe finished water with turbidity levels lower than 0.2 NTU. Meeting the guideline level of 0.3 NTU for these systems should be straightforward. Slow sand and diatomaceous earth filtration plants can consistently achieve a safe finished water turbidity levels of less than 1.0 NTU. Membrane filtration plants can consistently achieve finished water turbidity of less than 0.1 NTU. For all filtration technologies, these limits are achievable and expected in 95-99% of measurements, but a target of 0.1 NTU should be sought at all times.

Application of the guideline

The health-based turbidity guideline applies to drinking water produced by systems that use either a surface water source or a groundwater source under the direct influence of surface water. The guideline is applied to individual filter turbidity. However, good operating practices suggest that both the individual filter turbidity and the combined filter turbidity should be continuously monitored. Drinking water taken from pristine sources may be exempt from the filtration requirements if it meets all of the criteria outlined below (see “Criteria for the exclusion of filtration in waterworks systems”).

Surface water is defined as all waters open to the atmosphere and subject to surface runoff. Groundwater under the direct influence of surface water is defined as “any water beneath the surface of the ground with (i) significant occurrence of insects or other macro-organisms, algae, organic debris, or large-diameter pathogens such as *Giardia lamblia*, *Cryptosporidium*, or (ii) significant and relatively rapid shifts in water characteristics such as turbidity, temperature, conductivity, or pH which closely correlate to climatological or surface water conditions.”¹ Key issues that should be considered when determining whether groundwater is under the influence of surface water are given in Appendix A.

The health-based turbidity guideline does not apply to secure groundwater sources, i.e., those not under the direct influence of surface water. Turbidity in these cases is non-organic, should pose no health threat and should not hinder disinfection. However, for effective operation of the distribution system, it is good practice to ensure water entering the distribution system has low turbidity levels of around 1.0 NTU.

Monitoring turbidity levels

For chemically-assisted filtration (i.e., continuous feed of a coagulant with mixing ahead of filtration), source water turbidity levels should be measured at least once per calendar day directly in front of where the first treatment chemical is applied. Treated water turbidity levels from individual filters should be continuously measured (with an on-line turbidimeter) at intervals no longer than five minutes apart at a point upstream of the combined filter effluent line or the clear water tank.

For slow sand or diatomaceous earth filtration, water turbidity levels from individual filters should be continuously measured (with an on-line turbidimeter) at intervals no longer than five minutes apart at a point upstream of the combined filter effluent line or the clear water

Turbidity (10/03)

tank. However, the frequency of monitoring may be reduced to one grab sample per day if it can be demonstrated that this frequency gives a reliable measure of filter performance.

For membrane filtration, treated water turbidity levels from individual filters should be continuously measured (with an on-line turbidimeter) at intervals no longer than five minutes apart at a point upstream of the combined filter effluent line or the clear water tank. An individual membrane filter may be defined as a unit or group of membrane stacks or cartridges within a train that may be valved and isolated from the rest of the system for testing and maintenance. Process designs should include a minimum of two parallel trains, if practical. Consideration should be given to installing on-line turbidity meters to analyze the water unique to each "individual" filter.

Use of alternative filtration technology by waterworks systems

A waterworks system can use a filtration technology other than the technologies stipulated if, in combination with disinfection, it reliably achieves at least a 3-log reduction of *Giardia lamblia* cysts and *Cryptosporidium* oocysts and a 4-log reduction of viruses. Pilot studies or equivalencies from other jurisdictions should demonstrate that the technology meets these criteria.

Criteria for exclusion of filtration in waterworks systems

Filtration of a surface water source or a groundwater source under the direct influence of surface water may not be necessary if *all* of the following conditions are met:

1. Overall inactivation is met using a minimum of two disinfectants:
 - ultraviolet irradiation or ozone to inactivate cysts/oocysts;
 - chlorine (free chlorine) to inactivate viruses; and
 - chlorine or chloramines to maintain a residual in the distribution system.

Disinfection should reliably achieve at least a 99% (2-log) reduction of *Cryptosporidium* oocysts[‡], a 99.9% (3-log) reduction of *Giardia lamblia* cysts and a 99.99% (4-log) reduction of viruses. If mean source water cyst/oocyst levels are greater than 10/1000 L, more than 99% (2-log) reduction of *Cryptosporidium* oocysts, and 99.9% (3-log) reduction of *Giardia lamblia* cysts should be achieved. Background levels for *Giardia lamblia* cysts and *Cryptosporidium* oocysts in the source water should be established by monitoring as described in the most recent "Protozoa" guideline document, or more frequently during periods of expected highest levels (e.g., during spring runoff, or after heavy rainfall).

2. Prior to the point where the disinfectant is applied, the number of *Escherichia coli* bacteria in the source water does not exceed 20/100 mL (or, if *Escherichia coli* data is not available, the number of total coliform bacteria does not exceed 100/100 mL) in at least 90% of the weekly samples from the previous six months.

[‡] Studies on human volunteers have demonstrated that *Cryptosporidium* oocysts are less infectious than *Giardia* cysts by about one order of magnitude.

3. Average daily source water turbidity levels measured at equal intervals (at least every four hours), immediately prior to where the disinfectant is applied, range around 1.0 NTU but do not exceed 5.0 NTU for more than two days in a 12-month period. Source water turbidity also does not show evidence of protecting microbiological contaminants.
4. A watershed control program (e.g., protected watershed, controlled discharges, etc.) is maintained that minimizes the potential for faecal contamination in the source water.

Considerations for groundwater systems

In keeping with the multi-barrier approach to drinking water quality management, systems using secure groundwater sources should:

1. Ensure groundwater wells are properly constructed, are located in areas where there is minimum potential for contamination, and have appropriate wellhead protection measures in place. These source protection measures protect public health by reducing the risk of the drinking water source becoming contaminated.
2. Ensure treatment is sufficient to achieve 4-log reduction of viruses by disinfection. It is important to confirm that elevated turbidity levels will not compromise the disinfection process.
3. Maintain a chlorine residual throughout the distribution system and ensure water quality is monitored and maintained. Well-designed and operated distribution systems are key to providing safe, clean drinking water to consumers.

Identity and Sources in the Environment

The sources and nature of turbidity are varied and complex and are influenced by the physical, microbiological and chemical characteristics of water. In surface waters and groundwater under the direct influence of surface water, turbidity can vary significantly over time which has important implications for drinking water treatment processes and the microbiological safety of the drinking water. Particulate matter is frequently a source of nutrients for microorganisms and can protect microorganisms from both chemical and ultraviolet light disinfection. Particles contributing to turbidity may also carry undesirable chemical contaminants such as heavy metals. Turbidity can seriously affect the safety and acceptability of drinking water to consumers.

Description of turbidity

Turbidity is a “measure of the relative clarity of water.”³ Turbidity in water is caused by suspended and colloidal matter, such as clay, silt, finely divided organic and inorganic matter, and plankton and other microscopic organisms. However, turbidity is not a direct measure of suspended particles suspended in the water. It is, rather, a measure of the scattering effect such particles have on light. A directed beam of light remains relatively undisturbed when transmitted through absolutely pure water, but even the molecules in a pure fluid will scatter light to a certain degree. *Standard Methods for the Examination of Water and Wastewater* defines

Turbidity (10/03)

turbidity as an “expression of the optical property that causes light to be scattered and absorbed rather than transmitted with no change in direction or flux level through the sample.”⁴

In samples containing suspended solids, the manner in which water interferes with light transmittance is related to the size, shape and composition of the particles in the water and to the wavelength (colour) of the light that falls on the particles (incident light).⁵ A minute particle absorbs the incident light falling on it and then re-radiates the light in all directions.

The detection, measurement and visual perception of turbidity is influenced by a number of factors. Particle size has an impact on the direction in which light is scattered and on the intensity of scattered light of differing wavelengths (colours). The shape of the particle also influences light scattering, as does the refractive index of the water and the colour of the particles.

Light scattering intensifies as particle concentration increases. However, as scattered light strikes more and more particles, multiple scattering occurs, and absorption of light increases. When particulate concentration exceeds a certain point, detectable levels of both scattered and transmitted light drop rapidly, marking the upper limit of measurable turbidity. By decreasing the path length of light through the sample, the number of particles between the light source and light detector is reduced, extending the upper limit of turbidity measurement.

Because several factors affect the intensity of light scattering, it is not possible to relate scattered light measurements directly to the number or weight of suspended solids in a given volume of water with any accuracy. Direct correlations can be made only if such factors as the size, distribution, shape, refractive index and absorptive capacity of the suspended solids causing the turbidity remain constant; this can only be achieved in a laboratory and is therefore impractical and unnecessary in most cases.⁵

Sources

Levels of turbidity in raw water can range from less than 1.0 NTU to more than 1000.0 NTU. The particles that cause turbidity in water range in size from colloidal dimensions (approximately 10 nm) to diameters of the order of 0.1 mm and can be divided into three general classes: clays, organic particles resulting from decomposition of plant and animal debris, and fibrous particles from asbestos minerals.²⁰ Clay particles generally have an upper diameter limit of about 0.002 mm, but can be as large as 0.02 mm. Biological organisms may also cause turbidity.

Particulate material in natural waters is mostly made up of eroded soil particles from the surrounding area. Coarser sand and silt fragments are at least partially coated with organic material. Clay particles are composed of clay minerals, usually phyllosilicates, as well as non-clay material, such as iron and aluminum oxides and hydroxides, quartz, amorphous silica, carbonates and feldspar.²⁰ Clays and organic particles are often found together as a “clay organic complex.”²⁰ To a certain extent, it is artificial to treat the organic (humic) component in isolation from the inorganic component when considering the behaviour of suspended matter. However, humic substances have a much higher adsorptive capacity than clays (870 meq/100 g and 80 100 meq/100 g, respectively²¹); the effect of humic components likely predominates in many instances.

Other particles in raw water and drinking water supplies include the group of naturally occurring hydrated silicate minerals with fibrous structures known as asbestos; inorganic precipitates, such as metal (iron or manganese) oxides and hydroxides; and biological organisms, such as algae, cyanobacteria, zooplankton, and filamentous or macrobacterial growths.^{22,23} Due to the numerous types of source particles and their implications in the treatment process, raw water quality monitoring for turbidity should be done at least daily, and preferably more often.

Relationship between turbidity and other water quality parameters

Table 1 summarizes some of the relationships between the source of turbidity and water quality/treatment implications.

Microbiological characteristics

Relationship between turbidity and the presence of pathogenic/non-pathogenic organisms

The microbiological quality of drinking water can be significantly affected by turbidity. Microbial growth in water is most extensive on the surfaces of particles and inside loose flocs, both naturally occurring and those formed during treatment (see section "Treatment technology"). This growth occurs because nutrients adsorb to surfaces, allowing bacteria to grow more efficiently than when in free suspension.^{56,57} Similarly, river silt has been shown to readily adsorb viruses.⁵⁸

Studies of distribution systems have shown conflicting findings with respect to turbidity and microorganisms. Haas *et al.*⁵⁹ noted that increased values of pH, temperature and turbidity were associated with increased concentrations of microorganisms. HPC increases that parallel increases in turbidity have been found at turbidity levels lower than 2.0 NTU.⁶⁰ Similarly, work by Goshko *et al.*⁶¹ found positive correlations between HPCs and turbidities in the 0.83–8.89 NTU range. On the other hand, a study reported by Reilly and Kippin⁶² suggested that turbidity around 1.0 NTU does not affect the frequency with which either coliforms or HPC organisms occur in the analysis.

Table 1: Turbidity and implications for water quality and water treatment

Source of turbidity	Possible water quality/chemistry implications	Treatment implications
Inorganic particles (silt, clay, natural precipitants, e.g., CaCO ₃ , MnO ₂ , Fe ₂ O ₃ , etc.)	<ul style="list-style-type: none"> - raise/lower pH and alkalinity - source of micronutrients - affect zeta potential - source of metals and metal oxides - cloudy/turbid appearance - affect taste 	<ul style="list-style-type: none"> - major influence on coagulation, flocculation and sedimentation design - harbour/protect microorganisms
Organic particles (decomposed plant and animal debris, humic substances)	<ul style="list-style-type: none"> - source of energy and nutrients for microorganisms - cause colour - impart taste and odour - serve as precursors for the formation of chlorinated or ozonated compounds 	<ul style="list-style-type: none"> - high disinfectant demand - potential to form chlorinated organics - potential to form ozonation by-products - high coagulant dose - reduce clarifier overflow rates

Turbidity (10/03)

Source of turbidity	Possible water quality/chemistry implications	Treatment implications
	<ul style="list-style-type: none"> - possess ion exchange and complexing properties that include association with toxic elements and micropollutants - affect pH - affect zeta potential 	<ul style="list-style-type: none"> - increase flocculation/sedimentation times - harbour/protect microorganisms - reduce filter runs - can compete with pollutant compounds for adsorption sites in activated carbon adsorption - can precipitate in the distribution systems
Biological organisms (algae, cyanobacteria, zooplankton, filamentous or macrobacterial growth)	<ul style="list-style-type: none"> - impart taste and odour - potential source of toxin (microcystin-LR) - disease transmission - corrode tanks, pipes, etc. - stain fixtures - cause aesthetic problems due to sloughing of growths from tanks, filters, reservoirs and distribution system 	<ul style="list-style-type: none"> - plug filters - high disinfectant demand - need multiple barriers to ensure effective microbial inactivation - flotation may be more effective than sedimentation - microbial inactivation required

In water with turbidities ranging from 3.8 to 84.0 NTU, Sanderson and Kelly⁶³ found coliform organisms even after the water was treated with chlorine (free chlorine residuals between 0.1 and 0.5 mg/L after a minimum contact time of 30 minutes).

Huck *et al.*,⁶⁴ in their investigation of *Cryptosporidium* removal by granular media filtration, noted that an increase in turbidity associated with suboptimal coagulation and breakthrough at the end of filtration runs resulted in deterioration in oocyst reduction, even at turbidity levels less than 0.3 NTU. Utilities should therefore carefully consider the effects of reducing coagulant dosage. To avoid breakthrough, plants should specify a maximum head loss and filter run times and should consider using particle counters to monitor for early breakthrough.

Effect of turbidity on disinfection

Particulate matter (e.g., organic, inorganic, higher microorganisms) can protect bacteria and viruses from the effects of disinfection. LeChevallier *et al.*,⁶⁵ studying the efficiency of chlorination in killing coliforms in unfiltered surface water supplies, found a negative correlation with turbidity. A derived model predicted that an increase in turbidity from 1.0 to 10.0 NTU would result in an eight-fold decrease in the disinfection efficiency at a fixed chlorine dose. A study by Hoff,⁶⁶ which examined the efficiency of disinfection at turbidities of 1.0 and 5.0 NTU on poliovirus and sewage effluent coliforms, found that viruses and coliforms that adsorbed to organic matter were more resistant to disinfection than those that adsorbed to inorganic material such as clay and aluminum phosphate. For organic particulates, a reduction of turbidity from 5.0 to 1.0 NTU reduced the concentrations of disinfectant-resistant organisms approximately five-fold.

Hoff and Geldreich⁶⁷ reiterated that particulate characteristics have a significant impact on protection effects. Studies with ozone by Sproul *et al.*⁶⁸ confirmed that alum and bentonite afforded little protection to a variety of test organisms at 1.0 and 5.0 NTU, whereas faecal

material and, in particular, human epithelial carcinoma cells did provide protection. Chlorine dioxide studies by Scarpino *et al.*⁶⁹ suggested that temperature and turbidity affected the rate of inactivation of bentonite-adsorbed poliovirus. At 25°C, turbidities in excess of 2.29 NTU reduced inactivation rates.

Free-living nematodes are relatively common in North American municipal water supplies. Nematodes of the Rhabditae family are known to ingest pathogenic bacteria and viruses, and hence are able to protect these pathogens from chlorine disinfection.⁷⁰ Studies indicate that more nematodes are found in higher-turbidity raw and treated waters.^{71,72} In a study of the San Francisco water supply, coliform organisms were detected at chlorine levels of 0.35 mg/L or greater. Crustaceans apparently harboured the coliforms; on passing through a spigot, the crustaceans ruptured, and viable coliforms were released.⁷³ In laboratory tests, various clays and humic acid were shown to protect *Klebsiella aerogenes* from ultraviolet light disinfection.⁷⁴

Chlorine (as hypochlorous acid) reacts readily with organic matter containing unsaturated bonds, phenolic groups and nitrogen groups, giving rise to taste- and odour-producing compounds⁷⁵ and trihalomethanes.⁷⁶ Hence, waters with high turbidity from organic sources may give rise to a substantial chlorine demand. This could result in reductions in the free chlorine residual in distribution systems as protection against possible recontamination. For Ottawa River plants, Otson *et al.*⁷⁷ noted that increased pre-chlorination dosage requirements were strongly correlated with increases in turbidity. In Oregon surface waters, chlorine demand had a positive correlation with both turbidity and total organic carbon levels.⁶⁵ The resultant model suggested a 180% increase in chlorine demand for a turbidity increase from 1.0 to 5.0 NTU.

In the United States, well-operated slow sand filtration plants may be allowed to have higher turbidity in filter effluents if there is no interference with disinfection and the turbidity level never exceeds 5.0 NTU.⁷⁸ Non-interference with disinfection may be assumed if the finished water meets the coliform maximum contaminant level and if there are fewer than 10 heterotrophic plate count bacteria per mL during times of highest turbidity.⁷⁸

Effect of turbidity on microbial enumeration

The presence of turbidity may interfere with the quantification of bacteria and viruses. Bacteria are enumerated by counting the number of visible colonies that form on nutritive media when bacterial cells are incubated on the media for a fixed period of time. This process assumes that each colony represents one cell; however, a single colony could emanate from a particle containing many bacterial cells adsorbed on its surface. Fewer cells than were actually present would then be recorded. This phenomenon would also lead to an underestimation of bacterial numbers with the most probable number technique.

Geldreich *et al.*⁷⁹ noted that turbidity in a potable water sample may make membrane filtration impractical because of the volume of water the filter can pass, the character of the suspended material and the thickness of the deposit on the surface of the membrane. Although crystalline or siliceous materials may not be a problem, other substances may clog filter pores or cause a confluent growth to develop during incubation, hampering microbial enumeration. Coliform masking has been observed with membrane filters, with false-negative results occurring 17, 45 and more than 80% of the time for turbidities of less than or equal to 1.0, 5.0

and more than 10.0 NTU, respectively.^{65,80} Additional studies suggested that levels of turbidity *per se* (up to approximately 10.0 NTU) did not greatly affect coliform discovery, although associated non-coliform bacteria seriously inhibited detections.⁸¹

Viruses can also be adsorbed on or within particulate matter and may be very difficult to remove; 1% recovery is not unusual.⁸² A review of virus detection methods concluded that no simple and accurate system for enumerating viruses in highly turbid waters was available.⁸³

Relationship between Turbidity Removal and Microbial Quality of Treated Water

Historically, filtration has been shown to substantially block disease-causing organisms from entering into the drinking water supply.⁸¹ During coagulation, protozoa, bacteria and viruses, along with other sources of turbidity, become trapped in the floc and are removed by the filter.^{85,86} However, sometimes floc breaks through filter beds; such breakthroughs have been shown to be accompanied by an increase in virus penetration, even though the turbidity of the finished water remained below 0.5 NTU.⁸²

Studies have shown a correlation between decreased filtrate turbidity (down to 0.1 NTU) and reduced bacterial and algal counts.⁸⁴ Increases in the turbidity of filter effluent can signal the potential for increasing passage of unwanted organisms, even if the turbidity in the effluent is less than 1.0 NTU. For example, increasing concentrations of *Giardia* cysts can occur with turbidity increases of only 0.2–0.3 NTU.^{87,88}

The Pennsylvania Department of Environmental Protection, in its 1996 Regulatory Basics Initiative Program report,⁸⁹ gave its view of the relationship between turbidity and pathogen occurrence in finished filtered water. It stated that a relationship exists between turbidity spikes and *Giardia* breakthrough such that a stable filter with low turbidities that experiences a 0.1 NTU increase in turbidity can experience a 10- to 50-fold increase in cyst breakthrough from disturbance of the media.

In evaluating plant performance using endospores, researchers found that the log reduction of spores was similar in magnitude to the individual reduction of turbidity, total particles and particles in the *Cryptosporidium* oocyst size range. More important, spore removal closely paralleled particle and turbidity removal in response to coagulant dosage under all the water quality conditions examined.⁹⁰

In examining relationships between turbidity and parasites, it was found that for every log removal of turbidity, a 0.89-log removal was achieved for *Giardia* and *Cryptosporidium*.⁹¹ Conversely, increases in filtrate turbidity paralleled increases in the risk of *Cryptosporidium* breaking through the filter due to floc material breaking through that contained, or was associated with, oocysts. These increases occurred even with efficient chemical coagulation. It is therefore reasonable to assume that during the filter 'ripening' period at the beginning of a run, when turbidity is often greater than normal for the filter, the risk of *Cryptosporidium* breakthrough is higher.⁹²

Table 2 shows average potential removal credits estimated for *Giardia lamblia*, *Cryptosporidium* and viruses, when treated water meets the prescribed turbidity limits. The log reduction credits outlined in Table 2 are based on the mean or median removal established by the US EPA as part of the Long Term 2 Enhanced Surface Water Treatment Rule (LT2ESWTR).¹²⁶ Facilities that do not meet the requirements, or facilities that believe they can achieve a higher

log credit than is automatically given, can be granted a log reduction credit based on a demonstration of performance by the appropriate regulatory agency.

Table 2: *Giardia lamblia*, *Cryptosporidium* and virus potential reduction credits for various technologies.

Technology	Cyst/oocyst credit ^c	Virus credit
Conventional filtration ^a	3.0 log	2.0 log
Direct filtration ^a	2.5 log	1.0 log
Slow sand or diatomaceous earth filtration ^a	3.0 log	2.0 log
Micro- and ultrafiltration, nanofiltration and reverse osmosis ^b	Removal efficiency demonstrated through challenge testing and verified by direct integrity testing	No credit for micro- and ultrafiltration; for nanofiltration and reverse osmosis, removal efficiency demonstrated through challenge testing and verified by direct integrity testing

Notes:

^aConventional/direct/slow sand/diatomaceous earth filtration should be followed by free chlorination to obtain additional virus credit.

^bMicro- and ultrafiltration should be followed by free chlorination for the inactivation of viruses.

^cDepending on cyst/oocyst levels in source water, additional treatment is required using ultraviolet light, ozone, chlorine or chlorine dioxide (refer to protozoa/virological quality supporting documents for the level of inactivation required and the CT/IT tables for various disinfectants).

Chemical characteristics

Because of their adsorption capacity, suspended particulates have the ability to entrap undesirable organic and inorganic compounds; as such, an indirect relationship exists between turbidity and the chemical characteristics of these compounds in water. Most important in this respect is the organic or humic component of turbidity.

Humic substances are able to bind substantial amounts of metals and hydrous oxides together, forming complexes. An excellent review of metal–humate complexes, the mechanism of their formation and their properties is provided by Schnitzer and Kahn.⁹³ The ability of a number of natural waters in Ontario to complex copper has been demonstrated, with complexing capacities of up to 2.35 µmol Cu/L (0.149 mg/L) being reported.⁹⁴ A wide variety of heavy metal ions were found to be complexed in sediments of the Ottawa and Rideau rivers. A positive correlation between the unit surface area of the sediment and the concentration of adsorbed metal ions was observed.⁹⁵ In a study of mercury sorption and desorption characteristics of Ottawa River sediments, it was found that sorption rates were higher for organic-rich sands. Desorption of mercury was difficult, with less than 1% of the mercury being leached during a seven-hour contact period.⁹⁶ The strength of some metal–humate complexes may lead to negative errors in the analytical measurement of trace metals in natural water samples if turbidity exists.⁹⁷

One method that is used to remove undesirable metal ions during water treatment is adsorption with activated carbon. This process is aided by the presence of organic matter.⁹⁸ Organic molecules are also adsorbed by natural organic matter. DDT, for example, is solubilized in 0.5% sodium humate solution by a factor of at least 20 over its solubility in pure water.⁹⁹

Herbicides such as 2,4-D, paraquat and diquat can be adsorbed onto clay/humic acid particulates, the adsorption being greatly influenced by metal cations present in the humic material.¹⁰⁰ The presence of turbidity, therefore, might also interfere with the detection of biocides in water samples.

Chlorination of water containing organic matter such as humic acids can produce trihalomethanes, a group of chemical compounds that includes chloroform, bromodichloromethane, chlorodibromomethane and bromoform. The Canadian drinking water guideline for trihalomethanes is based on the known health effects associated with chloroform. Morris and Johnson¹⁰¹ observed a relationship between raw water turbidity and trihalomethane concentration in finished Iowa City water. In laboratory tests, Stevens and co-workers¹⁰² found that trihalomethane production was reduced if the water was filtered prior to chlorination. Harms and Looyenga¹⁰³ also reported that raw water turbidity was positively correlated with chloroform concentration in a South Dakota water supply. Strategies for addressing turbidity have implications related to controlling the potential formation of trihalomethanes, including the removal of organic matter, the use of alternative disinfectants, disinfectant application points and dosages, and the use of activated carbon.¹⁰⁴

For plants using aluminum salts as coagulants, highest particulate aluminum concentrations ($>200 \mu\text{g/L}$) were measured when the turbidity was greater than 0.5 NTU.¹⁰⁵ The results of the study suggest that filtered water turbidity should be less than 0.1 NTU to minimize particulate aluminum concentrations that contribute to residual aluminum.¹⁰⁵

At the asbestos levels commonly found in drinking water (of the order of 10^4 – 10^6 fibres/L),¹⁰⁶ very little, if any, correlation has been observed between turbidity and asbestos concentration.^{3,107,108} However, a general but non-linear relationship has been reported at high levels of asbestos (10^9 – 10^{11} fibres/L).¹⁰⁹ Further studies on treatment efficiencies for asbestos removal have resulted in a recommendation by Logsdon and co-workers^{110,111} that plants designed for asbestos removal should produce filtered waters with turbidities of 0.1 NTU or lower. McGuire *et al.*¹¹² suggested that this objective would help but not necessarily guarantee low asbestos counts ($<10^6$ fibres/L). Boatman¹¹³ reported that turbidity could impede asbestos analyses because of restricted filter volumes. Asbestos-cement pipes are used in some localities to transport drinking water, and it has been demonstrated that water with an aggressivity index of less than 10 can cause the release of asbestos fibres into the drinking water.¹¹⁴

Physical characteristics

A considerable body of evidence suggests that a large part of colour in water arises from colloidal particles. These tiny particles have physical and chemical properties that allow them to stay suspended in the water, rather than settling down or dissolving. Black and co-workers^{52,53} used electrophoretic studies to demonstrate the predominantly colloidal nature of colour in water; it has been claimed that about 50% of colour is due to a “colloidal fraction” of humic substances.⁵⁴ True colour is therefore defined as the colour of water from which turbidity has been removed.³

The relationship between high turbidity, in both raw and filtered water, and taste and odour has long been recognized.⁵⁵ Algal growths, actinomycetes and their debris also contribute

to taste and odour problems.²² At 5.0 NTU and above, there is an increasing visual detection, which many consumers find unacceptable.

Analytical methods

Turbidity is measured using the nephelometric method. Nephelometry determines turbidity using the intensity of scattered light. Table 3 lists four nephelometric methods that meet the criteria of the American Water Works Association/American Public Health Association (AWWA/APHA) or the U.S. Environmental Protection Agency (USEPA) and one International Organization for Standardization (ISO) criteria for determining turbidity in drinking water.

Table 3: Recognized Analytical Methods for Measuring Turbidity in Drinking Water^a

Method	Citation	Description
Nephelometric	AWWA/APHA 2130B ⁴	Tungsten lamp@2200-3000°K and one or more perpendicular detectors (&filters) with spectral response peak of 400-600nm. Light path ≤10 cm.
Nephelometric	USEPA 180.1 ⁶	Tungsten lamp@2200-3000°K and one or more perpendicular detectors (&filters) with spectral response peak of 400-600nm. Light path ≤10 cm.
Optical	ISO 7027 ⁸	Tungsten lamp (&filters),Diode or Laser as radiation source at 860 nm (or 550nm if sample is colourless) with a perpendicular detector and aperture angle 20-30°
Great Lakes Instruments	USEPA GLI 2 ⁷	Two perpendicular 860nm light sources alternately pulse each 0.5 seconds & two perpendicular detectors alternately measure “reference” and “active” signals.
Hach Filter Trak	USEPA 10133 ¹²⁵	Laser Diode @660 nm at 90° to detector/receiver (light path ≤10 cm) which may use Photo-Multiplier Tube and fibre-optic cable. Range is 0-1000 mNTU's.

Notes:

^a Additional methods may be approved before this guideline is revised/updated in the future.

Nephelometric turbidity instrumentation varies in design, range, accuracy and application. The design of nephelometric instruments should take into account the physics of scattered light. As noted in a previous section (Identity and Sources in the Environment), the size, shape and concentration of the particles affect the intensity pattern and distribution of the scattered light. Small particles less than one-tenth of the light wavelength will scatter light uniformly in both forward and backward directions. As the particle size approaches and exceeds the wavelength of the incident light, more light is transmitted in the forward direction. Because of this intensity pattern, the angle at which the light is measured is a critical factor; the current international standards have determined the most appropriate angle to be 90 degrees.⁸ As noted above in a previous section, as the concentration of particles increases, more particles reflect the incident light, which increases the intensity of the scattered light. As the concentration exceeds a

Turbidity (10/03)

certain point determined by the specific optical characteristics of the process, the particles themselves begin to block the transmission of the scattered light. The result is a decrease in the intensity of the scattered light. The intensity at which various wavelengths of light are reflected or absorbed is also determined by the colour of the liquid and the reflecting surface. Industry standards require nephelometers to operate in the visible or infrared ranges: 400–600 and 800–900 nm, respectively.⁹

All these factors, along with the optical geometry of a particular instrument, cause measured values between instruments to vary widely; thus, criteria for instrument design have been developed to minimize these variables. Manufacture of turbidimeters is guided by recommendations provided by the U.S. Environmental Protection Agency¹⁰ and the International Organization for Standardization (ISO 7027).⁸

Using special experimentation methods with a quartz iodine light source, the nephelometric response of exhaustively filtered de-ionized water has been shown to be 0.022–0.003 NTU.¹¹ Air bubbles and dirty sample tubes can cause false high readings for turbidity; very turbid samples or samples with colour due to dissolved substances will give low readings.^{4,12}

For a finished water turbidity goal of 0.1 NTU, rigorous standard operating procedures and a high level of quality control are required; a small numeric change may result in a large percent change.^{13,14} However, according to USEPA *Analytical Methods for Turbidity Measurement (180.1 and GLI 2)* and *Standard Methods for the Examination of Water and Wastewater (2130B)*, the sensitivity of nephelometers is such that turbidity differences of 0.02 NTU or less can be detected in waters having a turbidity of less than 1.0 NTU.^{4,6,7} All three methods cite “reporting to the nearest 0.05 NTU where the turbidity range is 0–1.0 NTU.” Thus, the practical lower limit of the standard nephelometric method can be considered to be 0.1 NTU.

Laser turbidimeters have recently entered the market. The manufacturers claim that these instruments are far more sensitive than the standard turbidimeters; purporting to accurately measure in the mNTU range. The USEPA has approved a laser turbidity method, “Method 10133, Determination of Turbidity by Laser Nephelometry.”¹²⁵ Currently they are not widely used in the industry.¹⁵

Turbidity, as defined by the above methods, is a non-scientific measure of particle concentration. Electronic particle counters are now available that are capable of accurately counting and recording the number of particles as a function of size (often in the 1–150 μm range). Although there is a general relationship between particle counts and turbidity (below 1.0 NTU), a firm correlation does not exist.^{16–18}

A simple conversion factor relating particle counting and turbidity measurements is not possible because the two techniques differ fundamentally in terms of discernment. Particle counting measures two characteristics of particulates: particle number and particle size. Samples with identical clarity can be distinguished on the basis of these two features; one sample may contain many small particles, whereas another may contain few large particles. Turbidity, on the other hand, cannot distinguish between two samples of identical clarity and different particulate composition.¹⁹

Particle counters are an excellent tool for optimizing treatment processes and for detecting the onset of filter breakthrough. Particle counters are restricted to performance verification only, and no limit is set as a maximum acceptable concentration for the number of particles in the treated water.

Treatment technology

Turbidity is reduced by removing particles from the water through filtration. Adequate filtration can be achieved by a variety of technologies: chemically-assisted filtration, slow sand filtration, diatomaceous earth filtration, membrane filtration or an alternative proven filtration technology.

Chemically-Assisted Filtration

The chemically-assisted filtration process generally includes chemical mixing, coagulation, flocculation, sedimentation (or dissolved air flotation) and rapid gravity filtration. Aluminum and ferric salts are used as primary coagulants. Cationic and anionic polymers are most commonly used as flocculation aids, and both, along with non-ionic polymers, have been used as filter aids. The coagulants and polymers are used to destabilize the generally negatively charged colloidal particles, which allows aggregation to occur via chemical and van der Waals interactions.^{24,25} The resulting (much larger) particles are filtered out when the water passes through sand beds or other single-, dual- or mixed-media granular filters. In systems where the combined water from all filters is monitored continuously, this treatment process is capable of producing water with a turbidity of less than 0.3 NTU; turbidities of less than 0.2 NTU have been demonstrated to be achievable on an ongoing basis. Filter loading rates generally range from 3.0 to 12.0 m/h.^{26,27}

Changes in alkalinity, colour, turbidity and orthophosphate concentrations affect coagulation reactions, and the properties and rate of settling of resulting floc particles. Temperature affects efficiency by influencing the rate of chemical reactions and the viscosity of water, thereby affecting the particle settling velocity and the filter backwash rate. The lower the temperature of the water, the more difficult it is to treat the water.

All filtration plants should provide for continuous monitoring of the effluent turbidity from each individual filter, as well as for continuous monitoring of the combined filtered water turbidity from all filters. Continuous monitoring is required because short-term turbidity spikes represent a process failure and potential health risk. Peak turbidity levels in the filtered water are a particular concern immediately after filter backwashing; therefore, all filters should be designed so that the filtered water immediately after filter backwashing is directed into a waste stream ('filter-to-waste' provision). When operating the filters, every effort should be made to minimize the magnitude and duration of turbidity spikes.²⁸

Discharge of filter backwash water into a raw water reservoir should not be permitted unless the filter backwash water receives off-line treatment, or is returned to a location upstream of the coagulant dosage point, so that all processes of a conventional or direct filtration plant are employed. The off-line treatment may be acceptable depending on the method used to treat the backwash water.

Turbidity (10/03)

Following filtration, turbidity in a waterworks may increase if any of the following occur:

- coagulants escape into the filtered water;
- dissolved metals oxidize;
- bacteria and other microflora grow;
- chemicals are added for stability or corrosion control;
- deposited materials (especially in low-flow parts of the system) are resuspended;
- or
- pipes corrode or lines break.^{29,30}

Uncovered distribution system reservoirs may also lead to increased turbidities, mainly by encouraging biological production.^{31,32}

In 1989, the American Water Works Association Research Foundation sponsored a study that identified design provisions and operational practices at high-rate filtration plants. For the study, researchers chose 21 plants that were successful in producing finished water with turbidity of less than 0.2 NTU.²⁷ In choosing the participating plants, consideration was given to geographic coverage as well as diversity of raw water types and treatment processes. In a different study, the Pennsylvania Department of Environmental Protection undertook performance evaluations of 150 surface water treatment plants that used filtration from 1988 to 1990 and found that a goal of 0.2 NTU was achievable for most plants.³³ An internal report, prepared in 1995 for the same department, also found that filtration plants can readily achieve finished water with turbidities of less than 0.5 NTU and that most plants can achieve less than 0.2 NTU.²⁶ In pilot tests involving treatment of Boston's low-turbidity surface water supply with dissolved air flotation, the turbidity goal of 0.1 NTU was met in more than 90% of the runs.³⁴ Operational studies at specific plants have indicated that low turbidities in plant effluent are readily achievable when competent operations are in place.^{35,36} In another study, it was demonstrated that well-operated conventional treatment plants or direct filtration plants that produce water with low turbidity (less than 0.5 NTU) can achieve up to a 3-log reduction of *Giardia* cysts and up to a 2-log reduction of viruses.³⁷ The same study demonstrated that source waters with low raw water turbidity require filter effluent turbidities to be substantially lower than 0.5 NTU in order to effectively remove *Giardia* cysts and viruses.

The U.S. Environmental Protection Agency's 1997 Notice of Data Availability for Interim Enhanced Surface Water Treatment Rule shows that systems serving greater than 10 000 people are able to meet low turbidity limits. The same study indicated that chemically-assisted filtration is able to achieve a 2-log reduction of *Cryptosporidium* through filtration.^{38,39} The US EPA has now concluded that conventional treatment plants in compliance with the IESWTR or LTIESWTR achieve an average of 3-log reduction of *Cryptosporidium*. Direct filtration plants achieve an average of 2.5-log reduction of *Cryptosporidium*.¹²⁶

Slow sand filtration

In slow sand filtration, filter effectiveness depends on the formation of *schmutzdecke*, which is a layer of bacteria, algae and other microorganisms on the surface of the sand, and the

formation of a biopopulation within the sand bed. Raw water passes through the sand bed where physical, chemical and biological mechanisms remove contaminants. The most important removal mechanism has been attributed to the biological process. No chemicals are added, nor is there a need to backwash.

Researchers have observed variation in the ability of slow sand filters to reduce turbidity. Fox *et al.*⁴⁰ found that when water was filtered at 0.12 m/h, after an initial ripening period had allowed the biopopulation to become established on new sand, the treated water turbidity was consistently less than 1.0 NTU. Raw water turbidity ranged from 0.2 to 10.0 NTU. Cleasby *et al.*⁴¹ reported that typical effluent turbidity was 0.1 NTU for raw water with turbidity ranging from lower than 1.0 to 30.0 NTU, except during the first two days after scraping of the schmutzdecke. Pyper⁴² observed slow sand filtered water with turbidity of 0.1 NTU or lower 50% of the time and 1.0 NTU or lower 99% of the time; raw water turbidity in this study ranged from 0.4 to 4.6 NTU. Slezak and Sims⁴³ reported that nearly half of the 27 slow sand filtration plants they surveyed produced filtered water turbidity of 0.4 NTU or lower; at the same time, 15% of the plants produced water with an average turbidity of 1.0 NTU or higher. Consistent 3-log reductions of particles sized from 2 to 4 μm upwards were also observed in this study. The size range of 7–12 μm is considered to be representative of the size of *Giardia* cysts. Bellamy *et al.*⁴⁴ studied the water treatment efficiency of slow sand filtration to ascertain removal of *Giardia* cysts, total coliform bacteria, heterotrophic plate count (HPC, formerly known as standard plate count) bacteria, particles and turbidity. Results showed that slow sand filtration is an effective water treatment technology. Using a biologically mature filter, *Giardia* cyst removal was virtually 100%; total and faecal coliform removal was approximately 99%; particle removal averaged 98%; HPC bacteria removal ranged from negative to 99%, depending on the influent concentration; and turbidity removal ranged from 0 to 40%.³⁹ The US EPA has now concluded that slow sand filtration plants in compliance with the IESWTR or LTIESWTR achieve an average of 3-log reduction of *Cryptosporidium*.¹²⁶

Slow sand filtration is appropriate for use when raw water turbidities are relatively low (e.g., <10.0 NTU).

As is the case with chemically-assisted filtration, a 'filter-to-waste' feature should be provided so that the filtered water immediately after filter cleaning is directed into a waste stream.

Diatomaceous earth filtration

Diatomaceous earth filters operate by passing water through a thin layer of diatomaceous earth about 3 mm thick supported on a septum or filter element. To prevent turbid water from clogging the filter, a small amount of diatomaceous earth is continually added as body feed to maintain a permeable filter cake. Once the headloss across the filter cake becomes too great or the filter cake begins to slough, the filter is removed from service and the filter cake is washed and reused. New precoat is applied, and the cycle starts again.

Diatomaceous earth filtration has been shown to attain excellent removal of *Giardia* cysts over a broad range of operating conditions. Cyst removals exceeding 99%, and often 99.9%, were reported by Lange *et al.*⁴⁵ for filtration rates of 2.4–9.6 m/h and for temperatures

from 3.5 to 15°C. Logsdon *et al.*⁴⁶ reported that when sufficient diatomaceous earth and body feed were used, removal of 9- μm radioactive beads was nearly always 99.9% or higher. The same study reported that 11 filter runs were made with *Giardia muris* cysts at filtration rates of 2.2–3.5 m/h. Cyst removal exceeded 99% in all runs and exceeded 99.9% in five of the runs. The US EPA has now concluded that diatomaceous earth filtration plants in compliance with the IESWTR or LT1ESWTR achieve an average of 3-log reduction of *Cryptosporidium*.¹²⁶

Diatomaceous earth filtration is appropriate and effective in treating waters with low turbidity. Logsdon *et al.*⁴⁶ reported that turbidity reductions of 56–78% were attained with diatomaceous earth when raw water turbidity ranged from 0.95 to 2.5 NTU. Pyper⁴² reported an average turbidity reduction of 75% with an effluent quality of 0.5 NTU.

As is the case with chemically-assisted filtration, a ‘filter-to-waste’ feature should be provided so that the filtered water immediately after filter backwashing is directed into a waste stream.

Membrane filtration

Four membrane treatment processes are currently used in the water industry, and all involve pressure-driven semi-permeable membranes. The most appropriate type of membrane depends on a number of factors, including targeted materials to be removed, source water quality characteristics, treated water quality requirements, membrane pore size, molecular weight cut-off, membrane materials and system/treatment configuration.⁴⁷ The four processes are:

1. **Reverse osmosis:** a high-pressure membrane treatment process originally developed to remove salts from brackish water.
2. **Nanofiltration:** a low-pressure reverse osmosis process for the removal of larger cations (e.g., calcium and magnesium ions) and/or organic molecules.
3. **Ultrafiltration:** a lower-pressure membrane process characterized by a wide band of molecular weight cut-off and pore sizes for the removal of dissolved organics and particulates.
4. **Microfiltration:** a low operating pressure membrane process used to remove particulates, including pathogenic cysts.^{47,48}

Reverse osmosis and nanofiltration are very effective for absolute removal of cysts, bacteria and viruses.⁴⁸ Ultrafiltration (pore size 0.01 μm) and microfiltration (pore size 0.1 μm) are effective for absolute removal of *Giardia* cysts and partial removal of bacteria and viruses.⁴⁹ Filtrate turbidity can be achieved consistently at or below 0.1 NTU.^{50,51}

Prefiltration and/or the addition of a scale-inhibiting chemical may be required to protect membranes from plugging effects, fouling and/or scaling.

If membrane filtration is the sole treatment technology in use then a form of virus inactivation should be incorporated into the treatment train after the filtering process.

‘Filter-to-waste’ feature should be provided for initial start-up and commissioning of the membrane system and for emergency diversion in the event of a membrane integrity breach.

Health considerations

Microbial

The most important health-related effect of turbidity is probably its ability to protect microorganisms from disinfection. Turbidity, which has been shown to be correlated with the contamination of water supplies by *Giardia* and *Cryptosporidium*,¹¹⁹ serves as a surrogate measure for indicating the risk of contamination by these pathogens. A dramatic increase in turbidity levels at one of the Milwaukee water treatment plants (levels many times higher than those of the preceding 14 months) was associated with the outbreak of cryptosporidiosis in April 1993, when more than 400 000 people developed symptomatic gastrointestinal infections as a consequence of exposure to contaminated drinking water.¹²⁰ An outbreak of giardiasis in Rome, New York, where an unfiltered but chlorinated water supply was used, has been cited as illustrating the problem of particulates possibly protecting pathogens and interfering with marginal disinfection.¹⁰⁸ In another incident, high turbidities (>4.0 NTU), resulting from poor plant operation coupled with a malfunctioning chlorinator, were considered as causal factors in an outbreak of giardiasis.⁸⁴

In most water treatment plants, *Giardia* removal is a physical process involving coagulation, flocculation and filtration; chlorine contact times alone are insufficient to result in complete destruction or removal.¹²¹ Monitoring turbidity can therefore be a useful indicator of plant performance, including cyst removal. Studies have shown that small increases in turbidity (about 0.2 NTU) can result in significant passage of *Giardia* cysts.⁸⁷ It has been suggested that 0.1 NTU should be set as a goal or objective for treated water.^{84,87,121,122} Giardiasis problems have, however, occurred where turbidity limits have been met, and it should not be assumed that achieving a turbidity limit will by itself prevent waterborne disease.^{88,123}

A study in Philadelphia by Schwartz *et al.*,⁵¹ which asserted a correlation between levels of turbidity and hospital admissions of elderly residents with gastrointestinal illnesses, highlights the fact that meeting the turbidity limits does not necessarily mean that disease can be prevented. The authors found that an increase in the weighted average turbidity of approximately 25% (0.035 NTU) was associated with a 9% increase in hospital admissions of elderly residents with gastrointestinal illness 9–11 days after exposure, even though the recorded average turbidities were well below the regulated limits. A similar study by Aramini *et al.*¹²⁴ has demonstrated a relationship between reported gastrointestinal illness and turbidities in excess of 1.0 NTU, the previous Canadian health-based drinking water guideline. Using a generalized additive model, the authors demonstrated that excess turbidities during the period 1992–1998 could explain 2.1%, 0.8% and 0.9% of emergency-associated, gastroenteritis-related physician visits by persons residing within the three water distribution areas, respectively. In addition, 1.3%, 0.2% and 0.3% of gastroenteritis-related hospitalizations of persons residing in the same three areas were explained by variations in turbidity. It is evident from these studies that change in turbidity levels in drinking water is a potential indicator for breakthrough of pathogenic organisms and increased consumer risk.


Turbidity (10/03)

Hudson,¹¹⁵ using 1953 data on infectious hepatitis and raw water turbidity for 12 U.S. cities, observed that infectious hepatitis incidence was greater with higher turbidity. A similar relationship appeared to exist between turbidity and cases of poliomyelitis, although this finding was based on a smaller sample.¹¹⁵ Shaffer *et al.*¹¹⁶ reported detection of poliovirus in waters with chlorine concentrations greater than 1 mg/L and turbidities less than 1.0 NTU, which indicates that protection from disinfection occurs even at very low turbidity levels. Although a study of 16 U.S. cities in 1961 failed to reveal a clearly defined relationship between hepatitis incidence and finished water turbidity, the authors stated that, because of the many factors involved, it should not be inferred that there is none.¹¹⁷ The infectious hepatitis epidemic in Delhi, India, occasioned by the massive contamination of the raw water source of a treatment plant by sewage, was also accompanied by a significant increase in raw water turbidity. Even though chlorination was practised, it was apparently insufficient to inactivate the infectious hepatitis virus.¹¹⁸ The protection from disinfection offered by organic or cellular material in particular has been reported in other studies.^{66,68}

Chemical

Particulate matter in water is not usually a potential chemical hazard in itself, but may have indirect effects.²⁰ The concentrations of both heavy metal ions and biocides are usually much higher in suspended solids than in water. The possibility therefore exists that when such contaminated particles enter a different environment, such as the stomach, release of the pollutants could occur, with potentially deleterious effects.

The metal-ligand binding in humate complexes can be represented by the equation:⁹³



where:

- M^{n+} = the metal ion
- $H_m A$ = humic acid
- $M_m A_n$ = the metal complex.

If, for instance, the hydrogen ion concentration is increased by stomach acid, the equilibrium will be displaced in favour of the free ion and the undissociated humic acid.

Similarly, the absorption of some herbicides, in particular s-triazine compounds, by soil organic matter, has been demonstrated to be pH dependent. Maximum absorption occurs at pH levels in the vicinity of the respective pK values of the herbicides (i.e., pH levels of about 4–6). Lowering or raising the pH decreases absorption and hence may lead to the release of free herbicides.⁹³

Other considerations

Excessive turbidity has often been associated with unacceptable tastes and odours. Turbidity in excess of 5.0 NTU also becomes visually apparent and may be objected to by consumers. In some cases, if the level of turbidity is not lowered to reduce the organic loading in advance of applying certain chemicals, it may lead to other health concerns (e.g., the formation of trihalomethanes).

As noted above, turbidity measurement does not indicate the type, number or mass of particles. However, because of the ease of analysis and relative inexpensiveness of the equipment, it is a very useful tool to assess the performance of water treatment processes — especially for conventional surface water systems. Moreover, turbidity can serve to signal potential contamination problems or difficulties within a distribution system. Drinking water should be aesthetically pleasing. Every effort should be made to keep the turbidity as low as possible by flushing and cleaning the pipelines. For aesthetic purposes, turbidity should not exceed 5.0 NTU within the distribution system, especially at the point of consumption.

Rationale

Turbidity is a characteristic of all water supplies. In surface waters and groundwaters under the influence of surface water, turbidity is a concern for both health and aesthetic reasons. In these waters, the particulate matter that creates turbidity can contain toxins, harbour microorganisms and interfere with disinfection. In addition, organic matter in the water can react with disinfectants such as chlorine to create by-products. These by-products may cause adverse health effects.

While turbidity may be measured in secure groundwater supplies (i.e., not under the direct influence of surface water), it is not a concern in treated water from these sources provided it does not hinder disinfection. It is good practice to ensure water entering the distribution system from a secure groundwater supply has a low turbidity level around 1.0 NTU.

Turbidity is effectively reduced through filtration, using one of a number of common technologies. The most important consideration when dealing with turbidity is to reduce its level as low as possible and minimize fluctuation. For this reason, while the target is to reduce turbidity levels to below 0.1 NTU at all times, it is considered acceptable for treatment plants to achieve the following levels based on the type of technology used. The levels of turbidity in treated water should be:

1. For chemically-assisted filtration, less than or equal to 0.3 NTU in at least 95% of the measurements made, or at least 95% of the time each calendar month and not exceed 1.0 NTU at any time.
2. For slow sand or diatomaceous earth filtration, less than or equal to 1.0 NTU in at least 95% of the measurements made, or at least 95% of the time each calendar month and not exceed 3.0 NTU at any time.
3. For membrane filtration, less than or equal to 0.1 NTU in at least 99% of the measurements made, or at least 99% of the time each calendar month and not exceed 0.3 NTU at any time. If membrane filtration is the sole treatment technology employed, some form of virus inactivation should follow the filter process.

Most problems associated with turbidity are caused when the level of turbidity in the treated water spikes. Spikes can occur when the natural levels of particulate matter increase in the source water, when the filtration rate increases or when an individual filter breaks down. In order to quickly figure out that a filter is malfunctioning and to identify which one it is, this guideline applies to individual filters within a system.

Turbidity (10/03)

Turbidity measured to be less than 5.0 NTU is not discernable to the naked eye but at higher levels the particulate matter in water may cause colour, taste and odour concerns for consumers. For this reason, utilities should try to maintain the level of turbidity in the distribution system to below 5.0 NTU. An aesthetic objective has not been set in order to avoid confusion with the health-related guideline.

References

1. U.S. Environmental Protection Agency. National Primary Drinking Water Regulations: Final Rule. Fed. Regist., 54(124): 27485–27541 (1989).
2. Eckert, C. Personal communication. Alberta Environment (2003).
3. Sadar, M.J. Understanding turbidity science. Technical Information Series, Booklet II. Hach Co., Loveland, CO (1996).
4. American Public Health Association/American Water Works Association/Water Environment Federation. Standard methods for the examination of water and wastewater. 20th edition. American Public Health Association, Washington, DC (1995).
5. Hach, C.C., Vanous, R.D. and Heer, J.M. Understanding turbidity measurement. 1st edition. Technical Information Series, Booklet II. Hach Co., Loveland, CO (1982).
6. U.S. Environmental Protection Agency. Method 180.1. EPA/600/R-93/100. Cincinnati, OH (1993).
7. GLI International Inc. GLI Method 2. Milwaukee, WI (no date).
8. International Organization for Standardization. International Standard 7027. Geneva (1999).
9. Murren, C. Clear thinking on turbidity. Meas. Control, 26: 83–85 (1993).
10. U.S. Environmental Protection Agency. U.S. Code of Federal Regulations, Title 40, Protection of the Environment, Part 141, Section 74 (a)(1) (1989).
11. Eichner, D.W. and Hach, C.C. How clear is clear water. Water Sewage Works, 118: 299 (1971).
12. Traversy, W.J. Turbidity. In: Methods for chemical analysis for waters and wastewaters. Water Quality Division, Inland Waters Branch, Department of Fisheries and Forestry, Ottawa. p. 167 (1971).
13. Burlingame, G.A., Pickel, M.J. and Roman, J.T. Practical applications of turbidity monitoring. J. Am. Water Works Assoc., 90(8): 57–69 (1998).
14. Milstead, J.R., Motley, E.M. and Chiang, V.P. Expectations vs. reality. Proceedings of the American Water Works Association Water Quality Technology Conference, New Orleans, LA (1995).
15. Voss, K. Personal communication. City of Calgary (2003).
16. Beard, J.D. and Tanaka, T.S. A comparison of particle counting and nephelometry. J. Am. Water Works Assoc., 59: 533 (1977).

17. Gammie, L. Particle counting and turbidity in water treatment. In: Proceedings of the 36th Annual Convention, Western Canada Water and Sewage Conference, September (1984).
18. McTigue, N., LeChevallier, M., Arora, H. and Clancy, J. National assessment of particle removal by filtration. American Water Works Association Research Foundation, Denver, CO (1998).
19. Hargesheimer, E.E., Lewis, C.M. and Yentsch, C.M. Evaluation of particle counting as a measure of treatment plant performance. American Water Works Association Research Foundation, Denver, CO (1992).
20. National Academy of Sciences. Drinking water and health: Chap. IV. U.S. National Research Council, Washington, DC (1977).
21. Narkis, N. and Rebhun, M. The mechanism of flocculation processes in the presence of humic substances. *J. Am. Water Works Assoc.*, 67: 101 (1975).
22. Mackenthun, K.M. and Kemp, L.E. Biological problems encountered in water supplies. *J. Am. Water Works Assoc.*, 62: 520 (1970).
23. Kay, G.P., Sykora, J.L. and Burgess, R.A. Algal concentration as a quality parameter of finished drinking waters in and around Pittsburgh, Pa. *J. Am. Water Works Assoc.*, 72: 162 (1980).
24. Stumm, W. and O'Melia, C.R. Stoichiometry of coagulation. *J. Am. Water Works Assoc.*, 60: 514 (1968).
25. Stumm, W. and Morgan, J.J. Chemical aspects of coagulation. *J. Am. Water Works Assoc.*, 54: 971 (1962).
26. Consonery, P.J. Summaries of yearly performance of Pennsylvania's surface water treatment plants. Internal report for the Pennsylvania Department of Environmental Protection, Harrisburg, PA (1995).
27. Cleasby, J.L., Dharmarajah, A.H., Sindt, G.L. and Baumann, E.R. Design and operation guidelines for optimization of the high-rate filtration process: plant survey results. American Water Works Association Research Foundation, Denver, CO (1989).
28. U.S. Environmental Protection Agency. Interim Enhanced Surface Water Treatment Rule. U.S. Code of Federal Regulations Parts 9, 141, and 142 (1998).
29. Stinson, K.B. Treated water forever pure? *Water Eng. Manage.*, 129: 34 (1982).
30. Johnson, M.L. and Doe, P.W. Designing and constructing the Trap Falls water treatment plant. *J. Am. Water Works Assoc.*, 75: 124 (1983).
31. Committee Report. Deterioration of water quality in large distribution reservoirs (open reservoirs). *J. Am. Water Works Assoc.*, 75: 313 (1983).
32. Silverman, G.S., Nagy, L.A. and Olson, B.H. Variations in particulate matter, algae and bacteria in an uncovered, finished drinking water reservoir. *J. Am. Water Works Assoc.*, 75: 191 (1983).
33. Consonery, P.J. and Greenfield, D.N. Filter plant performance evaluation: a summary of procedures and results. Internal report for the Bureau of Water Supply and Community Health, Pennsylvania Department of Environmental Protection, Harrisburg, PA (1991).

Turbidity (10/03)

34. Johnson, B.A., Gong, B., Bellamy, W. and Fran, T. Pilot plant testing of dissolved air flotation for treating Boston's low turbidity water supply. *Water Sci. Technol.*, 31(3-4): 83-92 (1995).
35. Atherton, T. and Goss, J. Low turbidity water from fast processes. *Water Eng. Manage.*, 128: 40 (1981).
36. Morand, J.M. and Young, M.J. Performance of packaged water treatment plants for small communities. In: *Proceedings of the American Water Works Association Seminar on Innovative Filtration Techniques, Las Vegas, NV*. p. 129 (1983).
37. Logsdon, G.S. Comparison of some filtration processes appropriate for *Giardia* cyst removal. Presented at Calgary *Giardia* Conference, Calgary, Alberta, 23-25 February. Drinking Water Research Division, U.S. Environmental Protection Agency (1987).
38. U.S. Environmental Protection Agency. National Primary Drinking Water Regulations: Interim Enhanced Surface Water Treatment Rule Notice of Data Availability; Proposed Rule. *Fed. Regist.*, 62(212): 59500-59501 (1997).
39. U.S. Environmental Protection Agency. National Primary Drinking Water Regulations: Long Term 1 Enhanced Surface Water Treatment and Filter Backwash Rule; Proposed Rule. *Fed. Regist.*, 65(69): 19063-19068 (2000).
40. Fox, K.R., Miltner, R.J., Logsdon, G.S., Dicks, D.L. and Drolet, L.F. Pilot plant studies of slow-rate filtration. *J. Am. Water Works Assoc.*, 76(12): 62-68 (1984).
41. Cleasby, J.L., Hilmoe, D.J. and Dimitracopoulos, C.J. Slow sand and direct in-line filtration of a surface water. *J. Am. Water Works Assoc.*, 76(12): 44-45 (1984).
42. Pyper, G.R. Slow sand filter and package treatment plant evaluation: Operating costs and removal of bacteria, *Giardia* and trihalomethanes. EPA/600/2-85/052. U.S. Environmental Protection Agency, Cincinnati, OH (1985).
43. Slezak, L.A. and Sims, R.C. The application and effectiveness of slow sand filtration in the United States. *J. Am. Water Works Assoc.*, 76(12): 38-43 (1984).
44. Bellamy, W.D., Silverman, G.P. and Hendricks, G.W. Filtration of *Giardia* cysts and other substances. Vol. 2. Slow sand filtration. EPA 600/2-85/026. U.S. Environmental Protection Agency, Cincinnati, OH (1985).
45. Lange, K.P., Bellamy, W.D., Hendricks, D.W. and Logsdon, G.S. Diatomaceous earth filtration of *Giardia* cysts and other substances. *J. Am. Water Works Assoc.*, 78(1): 76-84.
46. Logsdon, G.S., Symons, J.M., Hoye, R.L., Jr., and Arozarena, M.M. Alternative filtration wetlands for removal of *Giardia* cysts and cyst models. *J. Am. Water Works Assoc.*, 73(2): 111-118.
47. Jacangelo, J.G. The development of membrane technology. International Report (IR3). *Water Supply: Rev. J. Int. Water Supply Assoc.*, 9(3/4) (1991).
48. Taylor, J.S., Duranceau, S.J., Barrett, W.M. and Goigel, J.F. Assessment of potable water membrane applications and research needs. Prepared for the American Water Works Association Research Foundation, Denver, CO (1990).
49. Jacangelo, J.G., Laine, J.M., Carns, K.E., Cummins, E.W. and Mallevalle, J. Low pressure membrane filtration for removing *Giardia* and microbial indicators. *J. Am. Water Works Assoc.*, 83(9): 97-106 (1991).

50. Clark, M.M. Ultrafiltration of lake water: Optimization of TOC removal and flux: influence and removal of organics in drinking water. Lewis Publishers, Boca Raton, FL (1992).
51. Schwartz, J., Levin, R. and Goldstein, R. Drinking water turbidity and gastrointestinal illness in the elderly of Philadelphia. *J. Epidemiol. Community Health*, 54(1): 45-51 (2000).
52. Black, A.P. and Willems, D.G. Electrophoretic studies of coagulation for removal of organic colour. *J. Am. Water Works Assoc.*, 53: 589 (1961).
53. Black, A.P. and Christman, R.F. Characteristics of coloured surface waters. *J. Am. Water Works Assoc.*, 55: 753 (1963).
54. Pennanen, V. Humus fractions and their distribution in some lakes in Finland. In: Humic substances, their structure and function in the biosphere. D. Povoledo and H.L. Golterman (eds.). Pudoc, Wageningen, The Netherlands. p. 207 (1975).
55. Atkins, P.F. and Tomlinson, H.D. Evaluation of daily carbon chloroform extracts with CAM. *Water Sewage Works*, 110: 281 (1963).
56. Brock, T.D. Principles of microbial ecology. Prentice-Hall, Englewood Cliffs, NJ. p. 72 (1966).
57. Stotzky, G. Influence of clay minerals on microorganisms. III. Effect of particle size, cation exchange capacity, and surface area on bacteria. *Can. J. Microbiol.*, 12: 1235 (1966).
58. Berg, G. Removal of viruses from sewage, effluents, and waters. 2. Present and future trends. *Bull. W.H.O.*, 49: 461 (1973).
59. Haas, C.N., Meyer, M.A. and Paller, M.S. Microbial alterations in water distribution systems and their relationship to physical-chemical characteristics. *J. Am. Water Works Assoc.*, 75: 475 (1983).
60. Snead, M.C., Olivieri, V.P., Kruse, C.W. and Kawata, K. Benefits of maintaining a chlorine residual in water supply systems. EPA-600/2-80-010. U.S. Environmental Protection Agency, Washington, DC, June (1980).
61. Goshko, M.S., Minnigh, H.A., Pipes, W.O. and Christian, R.R. Relationships between standard plate counts and other parameters in water distribution systems. *J. Am. Water Works Assoc.*, 75: 568 (1983).
62. Reilly, J.K. and Kippin, J.S. Relationship of bacterial counts with turbidity and free chlorine in two distribution systems. *J. Am. Water Works Assoc.*, 75: 309 (1983).
63. Sanderson, W.W. and Kelly, S. Comments following a paper by N.A. Clarke *et al.*, reference 85.
64. Huck, P.M., Coffey, B.M., Emelko, M.B., Maurizo, D.D., Slawson, R.M., Anderson, W.B., Van Den Oever, J., Douglas, I.P. and O'Melia, C.R. Effects of filter operation on *Cryptosporidium* removal. *J. Am. Water Works Assoc.*, 94(6): 97-111 (2002).
65. LeChevallier, M.W., Evans, T.M. and Seidler, R.J. Effect of turbidity on chlorination efficiency and bacterial persistence in drinking water. *Appl. Environ. Microbiol.*, 42: 159 (1981).
66. Hoff, J.C. The relationship of turbidity to disinfection of potable water. Evaluation of the microbiology standards for drinking water. EPA-570/9-78-OOC. U.S. Environmental Protection Agency, Washington, DC. p. 103 (1978).

Turbidity (10/03)

67. Hoff, J.C. and Geldreich, E.E. Comparison of the biocidal efficiency of alternative disinfectants. *J. Am. Water Works Assoc.*, 73: 40 (1981).
68. Sproul, O.J., Buck, C.E., Emerson, M.A., Boyce, D., Walsh, D. and Howser, D. Effects of particulates on ozone disinfection of bacteria and viruses in water. EPA-600/2-79-089. U.S. Environmental Protection Agency, Washington, DC, August (1979).
69. Scarpino, P.V., Brigano, F.A.O., Cronier, S. and Zink, M.L. Effect of particulates on disinfection of enteroviruses in water by chlorine dioxide. EPA-600/2-79-054. U.S. Environmental Protection Agency, Washington, DC, July (1979).
70. Chang, S.L., Woodward, R.L. and Kabler, P.W. Survey of free-living nematodes and amebas in municipal supplies. *J. Am. Water Works Assoc.*, 52: 613 (1960).
71. Mott, J.B., Mulamootil, G. and Harrison, A.D. A 13-month survey of nematodes at three water treatment plants in southern Ontario, Canada. *Water Res.*, 15: 729 (1981).
72. Tombes, A.S., Abernathy, A.R., Welch, D.M. and Lewis, S.A. The relationship between rainfall and nematode density in drinking water. *Water Res.*, 13: 619 (1979).
73. Tracy, H.W., Camarena, V.M. and Wing, F. Coliform persistence in highly chlorinated waters. *J. Am. Water Works Assoc.*, 58: 1151 (1966).
74. Bitton, G., Henis, Y. and Lahav, N. Effect of several clay minerals and humic acid on the survival of *Klebsiella aerogenes* exposed to ultraviolet irradiation. *Appl. Microbiol.*, 23: 870 (1972).
75. Sawyer, C.N. and McCarty, P.L. Residual chlorine and chlorine demand. In: *Chemistry for sanitary engineers*. 2nd edition. Chap. 21. McGraw-Hill, Toronto (1967).
76. Rook, J.J. Chlorination reactions of fulvic acids in natural waters. *Environ. Sci. Technol.*, 11: 478 (1977).
77. Otson, R., Williams, D.T. and Bothwell, P.D. Comparison of trihalomethane levels and other water quality parameters for three treatment plants on the Ottawa River. *Environ. Sci. Technol.*, 15: 1075 (1981).
78. U.S. Environmental Protection Agency. Guidance manual for compliance with filtration and disinfection requirements for public water systems using surface water sources. Section 5.3.2. Washington, DC.
79. Geldreich, E.E., Allen, M.J. and Taylor, R.H. Interferences to coliform detection in potable water supplies. In: *Evaluation of the microbiology standards for drinking water*. EPA-570/9-78-OOC. U.S. Environmental Protection Agency, Washington, DC. p. 13 (1978).
80. Seidler, R.J. and Evans, T.M. Project summary: Persistence and detection of coliforms in turbid finished drinking water. EPA-600/S2-82-054. U.S. Environmental Protection Agency, Washington, DC, August (1982).
81. Herson, D.S. and Victoreen, H.T. Hindrance of coliform recovery by turbidity and non-coliforms. EPA-600/2-80-097. U.S. Environmental Protection Agency, Washington, DC, August (1980).
82. Robeck, G.G., Clarke, N.A. and Dostal, K.A. Effectiveness of water treatment processes in virus removal. *J. Am. Water Works Assoc.*, 54: 1275 (1962).
83. Fenters, J.D. and Reed, J.M. Viruses in water supply. *J. Am. Water Works Assoc.*, 69: 328 (1977).

84. Logsdon, G.S. and Lippy, E.C. The role of filtration in preventing waterborne disease. *J. Am. Water Works Assoc.*, 74: 649 (1982).
85. Clarke, N.A., Berg, G., Kabler, P.W. and Chang, S.L. Human enteric viruses in water: source, survival and removability. *Adv. Water Pollut. Res.*, 2: 523 (1964).
86. Foliguet, J.M. and Doncoeur, F. Élimination des enterovirus au cours du traitement des eaux d'alimentation par coagulation/floculation/filtration. *Water Res.*, 9: 953 (1975).
87. Logsdon, G.S., Thurman, V.C., Frinot, E.S. and Stoecker, J.G. Evaluating sedimentation and various filter media for removal of *Giardia* cysts. *J. Am. Water Works Assoc.*, 77: 61 (1985).
88. Cleasby, J.L. Slow sand filtration and direct in-line filtration of a surface water. In: Proceedings of the American Water Works Association Seminar on Innovative Filtration Techniques, Las Vegas, NV. p. 1 (1983).
89. Pennsylvania Department of Environmental Protection. Regulatory Basics Initiative Program report. Office of Policy and Communication, Harrisburg, PA (1996).
90. Rice, E.W., Fox, K.R., Miltner, R.J., Lytle, D.A. and Johnson, C.H. Evaluating plant performance with endospores. *J. Am. Water Works Assoc.*, 88(9): 122-130 (1996).
91. LeChevallier, M.W. and Norton, W.D. Examining relationships between particle counts, and *Giardia* and *Cryptosporidium* and turbidity. *J. Am. Water Works Assoc.*, 84(12): 54-60 (1992).
92. Hall, T., Pressdee, J., Gregory, R. and Murray, K. *Cryptosporidium* removal during water treatment using dissolved air flotation. *Water Sci. Technol.*, 31(3-4): 125-135 (1995).
93. Schnitzer, M. and Kahn, S.U. Humic substances in the environment. Marcel Dekker, New York, NY (1972).
94. Chau, Y.K. and Lum-She-Chan, K. Measurement of complexing capacity of lake waters. In: Humic substances, their structure and function in the biosphere. D. Povoledo and H.L. Golterman (eds.). Pudoc, Wageningen, The Netherlands. p. 11 (1975).
95. Oliver, B.G. Heavy metal levels of Ottawa and Rideau river sediments. *Environ. Sci. Technol.*, 7: 135 (1973).
96. Ramamoorthy, S. and Rust, R.R. Mercury sorption and desorption characteristics of some Ottawa River sediments. *Can. J. Earth Sci.*, 13: 530 (1976).
97. Gardiner, J. The chemistry of cadmium in natural water: 1. A study of cadmium complex formation using the cadmium specific-ion electrode. *Water Res.*, 8: 23 (1974).
98. Culp, G.L. and Culp, R.L. New concepts in water purification. Van Nostrand Reinhold, Toronto. p. 221 (1974).
99. Wershaw, R.L., Burcar, P.J. and Goldberg, M.C. Interaction of pesticides with natural organic material. *Environ. Sci. Technol.*, 3: 271 (1969).
100. Kahn, S.U. Adsorption of 2,4-D from aqueous solution by fulvic acid/clay complex. *Environ. Sci. Technol.*, 4: 236 (1974).
101. Morris, R.L. and Johnson, L.G. Agricultural runoff as a source of halomethanes in drinking water. *J. Am. Water Works Assoc.*, 68: 492 (1976).

Turbidity (10/03)

102. Stevens, A.A., Slocum, C.J., Seeger, D.R. and Robeck, G.G. Chlorination of organics in drinking water. *J. Am. Water Works Assoc.*, 68: 615 (1976).
103. Harms, L.L. and Looyenga, R.W. Preventing haloform formation in drinking water. EPA-600/2-80-091. U.S. Environmental Protection Agency, Washington, DC, August (1980).
104. American Water Works Association. Treatment techniques for controlling trihalomethanes in drinking water. Denver, CO (1982).
105. Driscoll, C.T. and Letterman, R.D. Factors regulating residual aluminum concentrations in treated waters. *Envirometrics*, 6: 287-309 (1995).
106. Department of National Health and Welfare. A national survey for asbestos fibres in Canadian drinking water supplies. 79-EHD-4. Environmental Health Directorate, Ottawa (1979).
107. Logsdon, G.S. and Symons, J.M. Removal of asbestiform fibers by water filtration. *J. Am. Water Works Assoc.*, 69: 499 (1977).
108. Symons, J.M. and Hoff, J.C. Rationale for turbidity maximum contaminant level. Presented at the 3rd American Water Works Association Water Quality Technology Conference, Atlanta, GA, December (1975).
109. Lawrence, J. and Zimmerman, H.W. Asbestos in water: mining and processing effluent treatment. *J. Water Pollut. Control Fed.*, 49: 156 (1977).
110. Logsdon, G.S., Evavold, G.L., Patton, J.L. and Watkins, J. Filter plant design for asbestos fiber removal. *Am. Soc. Civ. Eng. J. Environ. Eng. Div.*, 109: 900 (1983).
111. Logsdon, G.S., Symons, J.M. and Sorg, T.J. Monitoring water filters for asbestos removal. *Am. Soc. Civ. Eng. J. Environ. Eng. Div.*, 107: 1297 (1981).
112. McGuire, M.J., Bowers, A.E. and Bowers, D.A. Optimizing large-scale water treatment plants for asbestos-fiber removal. *J. Am. Water Works Assoc.*, 75: 364 (1983).
113. Boatman, E.S. Analyzing asbestos fibres in water by means of transmission electron microscopy. *J. Am. Water Works Assoc.*, 74: 533 (1982).
114. Farren, E.F., Buelow, R.W., Thurnau, R.C., Gardels, M., Sorrell, R.K., Snyder, P. and Dressman, R.C. Water quality deterioration in the distribution system. Presented at the 5th American Water Works Association Water Quality Technology Conference, Kansas City, MO, December (1977).
115. Hudson, H.E. High-quality water production and viral disease. *J. Am. Water Works Assoc.*, 54: 1265 (1962).
116. Shaffer, P.T.B., Metcalf, T.G. and Sproul, O.J. Chlorine resistance of poliovirus isolants recovered from drinking water. *Appl. Environ. Microbiol.*, 40: 1115 (1980).
117. Taylor, F.B., Eagen, J.H., Smith, H.F.A., Jr. and Coene, R.F. The case for water-borne infectious hepatitis. *Am. J. Public Health*, 56: 2093 (1966).
118. Dennis, J.M. 1955-56 infectious hepatitis epidemic in Delhi, India. *J. Am. Water Works Assoc.*, 51: 1288 (1959).

119. LeChevallier, M.W., Norton, W.D. and Lee, R.G. Occurrence of *Giardia* and *Cryptosporidium* spp. in surface water supplies. *Appl. Environ. Microbiol.*, 199(57): 2610–2616 (1991).
120. Morris, R.D., Naumova, E.N., Levin, R. and Munasinghe, R.L. Temporal variation in drinking water turbidity and disguised gastroenteritis in Milwaukee. *Am. J. Public Health*, 86(2): 237–239 (1996).
121. Lin, S.D. *Giardia lamblia* and water supply. *J. Am. Water Works Assoc.*, 77: 40 (1985).
122. American Water Works Association. AWWA statement of policy: quality goals for potable water. *J. Am. Water Works Assoc.*, 60: 1317 (1968).
123. Committee Report. Waterborne disease in the United States and Canada. *J. Am. Water Works Assoc.*, 73: 528 (1981).
124. Aramini, J., McLean, M., Wilson, J., Holt, J., Copes, R., Allen, B. and Sears, W. Drinking water quality and health care utilization for gastrointestinal illness in Greater Vancouver. *Canada Communicable Disease Report* 26-24. Health Canada, Ottawa, Ontario, 15 December (2000).
125. U.S. Environmental Protection Agency. Hach Filter Trak Method 10133, “Determination of Turbidity by Laser Nephelometry”. January 2000, Revision 2.0 . [Federal Register 40 CFR §141.74: October 29, 2002 (Volume 67, Number 209)]. Description can be obtained from Hach Co., P.O. Box 389, Loveland, Colorado 80539-0389, telephone 1-970-669-3050.
126. U.S. Environmental Protection Agency. National Primary Drinking Water Regulations: Long Term 2 Enhanced Surface Water Treatment Rule - Toolbox Guidance Manual, June 2003, pages 1-8.

Appendix A

Determining if Groundwater Is Under the Direct Influence of Surface Water²

Determining whether groundwater is under the influence of surface water is a complex process. While there is considerable variation in the circumstances that may result in groundwater becoming contaminated with surface water, some key issues that should be considered include:

?????

Geology

- What are the characteristics of the aquifer deposit (i.e., lithology, stratigraphy and structure)?
- How was the deposit created (i.e., geomorphology)?
- What is the age of the deposit?
- Is it a confined, semi-confined or unconfined aquifer?
- If the aquifer was created during a recent geologic event (i.e., alluvial deposits/post-glaciation), is it likely to be connected to an existing surface water body? Is it susceptible to land surface use and influences? What are the consequences? What is the level of risk?
- If the aquifer was created during an ancient geologic event (i.e., unconsolidated deposits or bedrock deposits/pre-glaciation), is it likely to be connected to an existing surface water body? Is it susceptible to land surface use and influences? What are the consequences? What is the level of risk?
- What are the effects of local topography (e.g., mountains, foothills, plains)?
- What are the effects of local geology and geologic events (i.e., facies changes, complex geology, glaciation)?

Hydrogeology

- Do the aquifer characteristics (i.e., hydraulic head, intrinsic permeability, hydraulic conductivity, transmissivity, storativity) imply direct surface water and/or land surface influence(s)?
- Is there evidence of local surface water “discharge/recharge” to/from the aquifer?
- What is the direction of groundwater flow (i.e., hydraulic gradient)?
- What is the consequence of pumping groundwater from the aquifer (cone of influence)? Is there a change in gradient?

Hydrochemistry

- Is there evidence of water quality similarities between the aquifer and surface water (i.e., chemistry, temperature, bacterial count)?
- Is there evidence through environmental isotope analysis (³H, ¹⁴C, ¹⁸O, ²H)?
- What is the chemical age of the groundwater (i.e., mineralization)? How does it compare with that of the local surface water?
- Is there evidence of a hydrochemical facies change?
- What is the level of bacterial contamination in the aquifer?

Land use issues

- What types of local land use are there (e.g., agricultural, industrial, municipal, recreational)?

Soil horizon

- What type of soil is there?

Tools for making the assessment

- Cross-sections, isopach maps, topographic maps and geological maps
- Aquifer pumping test, groundwater modelling and groundwater monitoring (observation wells, piezometers), soil percolation tests
- Local water balance exercises (groundwater vs. surface water recharge/discharge)
- Isotope analysis

Trihalomethane

From Wikipedia, the free encyclopedia








Trihalomethanes (**THMs**) are chemical compounds in which three of the four hydrogen atoms of methane (CH_4) are replaced by halogen atoms. Many trihalomethanes find uses in industry as solvents or refrigerants. THMs are also environmental pollutants, and many are considered carcinogenic. Trihalomethanes with all the same halogen atoms are called **haloforms**.

Contents

- 1 Table of common trihalomethanes
- 2 Industrial uses
 - 2.1 Refrigerants
 - 2.2 Solvents
- 3 Water pollutants
- 4 References
- 5 External links

Table of common trihalomethanes

Common trihalomethanes (ordered by molecular weight)

Molecular formula	IUPAC name	CAS registry number	Common name	Other names	Molecule
CHF_3	trifluoromethane	75-46-7	fluoroform	Freon 23, R-23, HFC-23	
CHClF_2	chlorodifluoromethane	75-45-6	chlorodifluoromethane	R-22, HCFC-22	
CHCl_3	trichloromethane	67-66-3	chloroform	methyl trichloride	
CHBrCl_2	bromodichloromethane	75-27-4	dichlorobromomethane	BDCM	
CHBr_2Cl	dibromochloromethane	124-48-1	chlorodibromomethane	CDBM	
CHBr_3	tribromomethane	75-25-2	bromoform	methyl tribromide	
CHI_3	triiodomethane	75-47-8	iodoform	methyl triiodide	

Industrial uses

Refrigerants

Trifluoromethane and chlorodifluoromethane are both used as refrigerants in some applications. Trihalomethanes released to the environment break down faster than chlorofluorocarbons (CFCs), thereby doing much less damage to the ozone layer (if they contain chlorine). Chlorodifluoromethane is a refrigerant HCFC, or hydrochlorofluorocarbon, while fluoroform is an HFC, or hydrofluorocarbon. Fluoroform is not ozone depleting.

Unfortunately, the breakdown of trihalomethane HCFCs does still result in the creation of some free chlorine radicals in the upper atmosphere and subsequent ozone destruction. Ideally, HCFCs will be phased out entirely in favour of entirely nonchlorinated refrigerants.

Solvents

Chloroform is a very common solvent used in organic chemistry. It is a significantly less polar solvent than water, well-suited to dissolving many organic compounds.

Although still toxic and potentially carcinogenic, chloroform is significantly less harmful than carbon tetrachloride. Because of the health and regulatory issues associated with the use of carbon tetrachloride, in modern chemistry laboratories chloroform is used as a cheaper, cleaner alternative wherever possible.

Water pollutants

Trihalomethanes are formed as a by-product predominantly when chlorine is used to disinfect water for drinking. They represent one group of chemicals generally referred to as disinfection by-products. They result from the reaction of chlorine and/or bromine with organic matter present in the water being treated. The THMs produced have been associated through epidemiological studies with some adverse health effects. Many governments set limits on the amount permissible in drinking water. However, trihalomethanes are only one group of many hundreds of possible disinfection by-products—the vast majority of which are not monitored—and it has not yet been clearly demonstrated which of these are the most plausible candidate for causation of these health effects. In the United States, the EPA limits the total concentration of the four chief constituents (chloroform, bromoform, bromodichloromethane, and dibromochloromethane), referred to as total trihalomethanes (TTHM), to 80 parts per billion in treated water.

Chloroform is also formed in swimming pools which are disinfected with chlorine or hypochlorite in the haloform reaction with organic substances (e.g. urine, sweat, hair and skin particles). Some of the THMs are quite volatile and may easily vaporize into the air. This makes it possible to inhale THMs while showering, for example. The EPA, however, has determined that this exposure is minimal compared to that from consumption. In swimmers uptake of THMs is greatest via the skin with dermal absorption accounting for 80% of THM uptake^[1]. Exercising in a chlorinated pool increases the toxicity of a "safe" chlorinated pool atmosphere^[2] with toxic effects of chlorine byproducts greater in young swimmers than older swimmers^[3].

References

- ¹ ^ Lindstrom, AB et al. (1997) Alveolar breath sampling and analysis to assess trihalomethane exposures during competitive swimming training. *Environ. Health Persp.*, 105 (6), 636-642
- ² ^ Drobnic, F et al. (1996) Assessment of chlorine exposure in swimmers during training. *Medicine and Science in Sports and Exercise*, 28 (2), 271-274
- ³ ^ Aiking, H. et al. (1994) Swimming pool chlorination: a health hazard? *Toxicology Letters*, 72(1-3), 375-380

External links

- National Pollutant Inventory - Chloroform and trichloromethane (<http://www.npi.gov.au/database/substance-info/profiles/23.html>)
- How Ozone Technology Reduces Disinfection Byproducts (<http://www.biozone.com/trihalomethanes.html>)
- Testing for Trihalomethanes (<http://www.caslab.com/News/testing-for-trihalomethanes-in-your-water-tthm.html>)
- EPA - Trihalomethanes in Drinking Water (<http://yosemite.epa.gov/water/owrcatalog.nsf/9da204a4b4406ef885256ae0007a79c7/be44ad7c8f83f25a85256b06007255e9!OpenDocument>)

Retrieved from "<http://en.wikipedia.org/wiki/Trihalomethane>"

Categories: Halomethanes | Halogenated solvents | Refrigerants

- This page was last modified on 22 March 2011 at 03:47.
 - Text is available under the Creative Commons Attribution-ShareAlike License; additional terms may apply. See Terms of use for details.
- Wikipedia® is a registered trademark of the Wikimedia Foundation, Inc., a non-profit organization.

Home > Environmental & Workplace Health > Reports & Publications > Water Quality > Trihalomethanes

Environmental and Workplace Health

Table of Contents

Previous	Table of Contents	Next
--------------------------	-----------------------------------	----------------------

1.0 Guidelines

Trihalomethanes

The maximum acceptable concentration (MAC) for trihalomethanes¹ (THMs) in drinking water is 0.100 mg/L (100 µg/L) based on a locational running annual average of a minimum of quarterly samples taken at the point in the distribution system with the highest potential THM levels.

Bromodichloromethane

The maximum acceptable concentration (MAC) for bromodichloromethane (BDCM) in drinking water is 0.016 mg/L (16 µg/L) monitored at the point in the distribution system with the highest potential THM levels.

Other Considerations

Utilities should make every effort to maintain concentrations as low as reasonably achievable without compromising the effectiveness of disinfection.

2.0 Executive summary

Trihalomethanes are a group of compounds that can form when the chlorine used to disinfect drinking water reacts with naturally occurring organic matter (e.g., decaying leaves and vegetation). The use of chlorine in the treatment of drinking water has virtually eliminated waterborne diseases, because chlorine can kill or inactivate most microorganisms commonly found in water. The majority of drinking water treatment plants in Canada use some form of chlorine to disinfect drinking water: to treat the water directly in the treatment plant and/or to maintain a chlorine residual in the distribution system to prevent bacterial regrowth. The health risks from disinfection by-products, including trihalomethanes, are much less than the risks from consuming water that has not been disinfected. Utilities should make every effort to maintain concentrations of all disinfection by-products as low as reasonably achievable without compromising the effectiveness of disinfection.

The trihalomethanes most commonly found in drinking water are chloroform, bromodichloromethane (BDCM), dibromochloromethane (DBCM) and bromoform. Of these, chloroform has been most extensively studied, and there are some scientific data available on BDCM. However, insufficient data are available to develop a guideline for either DBCM or bromoform. Since chloroform is the trihalomethane most often found in drinking water, and generally at the highest concentrations, the trihalomethane guideline is based on health risks linked to chloroform. This guideline applies to the total concentration of chloroform, BDCM, DBCM and bromoform.

This Guideline Technical Document reviews all the health risks associated with trihalomethanes in drinking water, incorporating multiple routes of exposure to trihalomethanes via drinking water including ingestion, and both inhalation and skin absorption from showering and bathing. It

assesses all identified health risks, taking into account new studies and approaches, and applies appropriate safety factors. Based on this review, the guideline for total trihalomethanes in drinking water is established at a maximum acceptable concentration of 0.1 mg/L.

Although the concentration of BDCM is included in the concentration of trihalomethanes in the guideline, a separate guideline for BDCM is also deemed necessary. The guideline for bromodichloromethane in drinking water is established at a maximum acceptable concentration of 0.016 mg/L.

2.1 Health effects

Chloroform is considered to be a possible carcinogen in humans, based on limited evidence in experimental animals, and inadequate evidence in humans. Animal studies have shown links between exposure to specific trihalomethanes and liver tumours in mice and kidney tumours in both mice and rats; some studies in humans show data that are consistent with these findings. Human studies are suggesting a link between exposure to trihalomethanes and colorectal cancers.

Human studies also suggest a link between reproductive effects and exposure to high levels of trihalomethanes. However, an increase in the concentration of trihalomethanes could not be linked to an increase in risk, suggesting the need for more studies.

Preliminary animal studies indicate that BDCM and other trihalomethanes that contain bromine may be more toxic than chlorinated trihalomethanes such as chloroform. For this reason, and based on the availability of scientific data for BDCM, a separate guideline was also developed for BDCM. BDCM is considered to be a probable carcinogen in humans, with sufficient evidence in animals and inadequate evidence in humans. Animal studies have shown tumours in the large intestine in rats. Among the four trihalomethanes commonly found in drinking water, BDCM appears to be the most potent rodent carcinogen, causing tumours at lower doses and at more target sites than the other three compounds.

Exposure to BDCM at levels higher than the guideline value has also been linked to a possible increase in reproductive effects (increased risk for spontaneous abortion or stillbirth) above what can normally be expected. Further studies are required to confirm these effects.

2.2 Exposure

Levels of trihalomethanes, including BDCM, are generally higher in treated surface water than in treated groundwater, because of the high organic content in lakes and rivers, and will be higher in warmer months, because of the higher concentrations of precursor organic materials in the raw water and especially because the rate of formation of disinfection by-products increases at higher temperatures. Trihalomethanes levels are also affected by the choice and design of treatment processes. Recent data indicate that, in general, average trihalomethanes levels in Canadian drinking water supplies are well below the guideline. However, some systems show average levels well above the guidelines; these systems serve only a small proportion of Canadians (less than 4%) and are generally smaller treatment systems with limited ability to remove organic matter before adding the chlorine disinfectant. It should be noted that the presence of brominated by-products such as BDCM will also depend on the presence of bromine in the source water.

2.3 Treatment

Trihalomethanes and haloacetic acids are the two major groups of disinfection by-products found in drinking water and generally at the highest levels. Together, these two groups can be used as indicators for the presence of all disinfection by-products in drinking water supplies, and their control is expected to reduce the levels of all disinfection by-products and the corresponding risks to health. A guideline for haloacetic acids is expected to be available in 2006-2007.

The approach to reduce exposure to trihalomethanes is generally focussed on reducing the formation of chlorinated disinfection by-products. The concentrations of trihalomethanes and other chlorinated disinfection by-products in drinking water can be reduced at the treatment plant by

removing the organic matter from the water before chlorine is added, by optimizing the disinfection process or using alternative disinfection strategies, or by using a different water source. It is critical that any method used to control trihalomethanes levels **must not** compromise the effectiveness of disinfection. The Federal-Provincial-Territorial Committee on Drinking Water also recommends that every effort be made not only to meet the guideline, but to maintain concentrations of trihalomethanes as low as reasonably achievable.

¹ Trihalomethanes refers to the total of chloroform, bromodichloromethane, dibromochloromethane and bromoform

Previous	Table of Contents	Next
--------------------------	-----------------------------------	----------------------

Date Modified: 2009-04-24

Tech Brief

PUBLISHED BY THE NATIONAL ENVIRONMENTAL SERVICES CENTER

Line Pigging

By Zane Satterfield, P. E., NESC Engineering Scientist

Summary

Line pigging is an internal pipe-cleaning process used to remove biofilms or other foreign matter from the inside of water pipes. If performed correctly, line pigging will renew the flow rates to restricted piping systems and reduce pumping pressures. This Tech Brief discusses some of the techniques and processes used in cleaning waterlines in distributions systems.

Line Pigging

Line pigging (or line swabbing, as it sometimes known), is the process of cleaning distribution lines by inserting a small device known as a pig into the lines and pushing it through them. The term "pigging" originated in the gas and oil industry, where metal discs connected by a rod were moved through the oil pipelines to remove buildup of paraffin wax on the internal wall of the pipe. The action of metal on metal made a squealing noise like a pig and the name stuck. More and more, pigs are being used to clean pipelines in all types of industry including waterlines in municipal distribution systems.


Pigs range in size from 2- to 48-inches in diameter and can be made to order in varying lengths, styles, and configurations for specific applications. Not only are pigs used for cleaning but also for inspecting the inside of pipelines and determining interior dimensions.

Is pigging waterlines really necessary?

States and municipalities typically do not require regular pigging or swabbing of distribution lines in water systems. Some may only require pigging after initial construction of a new line to remove any debris left in the line because flushing alone will not always clean the dirt and debris out of the line.

What is a pig?

A pig is the object, usually bullet shaped, that is pushed by the water in the pipe in the direction of normal flow. The pig can be made of different materials (foam, steel, plastic, polyurethane), but generally is food-grade silicon, which is tough yet flexible and safe to be in contact with drinking water.

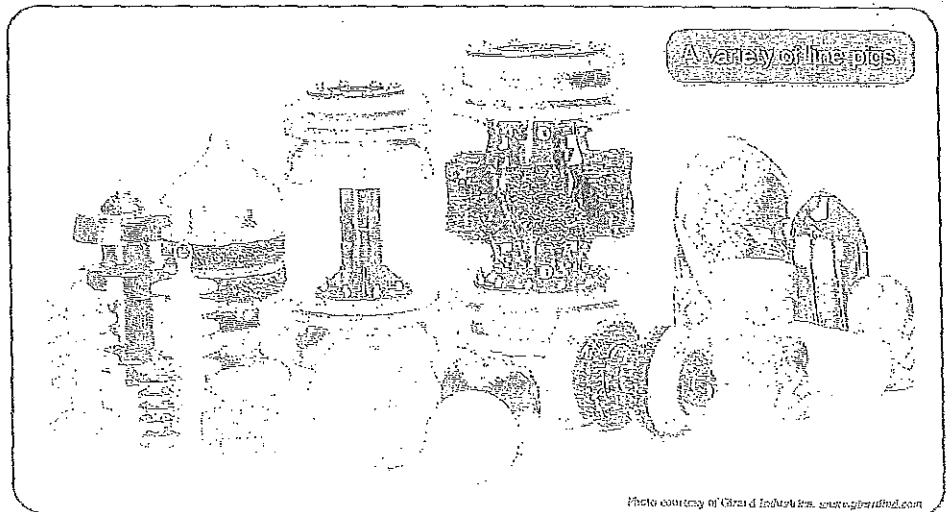

Download all of our
Tech Briefs at

www.nesc.wvu.edu/mdwc/mdwc_th_available.htm



A photo of a 4 x 4 that was pushed out of an 8" water line. It took several days to finally get it out and it came out in pieces, you may finally pigged it out.

One reason to pig a waterline is that all distribution lines tend to have a biofilm coating the inside of the pipe. The bacteria are dormant until certain conditions activate the bacteria, causing problems. Regular flushing will not eliminate this biofilm. Regular pigging with flushing will reduce or eliminate biofilms.

A second reason to pig a line is inadequate water flow. More flow (volume) of water may be needed to support development or a growing population in the water system or to provide adequate water for fire fighting. In areas of water systems where increased development has caused water demand to surpass the flow output of an existing line, the system will usually need to replace the existing waterline with a line that can support the demand needed. If the existing flow is restricted due to excessive deposits, however, pigging may be the solution to the problem.

Third, most states require a minimum of a 6-inch diameter waterline when connecting a fire hydrant to provide adequate flow. After years of service, the inside of the pipe can become

restricted with deposits making the fire hydrant less effective if not useless for its intended job. If fire flow is needed, the solution in the past has been to replace the whole waterline, which is very costly and time consuming. Pigging may restore adequate flow for fighting fires at a fraction of the time and cost.

Finally, pigging waterlines may lessen complaints from water customers regarding the very same deposits that have or can restricted fire flow. These deposits are unwanted foreign matter such as iron oxide (red water), alum, calcium carbonates, barium sulfide and sediment. Pigging, in most cases, provides a solution. Cleaning these deposits can also reduce pumping pressures in areas of water systems that have booster pump stations. Increased pumping pressures can result in line leaks and pipe failures.

Procedure

The procedure starts by determining if the waterline can be pigged. Not every water line is a candidate for line pigging. Is the water line so corroded that pigging can cause failure?

Does the waterline have reducers (i.e., the line getting smaller) that can cause the pig to get stuck? Does the line have increased pipe diameter sizes where the water pressure would be insufficient to move the pig?

One of the main things to look at is the condition of the interior of the pipe. If the pH of the water is low, the interior of the line could be so corroded that pigging could result in failure. If in doubt about the condition of the line, refer to past line repairs or talk to operators who have worked on any repairs of the particular line.

Much of this information can be obtained from as-built drawings or operators who have fixed leaks or installed the original water line. The line will have to be dug up to launch the pig. At that time, a visual inspection should be done to determine if pigging is possible. Another option is to use a low density foam pig in any unknown line and examine the foam pig for wear patterns, tears, or gouges. This may even help determine if the line can be successfully cleaned with a pig.

Before the pigging begins, it's useful to have information about the line:

1. Locate and mark all valves and meters.
2. Approximate all elbows and fittings in the line (again, refer to the as-built drawing if available).
3. Know the pressure and flows in the lines. This will also help determine if any flow increase and possibly pressure decrease was achieved by the pigging.

The more you know before you start, the fewer surprises you'll encounter once you start pigging.

Once the line has been inspected and appears suitable, the actual pigging begins. A pig is inserted into the line to be cleaned by means of a launcher. This is simply an oversized barrel with a reducer mating to the existing line. This allows for easy insertion of the pig, because the pig's outer diameter is larger than the pipe's internal diameter to maintain a good seal. Once in the launcher, clean water is introduced to send the pig on its way. This is usually the same water that is in the line from a nearby flushing hydrant or fire hydrant, or a tanker truck. The pig's path is determined by direction of flow and by isolating the line to be cleaned by closing valves to laterals, if present.

If the waterline is in service, you must notify your customers about the water interruption and possible dirty water after bringing the line back in service. If the water line has a lot of unwanted deposits, it may be wise to pull all water meters just before the pigging process starts and flush at the connection at the end of the process before you replace the meters. Foreign matter could stop-up the meter or cause the meter to malfunction. The debris could also get into the customers' plumbing and cause problems such as plugging the aerators on the faucets, dishwashers, or washing machines.

If the waterline to be pigged has severe scaling (tuberculation) due to iron oxide (red water), alum, calcium carbonates, barium sulfide, or sediment, a progressive or stepped approach must be taken to avoid getting a pig stuck or losing a pig. This approach is simply using a smaller diameter pig at first and working your way up incrementally to the inside diameter of the pipe. The stepped technique will minimize the risk of the pig getting stuck or large amounts of debris plugging the line by cleaning a little bit at a time.



Articles about locating distribution lines and valve exercising programs are available on the National Environmental Services Center Web site at www.nesc.wvu.edu/ndwc.


Smart Pigs

There are many different types and sizes of pigs. For waterline use, some nonstandard pigs include:

- Gauging pigs are mainly used after constructing the pipeline or before pigging an old line to determine if there are any obstructions in the pipeline.
- Profile pigs are gauging pigs with multiple gauging plates used to help map the inside condition of the pipe walls.
- Magnetic cleaning pigs are used to pick up ferrous debris left in the pipeline.
- Transmitter pigs or detector pigs are used to map out the location of pipeline or help locate a stuck pig.
- Spheres are round for ease in negotiating short radius 90-degree elbows, irregular turns, bends, and sweeps.

Dealing with a Stuck or Lost Pig

If a pipeline has not been pigged on a routine basis or has never been pigged, a pig can get stuck. If a pig becomes stuck, the first priority

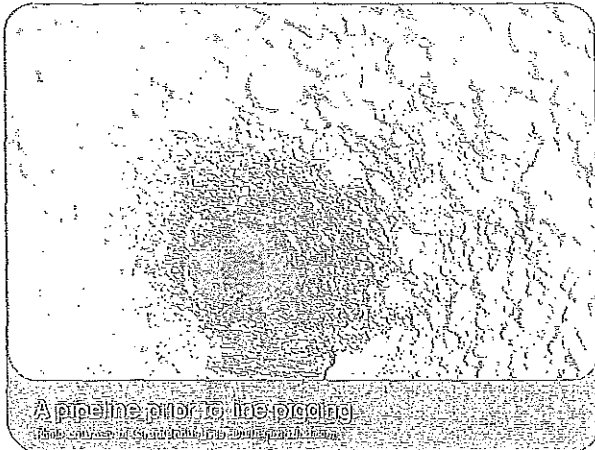

is to find and retrieve it, but you must identify the cause. Usually one of two conditions exists when a pig is stuck: fluid bypassing around the pig (not pushing the pig) or a blockage of the flow.

In water distribution systems that have loops and multiple tee connections a pig can find its way out of the work area and get lost. It is important to locate all valves and close off the lines that are not being pigged and know the direction of water flow.

If you lose a pig, a smart pig such as a detector pig or transmitter pig can be launched to help find the lost pig. A transmitter can also be installed in the cleaning pig so that a second pig does not have to be launched to help locate it if it should get lost or stuck. Sometimes a pig gets stuck because of a broken or shut gate valve.

Procedures for dealing with a stuck pig or fluid going around the pig:

1. Increase the line pressure and flow rate, but do not exceed the safe limits of the pipeline allowing for age and/or condition of the line. The flow rate and pressure can be increased with a pumper and tanker fire truck.
2. Release pressure from the line and drain the line back toward the launcher. Releasing pressure allows the pig to relax to its normal shape and may even cause the pig to back up in the line. After pressure has dissipated completely for several minutes, re-pressurize the line in an attempted to drive the pig through the restriction. This may be repeated two or three times.
3. For a bypass situation, run a soft swab in behind the stuck pig to try and create

a positive seal, stopping the bypass. Repeat step one above.

4. Back the pig up by applying pressure from the opposite end of the waterline using a pump or possibly a pumper fire truck.
5. If a foam pig is used and gets stuck a super-chlorinate mixture (3,000 to 5,000 ppm) in a slug form can be used to dissolve the pig. The line must be flushed and tested to be sure the chlorine residual is allowable limits after the super chlorination.

Water systems are advised not to undertake line pigging on their own. Shop around and find a reputable company with experience in line pigging with water lines. Start with an area of the water system that the line location, size, type, and condition are all known and the lines can be dug up easily if needed.

References:

- Chem Tech Services. 2007. Various Information. Accessed at www.chemtechservices.com/pigging.htm.
- Girard Industries. 2007. Technical Information on Pipeline Pigging. Accessed at www.girardind.com/articles/art-of-pigging.htm.
- Hygienic Pigging Systems. 2007. Various Information. Accessed at <http://hpspigging.com/services.html>.
- Kershaw, Richard. Date unknown. "Innovative Pigging Solutions For Pipelines." Tech Notes: A Pipeline & Gas Journal Fact Sheet. Chesterfield, UK: Pigtek Ltd.
- Pigs Unlimited. 2007. Various Information. Accessed at www.pigsunlimited.com/asp/about.asp.
- Rader, Larry. 2003. "On The Trail of the Elusive Water Leak." On Tap (Summer). Morgantown, WV: National Drinking Water Clearinghouse.
- U. S. Environmental Protection Agency. 1999. *Microbial and Disinfection Byproducts Rules Simultaneous Compliance Guidance Manual*. Washington, D.C.

Special thanks to John Burris of Girard Industries for his assistance.



NESC Engineering Scientist Zane Satterfield is a licensed professional engineer and previously worked for the West Virginia Bureau of Public Health, Environmental Engineering Division.


If you would like to receive any or all of our free Tech Bytes, send a request with your name, address, item numbers, your phone number, and number of copies to info@nec.nesc.com.

You also may call NESC at (306) 624-8301.



An Equal Opportunity/Affirmative Action Institution

Exova
 #104, 19575-65 A Ave.
 Surrey, British Columbia
 V3S 6P6, Canada
 T: +1 (604) 514-3322
 F: +1 (604) 514-3323
 E: Survey@exova.com
 W: www.exova.com





Analytical Report

Bill To: Fraser Health Authority	Project:	Lot ID: 822700
Report To: Fraser Health Authority	ID: Village of Harrison Springs	Control Number:
207 - 2776 Bourquin Crescent	Name: THM	Date Received: Aug 25, 2011
Abbotsford, BC, Canada	Location:	Date Reported: Aug 30, 2011
V2S 6A4	LSD:	Report Number: 1465090
Attn: Jeniene Lutz	P.O.:	
Sampled By:	Acct code:	
Company:		

Reference Number 822700-1
 Sample Date Aug 24, 2011
 Sample Time NA
 Sample Location
 Sample Description Village of Harrison
 Hot Springs
 Matrix Water

Analyte	Units	Results	Results	Results	Nominal Detection Limit
Trihalomethanes Screen - Water					
Chloroform	mg/L	0.038			0.001
Bromodichloromethane	mg/L	<0.001			0.001
Dibromochloromethane	mg/L	<0.001			0.001
Bromoform	mg/L	<0.001			0.001
Total Trihalomethanes	mg/L	0.038			0.001
Trihalomethanes - Surrogate Recovery					
Dibromofluoromethane	EPA Surrogate	%	105		86-118
Toluene-d8	EPA Surrogate	%	101		85-115
Bromofluorobenzene	EPA Surrogate	%	92		86-115

Approved by: *Mathieu Simoneau*
 Mathieu Simoneau
 Operations Manager



Home > Environmental & Workplace Health > Reports & Publications > Water Quality > Guidelines for Canadian Drinking Water Quality - Summary Table

Environmental and Workplace Health

Guidelines for Canadian Drinking Water Quality - Summary Table

Prepared by the
Federal-Provincial-Territorial Committee on Drinking Water of the
Federal-Provincial-Territorial Committee on Health and the Environment

December 2010

Help on accessing alternative formats, such as Portable Document Format (PDF), Microsoft Word and PowerPoint (PPT) files, can be obtained in the [alternate format help section](#).



(PDF Version - 190 K)

Table of Contents

Introduction

Membership of the Federal-Provincial-Territorial Committee on Drinking Water

New, revised, reaffirmed and upcoming guidelines

Table 1. New and revised guidelines

Table 2. Guidance documents

Table 3. Reaffirmed guidelines

Table 4. Upcoming documents

Guidelines for microbiological parameters

Bacteriological guidelines

Protozoa

Viruses

Turbidity

Guidelines for chemical and physical parameters

Table 5. Health-based and aesthetic guidelines for chemical/physical parameters

Table 6. Parameters without numerical guidelines

Table 7. Parameters that have been archived

Guidelines for radiological parameters

Table 8. Health based guidelines for radiological parameters

Introduction

The *Guidelines for Canadian Drinking Water Quality* are published by Health Canada on behalf of the Federal-Provincial-Territorial Committee on Drinking Water (CDW). This summary table is updated regularly and published on Health Canada's website (www.healthcanada.gc.ca/waterquality). It supersedes all previous versions, as well as the published booklet of the *Sixth Edition of the Guidelines for Canadian Drinking Water Quality*.

These guidelines are based on current, published scientific research related to health effects, aesthetic effects, and operational considerations. Health-based guidelines are established on the basis of comprehensive review of the known health effects associated with each contaminant, on exposure levels and on the availability of treatment and analytical technologies. Aesthetic effects (e.g., taste, odour) are taken into account when these play a role in determining whether consumers will consider the water drinkable. Operational considerations are factored in when the presence of a substance may interfere with or impair a treatment process or technology (e.g.,

turbidity interfering with chlorination or UV disinfection) or adversely affect drinking water infrastructure (e.g., corrosion of pipes).

The Federal-Provincial-Territorial Committee on Drinking Water establishes the Guidelines for Canadian Drinking Water Quality specifically for contaminants that meet all of the following criteria:

1. exposure to the contaminant could lead to adverse health effects;
2. the contaminant is frequently detected or could be expected to be found in a large number of drinking water supplies throughout Canada; and
3. the contaminant is detected, or could be expected to be detected, at a level that is of possible health significance.

If a contaminant of interest does not meet all these criteria, the Federal-Provincial-Territorial Committee on Drinking Water may choose not to establish a numerical guideline or develop a Guideline Technical Document. In that case, a Guidance Document may be developed.

Guidance Documents undergo a process similar to Guideline Technical Documents, including public consultations through the Health Canada website. They are offered as information for drinking water authorities, and help provide guidance relating to contaminants, drinking water management issues or emergency situations. Consultation documents, Guideline Technical Documents and Guidance documents are available from the Health Canada website (www.healthcanada.gc.ca/waterquality).

In general, the highest priority guidelines are those dealing with microbiological contaminants, such as bacteria, protozoa and viruses. Any measure taken to reduce concentrations of chemical contaminants should not compromise the effectiveness of disinfection.

Inquiries can be directed to: water_eau@hc-sc.gc.ca

Membership of the Federal-Provincial-Territorial Committee on Drinking Water

Jurisdictional representatives

Alberta	Department of Environment	Dr. Donald Reid
British Columbia	Ministry of Health Services	Mr. Barry Boettger
Manitoba	Department of Water Conservation	Ms. Kim Phillip
New Brunswick	Department of Health and Wellness	Ms. Karen White
Newfoundland and Labrador	Department of Environment and Conservation	Mr. Haseen Khan
Northwest Territories	Stanton Territorial Health Authority	Mr. Duane Fleming
Nova Scotia	Department of Environment and Labour	Ms. Judy MacDonald
Nunavut Territory	Department of Health and Social Services	Mr. Peter Workman
Ontario	Ministry of the Environment	Dr. Satish Deshpande
Prince Edward Island	Department of Environment, Energy and Forestry	Mr. George Somers
Québec	Ministère du Développement durable, de l'Environnement et des Parcs	Ms. Caroline Robert
Saskatchewan	Department of the Environment	Mr. Sam Ferris
Yukon Territory	Department of Health and Social Services	Ms. Patricia Brooks
Canada	Department of Health	Dr. John Cooper

Liaison officers

Federal-Provincial-Territorial Committee on Health and the Environment (CHE) Mr. Peter Workman
 Environment Canada/Canadian Council of Ministers of the Environment Dr. Doug Spry

Committee secretary

Health Canada (Water, Air and Climate Change Bureau, Safe Environments Directorate, Healthy Environments and Consumer Safety Branch) Ms. Anne Vézina

New, revised, reaffirmed and upcoming guidelines

Guidelines for several chemical, physical and microbiological parameters are new or have been revised since the publication of the *Sixth Edition of the Guidelines for Canadian Drinking Water Quality* in 1996. These new and revised guidelines are presented in [Table 1](#).

Table 1. New and revised guidelines

Parameter	Guideline (mg/L)	Previous guideline (mg/L)	CHE approval
<i>Microbiological parameters^a</i>			
Bacteriological		0 coliforms/100 mL	
<i>E.coli</i>	0 per 100 mL		2006
Total coliforms	0 per 100 mL		2006
Heterotrophic plate count	No numerical guideline required		2006
Emerging pathogens	No numerical guideline required		2006
Protozoa	No numerical guideline required	None	2004
Enteric viruses	No numerical guideline required	None	2004
Turbidity	0.3/1.0/0.1 NTU ^b	1.0 NTU	2004
<i>Chemical and physical parameters</i>			
Aluminum	0.1/0.2 ^c	None	1999
Antimony	0.006	None	1997

^aRefer to section on Guidelines for microbiological parameters.

^bBased on conventional treatment/slow sand or diatomaceous earth filtration/membrane filtration.

^cThis is an operational guidance value, designed to apply only to drinking water treatment plants using aluminum-based coagulants. The operational guidance values of 0.1 mg/L applies to conventional treatment plants, and 0.2 mg/L applies to other types of treatment systems.

^dThe separate guideline for BDCM was rescinded based on new science. See addendum to the THM document. In certain situations, the Federal-Provincial-Territorial Committee on Drinking Water may choose to develop guidance documents for contaminants that do not meet the criteria for guideline development, and for specific issues for which operational or management guidance is warranted.


Parameter	Guideline Value (mg/L)	Guideline Value (µg/L)	Guidance Document
Arsenic	0.010	0.025	2006
Benzene	0.005	0.005	2009
Bromate	0.01	None	1999
Chlorate	1.0	None	2008
Chlorine	No numerical guideline required	None	2009
Chlorite	1.0	None	2008
Cyanobacterial toxins--microcystin-LR	0.0015	None	2002
Fluoride	1.5	1.5	1996
Formaldehyde	No numerical guideline required	None	1998
Haloacetic Acids--Total (HAAs)	0.080	None	2008
2-Methyl-4-chlorophenoxyacetic acid (MCPA)	0.1	None	2010
Methyl <i>tertiary</i> -butyl ether (MTBE)	0.015	None	2006
Trichloroethylene (TCE)	0.005	0.05	2005
Trihalomethanes--Total (THMs) ^d	0.100	0.100	2006
Uranium	0.02	0.1	2000
<i>Radioactive parameters</i>			
Cesium-137 (¹³⁷ Cs)	10 Bq/L	10 Bq/L	2009
Iodine-131 (¹³¹ I)	6 Bq/L	6 Bq/L	2009
Lead-210 (²¹⁰ Pb)	0.2 Bq/L	0.1 Bq/L	2009
Radium-226 (²²⁶ Ra)	0.5 Bq/L	0.6 Bq/L	2009
Strontium-90 (⁹⁰ Sr)	5 Bq/L	5 Bq/L	2009
Tritium (³ H)	7000 Bq/L	7000 Bq/L	2009

^aRefer to section on Guidelines for microbiological parameters.

^bBased on conventional treatment/slow sand or diatomaceous earth filtration/membrane filtration.

^cThis is an operational guidance value, designed to apply only to drinking water treatment plants using aluminum-based coagulants. The operational guidance values of 0.1 mg/L applies to conventional treatment plants, and 0.2 mg/L applies to other types of treatment systems.

^dThe separate guideline for BDCM was rescinded based on new science. See addendum to the THM document. In certain situations, the Federal-Provincial-Territorial Committee on Drinking Water may choose to develop guidance documents: for contaminants that do not meet the criteria for guideline development, and for specific issues for which operational or management guidance is warranted.

 Top of Page

In certain situations, the Federal-Provincial-Territorial Committee on Drinking Water may choose to develop guidance documents: for contaminants that do not meet the criteria for guideline development, and for specific issues for which operational or management guidance is warranted.

Table 2. Guidance documents

Parameter	Year
Boil water advisories	2009
Chloral hydrate	2008
Corrosion Control	2009
Drinking water avoidance advisories	2009
Potassium from water softeners	2008

The Federal-Provincial-Territorial Committee on Drinking Water has established a science-based process to systematically review older guidelines to assess the need to update them. Table 3 provides the list of parameters whose guidelines remain appropriate and have been reaffirmed as a result of this review. Health Canada and the FPT Committee on Drinking Water will continue to monitor research on these parameters and recommend any revision(s) to the guidelines that is deemed necessary.

Table 3. Reaffirmed guidelines (2005)

Asbestos	Cyanazine	Iron	Taste
Azinphos-methyl	Diazinon	Magnesium	Temperature
Bendiocarb	Dicamba	Malathion	Terbufos
Benzo(a)pyrene	2,4-Dichlorophenol	Methoxychlor	2,3,4,6-
Bromoxynil	Diclofop-methyl	Metribuzin	Tetrachlorophenol
Cadmium	Dimethoate	Odour	Toluene
Calcium	Diquat	Paraquat	2,4,6-Trichlorophenol
Carbaryl	Diuron	Pentachlorophenol	Trifluralin
Carbofuran	Ethylbenzene	Phorate	Xylenes
Chloride	Gasoline	Picloram	Zinc
Colour	Glyphosate	Silver	

Table 4 outlines documents which are being or have been developed and are awaiting approval through the Federal-Provincial-Territorial process.

Table 4. Upcoming documents (not yet finalized/approved)

Parameter	Federal (FPT designated)	Development
Ammonia	GTD	In preparation ^b
Carbon tetrachloride	GTD	In preparation ^a
Chromium	GTD	In preparation ^b
Dichloroethane, 1,2-	GTD	In preparation ^b
Dichloromethane	GTD	In preparation ^a
<i>E. coli</i>	GTD	In preparation ^b
Enteric viruses	GTD	In preparation ^b
Fluoride	GTD	In preparation ^a
Heterotrophic plate count	guidance	In preparation ^a
Nitrate/Nitrite	GTD	In preparation ^b
N-Nitrosodimethylamine (NDMA)	GTD	In preparation ^a
Protozoa	GTD	In preparation ^a

^aFinal guideline technical document or guidance document in preparation for final approval/posting.

^bGuideline technical document or guidance document being prepared for public consultation.

Parameter (mg/L)	Guideline (GTD)	Notes
Selenium	GTD	In preparation ^b
Tetrachloroethylene	GTD	In preparation ^b
Total coliforms	GTD	In preparation ^b
Turbidity	GTD	In preparation ^b
Vinyl chloride	GTD	In preparation ^b

^aFinal guideline technical document or guidance document in preparation for final approval/posting.
^bGuideline technical document or guidance document being prepared for public consultation.

Guidelines for microbiological parameters

Currently available detection methods do not allow for the routine analysis of all microorganisms that could be present in inadequately treated drinking water. Instead, microbiological quality is determined by testing drinking water for *Escherichia coli*, a bacterium that is always present in the intestines of humans and other animals and whose presence in drinking water would indicate faecal contamination of the water.

Bacteriological guidelines

Escherichia coli

The maximum acceptable concentration (MAC) of *Escherichia coli* in public, semi-public, and private drinking water systems is none detectable per 100 mL.

Testing for *E. coli* should be carried out in all drinking water systems. The number, frequency, and location of samples for *E. coli* testing will vary according to the type and size of the system and jurisdictional requirements.

Total coliforms

The MAC of total coliforms in water leaving a treatment plant in a public system and throughout semi-public and private supply systems is none detectable per 100 mL.

For distribution systems in public supplies where fewer than 10 samples are collected in a given sampling period, no sample should contain total coliform bacteria. In distribution systems where greater than 10 samples are collected in a given sampling period, no consecutive samples from the same site or not more than 10% of samples should show the presence of total coliform bacteria.

Testing for total coliforms should be carried out in all drinking water systems. The number, frequency, and location of samples for total coliform testing will vary according to the type and size of the system and jurisdictional requirements.

Heterotrophic plate count

No MAC is specified for heterotrophic plate count (HPC) bacteria in water supplied by public, semipublic, or private drinking water systems. Instead, increases in HPC concentrations above baseline levels are considered undesirable.

Emerging pathogens

No MAC for current or emerging bacterial waterborne pathogens has been established. Current bacterial waterborne pathogens include those that have been previously linked to gastrointestinal illness in human populations. Emerging bacterial waterborne pathogens include, but are not limited to, *Legionella*, *Mycobacterium avium* complex, *Aeromonas hydrophila*, and *Helicobacter pylori*.

Protozoa

Although *Giardia* and *Cryptosporidium* can be responsible for severe and, in some cases, fatal gastrointestinal illness, it is not possible to establish MACs for these protozoa in drinking water at this time. Routine methods available for the detection of cysts and oocysts suffer from low recovery rates and do not provide any information on their viability or human infectivity. Nevertheless, until better monitoring data and information on the viability and infectivity of cysts and oocysts present in drinking water are available, measures should be implemented to reduce the risk of illness as much as possible. If the presence of viable, human-infectious cysts or oocysts is known or suspected in source waters, or if *Giardia* or *Cryptosporidium* has been responsible for past waterborne outbreaks in a community, a treatment and distribution regime and a watershed or wellhead protection plan (where feasible) or other measures known to reduce the risk of illness should be implemented. Treatment technologies in place should achieve at least a 3-log reduction in and/or inactivation of cysts and oocysts, unless source water quality requires a greater log reduction and/or inactivation.

Viruses

Although enteric viruses can be responsible for severe and, in some cases, fatal illnesses, it is not possible to establish MACs for enteric viruses in drinking water at this time. Treatment technologies and watershed or wellhead protection measures known to reduce the risk of waterborne outbreaks should be implemented and maintained if source water is subject to faecal contamination or if enteric viruses have been responsible for past waterborne outbreaks. Where treatment is required, treatment technologies should achieve at least a 4-log reduction and/or inactivation of viruses.

Turbidity

Waterworks systems that use a surface water source or a groundwater source under the direct influence of surface water should filter the source water to meet the following health-based turbidity limits, as defined for specific treatment technologies. Where possible, filtration systems should be designed and operated to reduce turbidity levels as low as possible, with a treated water turbidity target of less than 0.1 NTU at all times. Where this is not achievable, the treated water turbidity levels from individual filters:

1. For **chemically assisted filtration**, shall be less than or equal to **0.3 NTU** in at least 95% of the measurements made, or at least 95% of the time each calendar month, and shall not exceed 1.0 NTU at any time.
2. For **slow sand or diatomaceous earth filtration**, shall be less than or equal to **1.0 NTU** in at least 95% of the measurements made, or at least 95% of the time each calendar month, and shall not exceed 3.0 NTU at any time.
3. For **membrane filtration**, shall be less than or equal to **0.1 NTU** in at least 99% of the measurements made, or at least 99% of the time each calendar month, and shall not exceed 0.3 NTU at any time. If membrane filtration is the sole treatment technology employed, some form of virus inactivation* should follow the filtration process.



Top of Page

REPORT TO COUNCIL

TO: Mayor and Council

DATE: December 5, 2011

**FROM: Andre Isakov,
Community and Economic Development Officer**

FILE: 8100-01

SUBJECT: Relay for Life Event.

ISSUE: Staff have received an Park Special Event Application from the Canadian Cancer Society. The staff would like to seek direction from Council on this special application.


BACKGROUND: The Canadian Cancer Society is wishing to host a fundraising event along the beachfront by the lagoon. The Society has submitted a Park Special Event Application. The event request is for June 9th and 10th. The event would involve estimated 150 to 300 participants. The participants will be taking part in a non-competitive relay event in teams of 8 to 12 individuals. The teams will aim to walk or run non-stop for 12 hours from 7 pm to 7 am in efforts to raise money and awareness for cancer research.

The event is expecting to bring both visitors and attract positive attention. However, Council review and direction is required as this event is proposed to go all night and may involve some noise and light pollution discomforts for the residents in the area. The event organizers are promising to work closely with the community to minimize nuisances and address any noise or light concerns.

RECOMMENDATION:

THAT Council authorize staff to issue a Special Event Park Permit for the Canadian Cancer Society to host the Relay for Life.


Respectfully submitted for your
consideration;

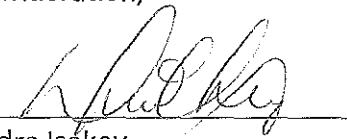

Andre Isakov


Community & Economic Development Officer

DIRECTOR OF FINANCE COMMENTS:




Dale Courtice
Director of Finance

CHIEF ADMINISTRATIVE OFFICER COMMENTS:



Ted Tisdale
Chief Administrative Officer



HARRISON HOT SPRINGS

No Kiosk, Refreshment

VILLAGE OF HARRISON HOT SPRINGS

SPECIAL EVENT PARK / FACILITY USE PERMIT APPLICATION

Name of Applicant: Tim Dixon

On behalf of: Canadian Cancer Society

Address of Applicant: 9136 Young Rd.
Chilliwack BC

Phone Number: 604-791-3323 E-mail: tdixon@bc.cancer.ca

Fax Number: 604-792-9403

Event: Relay For Life Date of Event: Nov 10 12:00 PM

- Wedding
- Family Reunion
- Memorial Hall
- Race / Competition
- Festival
- Other _____

*Note - please provide map of race route / layout of event on beach front, include any necessary road closures and plan for event.

Estimated number of participants: 150-300 participants / 150-300 public for the evening

Location of event: Water front, harbor area

Additional Information: Teams of 8-12 people, non-competitive relay event raising money for research, prevention, information + support programs.
More info @ www.relaybc.ca

In consideration of the issuance of this Permit, the Applicant agrees to the terms and conditions set out on the attached rules and regulations.

[Signature]
Applicant's Signature

Date: Nov 8/2011

CAO, Village of Harrison Hot Springs	Date: _____ Other Licenses required: _____
--------------------------------------	---



VILLAGE OF HARRISON HOT SPRINGS

REPORT TO COUNCIL

TO: Mayor and Council **DATE:** December 5, 2011

FROM: Andre Isakov,
Community and Economic Development Officer **FILE:** 7800-01

SUBJECT: Sasquatch Days – An Intercultural Celebration.

ISSUE: Staff have received a proposal from the Sts'ailes Indian Band for the Village to be a hosting partner in the Sasquatch Days. The staff require Council's direction in this matter.

BACKGROUND: The Sts'ailes Indian Band has approached the Village of Harrison Hot Springs, Tourism Harrison, and the Harrison Festival Society in an effort to form a partnership to bring back and host the Sasquatch Days along the beachfront in Harrison.

Attached to this report please find the following background documents provided by the Sts'ailes Indian Band:

- Event Proposal;
- Appendix with a budget.

Very specifically, Sts'ailes Indian Band is requesting the following from the Village:

- Representation on the organizing committee;
- \$10,000 to cover part of the expenses associated with the event.


The requested financial contribution is expected to be matched by a grant and be added to by contributions from the Sts'ailes Indian Band, Tourism Harrison, and Harrison Festival Society. The Sts'ailes Indian Band will be the main event managing entity.

The 2012-2016 Resort Development Strategy does have \$20,000 identified for events in each of the funding years of the strategy. It is possible to use some of the Resort Development Initiative (RMI) funding to host the Sasquatch Days. The event is expecting to bring both visitors and attract positive attention to the community.

RECOMMENDATION:


THAT Council authorize staff to engage the Sts'ailes Indian Band in hosting the Sasquatch Days with a commitment of a contribution from the RMI of \$10,000 towards the event in 2012.

Respectfully submitted for your consideration,




Andre Isakov
Community & Economic Development Officer

DIRECTOR OF FINANCE COMMENTS:



Dale Courtice
Director of Finance

CHIEF ADMINISTRATIVE OFFICER COMMENTS:



Ted Tisdale
Chief Administrative Officer

Sasquatch Days – An Intercultural Celebration

- Event:** Sasquatch Days – An Intercultural Celebration
Organization: Sts'ailes Indian Band
4690 Salish Way
Agassiz, BC V0M 1A1
P: 604-796-2116
F: 6004-796-3946
- Main Contact:** Paula Cranmer-Underhill, Tourism Officer
Sts'ailes Development Corporation
Paula.Cranmer-Underhill@chehalisband.com
Office 604-796-2116, E. 240
Cell 604-997-4417
- Event Goal:** To establish Sasquatch Days and ignite community spirit and integrate cross-cultural learning and activities in a welcoming, safe, fun environment based around Sts'ailes culture and history, regional culture and history, and international immigrant cultures.
- Date of Event:** Last weekend of May/ First Weekend of June.
- Location of Event:** Harrison Hot Springs, BC on the beach and grass areas facing the Harrison Lake.

INTRODUCTION

The 2012 Sasquatch Days would consist of canoe races, activity tables for people to observe and learn First Nation arts and crafts, slahal games, Salmon BBQ and a Sasquatch Parade. This event would be reminiscent of the Sasquatch Days many years before in Harrison Hot Springs combined with the spirit of other Sts'ailes community activities. In being consistent with the yearly canoe season, the end of May/ first weekend in June is the ideal time to host the event.

A brief history of the original Sasquatch Days will be shared follow by a description of each activity. A draft schedule and estimated costs are also included.

BACKGROUND

Historically, the Sasquatch Days in Harrison Hot Springs was a very popular event. A highly successful event, it drew thousands of people in 1938. This grand festival consisted of the canoe races, games and activities, and the Sasquatch Parade that included

Sts'ailes people dressed in traditional wear. One Sts'ailes member, Ambrose Point, would wear a full Sasquatch suit. Sts'ailes honours the Sasquatch. The very name "Sasquatch" derived from the Sts'ailes language; "Sa:sq'ets". The sacredness of the Sasquatch is very prevalent within Sts'ailes teachings.

After Sasquatch Days no longer took place, Sts'ailes continued with their own recreational and community activities; mainly the Sts'ailes Days where the community would gather to host soccer, hockey and canoe races among other family/community activities. There have been many incarnations of these events, such as the Sts'ailes Youth Tournament, Sts'ailes Canoe Races, and Family Fun Day. In all these gatherings, the goal was to lift the spirit of the community and to display the talent and athleticism of our people.

REVIVING THE SASQUATCH DAYS

Today, in partnership with the Village of Harrison Hot Springs, Tourism Harrison, and the Harrison Festival Society, and other emerging partners, Sts'ailes proposes to revive the Sasquatch Days. We envision the new Sasquatch Days to have canoe races, activity tables, slahal, medicine walks, cultural boat tours, Sasquatch Parade, and traditional salmon BBQ. The following is a brief summary of the each activity.

A table of estimated costs for these activities can be found in the attachment "APPENDIX 1" which also includes further details for each activity. These are in DRAFT form and may be adjusted.

1. Canoe Races

The canoe races may attract spectators, including canoe race enthusiasts, fans, family members, new immigrants, diverse cultures, and tourists looking to experience authentic First Nation cultures. For Sts'ailes, the canoe races are a time to gather and share culture and athleticism. This event gathers all generations – Elder, Youth and Adult. Sts'ailes canoe clubs advocate drug and alcohol free lifestyles and healthy habits. Much time and dedication goes into training for canoe racing. Hosting a canoe race is also a great deal of work and requires ample funding. Nonetheless, the success of gathering the people and sharing a long-time tradition is worth it.

2. Activity Stations

There are a number of Sts'ailes community members who have talents that are unique to the culture. Each artist will have an activity table where s/he sets up a display of their work. They will demonstrate their craft throughout the day and

they can welcome people to learn their craft. For instance, a cedar weaver can make a cedar bracelet as people watch, learn and try. Because their craft is so unique and highly valuable, we would like to pay the artists for their time. This is a general practice Sts'ailes does for most of their gatherings that have these activity stations. The standard price is \$150/full day and \$75/half-day for each artist. Whether an artist is paid for a full day or half a day depends on each artist's availability. Table 2.0 displays the maximum amount to pay artists. Although we will not allow commercial vendors, artists will also sell their handcrafted works.

3. Sasquatch Parade

The Sasquatch Parade is an exciting venture for Sts'ailes. The Parade could consist of inviting the Sts'ailes people to be a part of the parade and wear their traditional regalia. People could also drum and sing and dance traditional dances. Sts'ailes would also have members wear a Sasquatch mask and regalia.

There are many possible options for how to pursue organizing the parade. Currently, the most appealing would be to invite all Aboriginal people, immigrants, and other Canadians to the parade with a theme, such as "Honouring Our Culture". Each group who partakes in the parade will display their culture. This could be an open "fun" parade or a competition for 1st, 2nd, and 3rd.

DRAFT SCHEDULE OF EVENTS

Friday:

2:00pm-8:00pm	Parade registration table open Canoe registration open
---------------	---

Saturday:

8:00am – 11:00am	Canoe registration open
8:15am	Call for parade participants
8:45am	Final call for parade participants
9:00am	Sasquatch Parade to the Opening Ceremony area
10:00am	Opening Remarks Elder Prayer Welcome Dances Cultural Sharing
11:00am	First Cultural Boat Tour Departs (every 2 hours) First Medicine Walk Departs (every 2 hours)
11:30am	Artisan Activity tables open Final call for canoe racing registrations
12 Noon	Interactive Cultural Sharing Stage Pow wow/ Hoop Dancing
1:00pm	Second Cultural Boat Tour Departs (every 2 hours) Second Medicine Walk Departs (every 2 hours)

1:30pm	Canoe Races
3:00pm	Last Cultural Boat Tour Departs Last Medicine Walk Departs (every 2 hours)
4:00pm	Traditional Salmon BBQ Dinner Interactive Cultural Sharing Stage/ Open Mic
5:30pm	Sasquatch Story Telling
Sunday:	
9:00am	Opening Remarks Elder Prayer Interactive Cultural Sharing
9:30am	Canoe Races Calls for Program Draw
10:00am	Artist Activity Tables Open Call a Program Draw every half hour
11:00am	First Cultural Boat Tour Departs (every 2 hours) First Medicine Walk Departs (every 2 hours)
11:00am – 1pm	Interactive Cultural Sharing Stage
1:00pm	Last Cultural Boat Tour Departs (every 2 hours) Last Medicine Walk Departs (every 2 hours)
1:00pm	Final Program Draws
2:00pm	Artisan Activity Tables Close
2:30pm	Closing Remarks

Sasquatch Days – an Intercultural Celebration is a way of connecting diverse communities. The revival of Sasquatch Days can ignite community spirit; provide cross-cultural learning, in a welcoming experientially rich, safe, fun environment. For Sts’ailes, gathering for such events are a way of bringing the generations together to share athleticism and culture. For many new immigrant societies, and established Canadian Society, multigenerational gatherings provide a needed opportunity practice cultural teachings, to share among the generations, and to give families much needed special memory filled experiences that they can share with their friends and families locally and around the world.

APPENDIX 1 – Estimated Costs for the Sasquatch Days – an Intercultural Celebration

Table 1.0 - Canoe Races

ITEM	COST DETAILS	TOTAL
<p>MC (Master of Ceremonies) – The MC is a valuable asset to the races and the entire event. The MC provides race information and scheduling, announces activities, provides advertisement for local businesses, keeps the crowd energy going, and provides consistency to keep the races on schedule.</p>	<p>1 MC @ \$150 honorarium/day</p>	<p>\$300</p>
<p>Designated area & parking for canoes – this is for racers to store their canoes. Canoe racers have their canoes on their vehicles and need to have easy access to the beach to bring their canoes to the water or the designated area.</p>	<p>Volunteers set up</p>	<p>----</p>
<p>Travel Assistance – Traditionally, the canoe race host provides travel assistance to the canoe clubs attending the event – this is viewed as a “thank you” and builds good relations. This money often comes full circle when Sts’ ailes racers travel to other races and receive travel assistance from the hosts. Canoe clubs must register for this ahead of time. The travel assistance these canoe clubs receive could potentially re-circulate into local business for travel needs (i.e. gas, food, accommodations).</p>	<p>Anticipated #of Island Canoe Clubs: 6 @ \$200</p> <p>Anticipated # of Mainland Canoe Clubs: 12 @ \$150</p>	<p>\$3000</p>
<p>Honorarium for Judges – Judges are the most important part of the canoe races. They ensure safety of the racers and fair play during the races. A minimum of three boats with two judges per boat are needed for this task.</p>	<p>6 judges @ \$125/day (for two days)</p>	<p>\$1500</p>
<p>Boats for the Judges – Pay the boat owner gas for the use of their boat.</p>	<p>3 boats @ \$150/boat</p>	<p>\$450</p>
<p>Canoe race payouts – This is the prize money. These are awarded both days. Sunday is the “Championship Day” where the payouts are a little higher. This entices racers to stay the full weekend. The amount of the payouts reflects the number of racers who will attend. There may be other categories other than the ones mentioned in Table 1.1 – Sts’ ailes will provide the funding for these other categories.</p>	<p><i>See Table 1.1 for details</i></p>	<p><i>See Table 1.1</i></p>
	TOTAL	\$5250

Table 1.1 - Canoe Race Payouts

CATEGORY	FIRST		SECOND		THIRD		TOTAL
	SAT	SUN	SAT	SUN	SAT	SUN	
Single Paddle – WOMEN	\$20 each	\$25 each	\$15 each	\$20 each	\$10 each	\$15 each	\$105
Singe Paddle – MEN	\$20 each	\$25 each	\$15 each	\$20 each	\$10 each	\$15 each	\$105
Double Paddle – WOMEN	\$20 each	\$25 each	\$15 each	\$20 each	\$10 each	\$15 each	\$210
Double Paddle – MEN	\$20 each	\$25 each	\$25 each	\$20 each	\$10 each	\$15 each	\$210
Mixed Double	\$20 each	\$25 each	\$15 each	\$20 each	\$10 each	\$15 each	\$210
6 Paddle – WOMEN	\$20 each	\$25 each	\$15 each	\$20 each	\$10 each	\$15 each	\$630
6 Paddle – MEN	\$20 each	\$25 each	\$15 each	\$20 each	\$10 each	\$15 each	\$630
11 Paddle – WOMEN	\$20 each	\$25 each	\$15 each	\$20 each	\$10 each	\$15 each	\$1155
11 Paddle – MEN	\$20 each	\$25 each	\$15 each	\$20 each	\$10 each	\$15 each	\$1155
11 Paddle Buckskins	\$15 each	\$20 each	\$12 each	\$15 each	\$10 each	\$12 each	\$924
Special #1 *Could be intercultural canoe	TBA	TBA	TBA	TBA	TBA	TBA	TBA
Special #2 * Could be intercultural canoe							
Special #3 * Could be intercultural canoe							
						TOTAL	\$5334

* Specials are for categories that will be left open for further planning. Sts' ailes will acquire funds for these costs.

Table 1.3 – Artisan Activity Stations

ACTIVITY	PROPOSED ARTISTS	COST DETAILS	TOTAL
Medicine/Nature Walk	Vange Point	1 artists for 1 ½ days (3; 2 walks/day)	\$225
Drum-making	Darren Charlie/ or Nelson Leon	1 artist for 1 ½ days	\$225
Basket Weaving	Monica Joe or Joanne Chapman	1 artist for 1 ½ days	\$225
Cedar Weaving	Kevin Charlie, Vange Point or Wayne Williams	1 artist for 1 ½ days	\$225
Bone Game (Slahal)	TBA	2 artists for 1 day	\$300
Storytelling (Oral Tradition)	Willie Charlie or Kelsey Charlie	1 artist for 1 day	\$150
Carving	Rocky LaRock	1 artist for 1 ½ days	\$225
Materials/ Supplies for Make and Take Arts - Cedar			\$400
Materials/ Supplies for Make and Take Arts – Mini Drums			\$500
		TOTAL	\$2475

*Other Nation artists may come and demonstrate and sell handcrafted items, bringing their own setups/ displays, no charge.

Table 1.3 - Activity Stations – Other Details

ITEM	COST DETAILS	TOTAL
Designated area for Activity Stations – Anticipate having about 12 stations.	24 Tables, 75-100 chairs Village of Harrison Hot Springs In-Kind (\$)	-----
Awnings for Activity Stations – Stations can be set up with awnings along the beach.	Harrison Festival Society – In Kind Production \$2,000	-----
	TOTAL	\$0

Table 1.4 - Other Details of Sasquatch Days

ITEM	COST DETAILS	TOTAL
First Aid Centre – St. John’s Ambulance accepts a donation for their time that goes towards their organization.	2 days @ \$200/day.	\$400
Security – Generally, we notify RCMP of the events taking place and they book time in to be present at the event during day time hours and stay on notice throughout the times they are not present. We could also contract security guards on shifts throughout the two days and one night.	2 guards @ \$150 each for Saturday day shift 2 guards @ \$150 each for Saturday night shift 2 guards @ \$150 each for Sunday day shift The rest of the guards can be volunteers	\$900
Hotel/Camping Rates – A reduced rate can be given to a certain number of rooms/sites reserved for the event. Most of the attendees will be camping	Lower rates based on future discussions.	-----
Traditional BBQ Dinner – BBQ fish dinner for the guests and athletes is in keeping with our tradition. 300 dinners to be offset with \$7.50 funding per plate, actual cost is \$15 per plate. Sell for \$7.50 to cover costs.	Harrison Hot Springs provide chairs and tables. (\$) Village of Harrison provide Community Hall (\$) BBQ tickets will be on first come basis.	\$2250
Signage – Directional signs as well as signs to mark designated areas are needed to keep the people informed.		\$700

CONTINUED: Table 1.4 - Other Details of Sasquatch Days

<p>Advertisement & Promotion – This can be a joint effort between Sts’ailes and Harrison Hot Springs. Sts’ailes can circulate throughout the First Nations circles and other contacts and Harrison Hot Springs can advertise through their tourist and local advertising strategies. Anticipate AtBC Event Marketing Support, TBC</p>	<p>Harrison Tourism in Kind \$2,000 Local printing & distribution: \$500</p>	
<p>Canoe Registration Table – Canoe racers are to register their canoes upon arrival. There will be a designated awning and table for this.</p>	<p>Volunteers</p>	<p>-----</p>
<p>Program Draw - Sts’ailes would do a Program Draw and a daily 50/50 draw. If possible, a Loonie Auction will also take place. Gaming Applications required.</p>	<p>Delivery of sales: Volunteers</p>	<p>-----</p>
<p>Event Programs – This would include a welcoming from the Sts’ailes and Harrison Hot Springs leadership, the canoe schedule, activity station information, a map of the area, a list of sponsors, and advertisement for local businesses sales. We would charge a small fee for the purchase of a program but also include a program draw.</p>	<p>Program Printing Expense</p>	<p>\$800</p>
<p>Information Table – This can be a main station for participants and spectators to go to for directions and schedule of events. Maps and advertisement of local businesses could also be available at this station. This would be the main station for the 50/50, Raffles, and Program draws and located near the MC.</p>	<p>Volunteers AtBC Trailblazers to assist (TBC) In-Kind</p>	<p>-----</p>
<p>Interactive Cultural Sharing Stage – To offer an honouraria for other cultural groups who come to share.</p>		<p>\$1,890</p>
	<p>TOTAL</p>	<p>\$6,940</p>

Table 1.5 - Grand Total of Requested Funding

ALL AREAS	TOTAL
Table 1.0 – Canoe Races	\$5,250
Table 1.1 – Canoe Race Payouts	\$5,334
Table 1.2 – Activity Stations	\$2,475
Table 1.3 – Activity Stations – Other Details	\$0
Table 1.4 – Other Details of Sasquatch Days	\$6,940
GRAND TOTAL EXPENSES	\$19,999



VILLAGE OF HARRISON HOT SPRINGS

REPORT TO COUNCIL

TO: Mayor and Council **DATE:** December 6, 2011
FROM: Director of Finance **FILE:** 0530-01
SUBJECT: Road Reserve Transfer

ISSUE: To transfer one hundred thousand dollars (\$100,000) from the Road Reserve to the general account.

BACKGROUND: The 2011 – 2020 Financial Plan has \$100,000 included as a contribution towards the McCombs Drive Bridges Replacement Project.


RECOMMENDATION: THAT Council approves the transfer of one hundred thousand dollars (\$100,000) from the Road Reserve towards the construction of the McCombs Drive Bridges Replacement Program.

Respectfully submitted for your consideration;

Dale Courtice, CGA
Director of Finance

CHIEF ADMINISTRATIVE OFFICER COMMENTS:


Ted Tisdale
Chief Administrative Officer

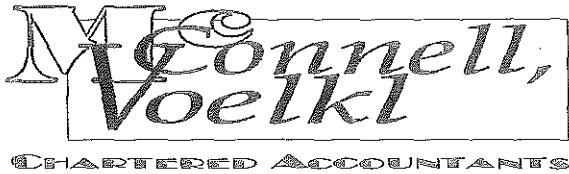

CHARTERED ACCOUNTANTS

F.W. Voelkl, B.Comm., C.A.
C.M. Kelley Inc., B.B.A., C.A.

P.O. Box 819
228 Wallace St.
Hope, B.C. V0X 1L0



Office (604)869-5634
Fax (604)869-2381

INTERIM AUDIT REPORT

To the Council of the **VILLAGE OF HARRISON HOT SPRINGS:**
P.O. Box 160
Harrison Hot Springs, BC
V0M 1K0

We have reviewed and evaluated the receipts, payroll, purchasing and financial information systems, examined accounts, and adhered to Canadian generally accepted auditing procedures and standards to test the records of the **VILLAGE OF HARRISON HOT SPRINGS** for the operating period ended **October 31, 2011**, and we have performed a financial review of the accounts, records, ledgers and computerized financial information system employed by the Village for the interim period then ended. Our examination included a review of council and administration policies and their implementation, review of accounting procedures, financial, management, and internal audit controls, and included such tests of supporting documents and records as we considered necessary in the circumstances.

We restricted our substantive tests, generally, to material transactions in excess of **\$2,000**. and our tests did not include external confirmations of specific receipts or expenditures. This procedure, in our opinion, based on the lack of response received in the past, would not greatly enhance the expected results nor assist management in performing its control function.

Subject to our comments in the Internal Management Report dated **November 25, 2011** we are pleased to report that in all material respects, we found the accounts, records and ledgers orderly, well kept and up to date, and to the best of our knowledge from the test checks that we conducted, they accurately reflect the results of operation of the **VILLAGE OF HARRISON HOT SPRINGS** for the period tested.

CHARTERED ACCOUNTANTS

November 25, 2011
Hope, B.C.
Canada



VILLAGE OF HARRISON HOT SPRINGS

BYLAW NO. 995

Being a Bylaw authorizing the expenditure of monies in the Community Works Fund Reserve

WHEREAS there is an unappropriated balance in the Community Works Fund Reserve established under Bylaw No. 850 of Three Hundred and Seventy Seven Thousand Six Hundred and Twenty Dollars (\$377,620) as at November 30, 2011 which amount has been calculated as follows:

Balance in Reserve Fund at December 31, 2010	\$373,048
Add: Interest earnings for current year to November 30, 2011	<u>4,572</u>
Uncommitted balance in Reserve Fund at November 30, 2011	<u>\$377,620</u>

AND WHEREAS: it is deemed desirable to expend a portion of monies set aside under Bylaw No. 850 for the purposes of expending funds for Eligible Projects pursuant to the Community Works Fund Agreement.

NOW THEREFORE, the Council of the Village of Harrison Hot Springs, in open meeting assembled, hereby enacts as follows:

1. A maximum sum of Two Hundred Thousand Dollars (\$200,000) is hereby appropriated from the Community Works Fund Reserve to be expended towards:
 - a. The construction of the North and South McCombs Drive Bridges

2. Should any of the above monies remain unexpended after the expenditures hereby authorized have been made, any unexpended balance shall be returned to the credit of the Reserve Fund.
3. This bylaw may be cited as the "Community Works Fund Reserve Expenditure Bylaw No. 995".

READ FOR A FIRST TIME THIS DAY OF DECEMBER, 2011.

READ FOR A SECOND TIME THIS DAY OF DECEMBER, 2011.

READ FOR A THIRD TIME AS THIS DAY OF DECEMBER, 2011.

ADOPTED THIS DAY OF DECEMBER, 2011.

Mayor

Corporate Officer



VILLAGE OF HARRISON HOT SPRINGS

BYLAW NO. 996

**Being a Bylaw authorizing the expenditure of monies in the Capital Works,
Machinery and Equipment Reserve Fund**

WHEREAS there is an unappropriated balance in the Capital Works, Machinery and Equipment Reserve Fund established under Bylaw No. 395 of Four Hundred and Fifty Four Thousand Seven Hundred and Ninety-Two Dollars (\$454,792) as at November 30, 2011 which amount has been calculated as follows:

Balance in Reserve Fund at December 31, 2010	\$424,724
Add: Contributions during the year	25,000
Add: Interest earnings for current year to November 30, 2011	<u>5,068</u>
Uncommitted balance in Reserve Fund at November 30, 2011	<u>\$454,792</u>

AND WHEREAS: it is deemed desirable to expend a portion of monies set aside under Bylaw No. 395 for the purpose of acquiring a new fire truck.

NOW THEREFORE, the Council of the Village of Harrison Hot Springs, in open meeting assembled, hereby enacts as follows:

1. A maximum sum of Three Hundred and Fifty Thousand Dollars (\$350,000) is hereby appropriated from the Capital Works, Machinery and Equipment Reserve Fund to be expended towards:
 - a. The acquisition of a new pumper fire truck.

2. Should any of the above monies remain unexpended after the expenditures hereby authorized have been made, any unexpended balance shall be returned to the credit of the Reserve Fund.
3. This bylaw may be cited as the "Capital Works, Machinery and Equipment Reserve Fund Expenditure Bylaw No. 996".

READ FOR A FIRST TIME THIS DAY OF DECEMBER, 2011.


READ FOR A SECOND TIME THIS DAY OF DECEMBER, 2011.

READ FOR A THIRD TIME AS THIS DAY OF DECEMBER, 2011.

ADOPTED THIS DAY OF DECEMBER, 2011.

Mayor

Corporate Officer

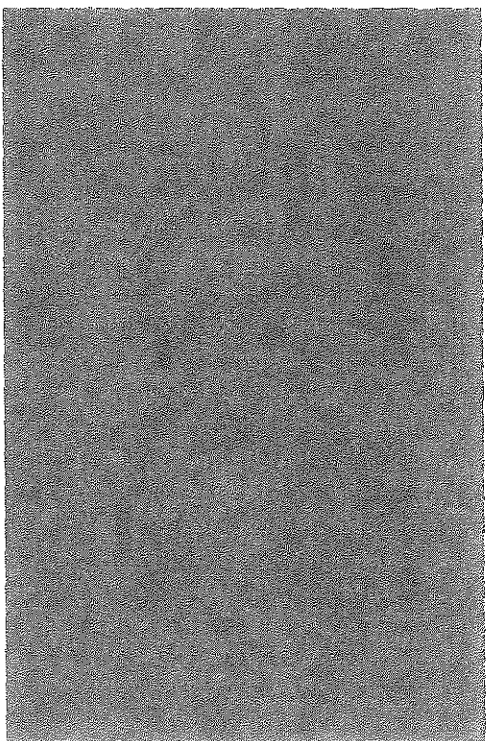

Angus
Estates
The Project



Angus Estates : Current Drainage System



Angus Estates : **Project Areas**


- Drainage
- Wastewater Collection
- Water
- Curbs/ Gutters
- Roads

Angus Estates : **Drainage**

- Drainage rites-of-way Registration
\$180,000.00

Angus Estates : Current Wastewater Collection System



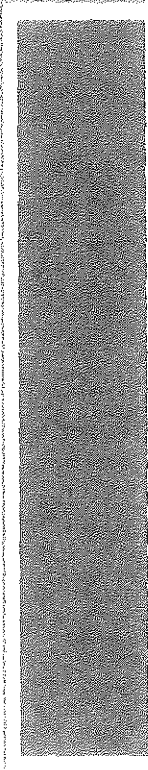

Angus Estates : **Wastewater Collection System**

- o Rite of Way Registration: Ramonda to
Haddway

Angus Estates : Current/Future Water System



Angus Estates : **Future Water System**

- Hot Springs to McCoombs – \$302,000.00
- Ramona North – \$88,000.00
- Angus Place – \$66,000.00
- Myng North – \$49,500.00
- Myng South – \$302,500.00
- Hope Place - \$154,000.00

Angus Estates : **Curbs/Gutter and Roads**

- Ramona - \$73,000.00
- Hadway - \$38,400.00
- Angus - \$37,000.00
- Myng - \$106,000.00
- Hope - \$54,000.00

- Ramona - \$122,550.00
- Hadway - \$73,530.00
- Angus - \$56,840.00
- Myng - \$285,940.00
- Hope - \$114,380.00

Angus Estates : Total Current/Future System





Angus Estates : Project Area \$ Totals

- Drainage - \$180,000.00
- Wastewater Collection - \$45,000.00
- Water - \$962,000.00
- Curbs/ Gutters - \$308,400.00
- Roads - \$655,240.00

Total Project Estimate - \$2,150,640.00

Angus Estates : **Project Timeline (4 Phase)**

- **Phase 1 :**
 - a) Drainage and Wastewater Collection
Rite-of-way Determinations.
 - b) Property Line Surveying (Street)
 - c) Pre-Planning of future Phases

- **Phase 2 : Water Lines with services to property** (4 year plan)
 - 1st yr. : Hot Springs to McCoombs - \$302,000.00
 - 2nd yr. : Myng to Hope Plc. - \$352,000.00
 - 3rd yr. : Hope Plc. - \$154,000.00
 - 4th yr. : Ramona North and Angus - \$115,500.00

- **Phase 3 : Curbs and Gutters** (4 year plan)
 - 1st yr. : Ramona Plc. - \$73,000.00
 - 2nd yr. : Hadway and Angus - \$75,400.00
 - 3rd yr. : Hope Plc. - \$106,000.00
 - 4th yr. : Myng Cr. - \$106,000.00

- **Phase 4 : Roads** (4 year plan)
 - 1st yr. : Ramona Plc. - \$122,500.00
 - 2nd yr. : Hadway and Angus - \$130,370.00
 - 3rd yr. : Hope Plc. - \$169,380.00
 - 4th yr. : Myng Cr. - \$391,940.00

HARRISON HOT SPRINGS

As the City Improves

INFRASTRUCTURE

Deficiencies &
Cost Estimations

2011

Infrastructure Areas

- * Water
- * Wastewater
- * Drainage
- * Roads
- * Curbs, Sidewalks
- * Street Lights
- * Parks
- * Beach
- * Structures

Water


- Treatment Plant - \$1,000,000.00 to \$2,000,000.00
- Waterline cleaning - \$450,000.00
- Waterline Rock-face Structure - \$80,000.00
- Culvert Crossing at Reservoir - \$25,000.00
- Waterline Looping
 - Lillooet, St Alice, Cedar - \$192,000.00
 - Pine, HS to McCombs --\$176,000.00
 - Alder, HS to McCombs --\$121,000.00

Water

* Waterline Looping cont'd

- 4. Emerald, HS to McCoombs -- \$165,000.00
- 5. Angus Estates, HS to McCoombs -- \$302,000.00
- 6. McCoombs, McPherson to Myring - \$550,000.00
- * S.C.A.D.A. Communication - \$20,000.00

Water Identified DCC Plan

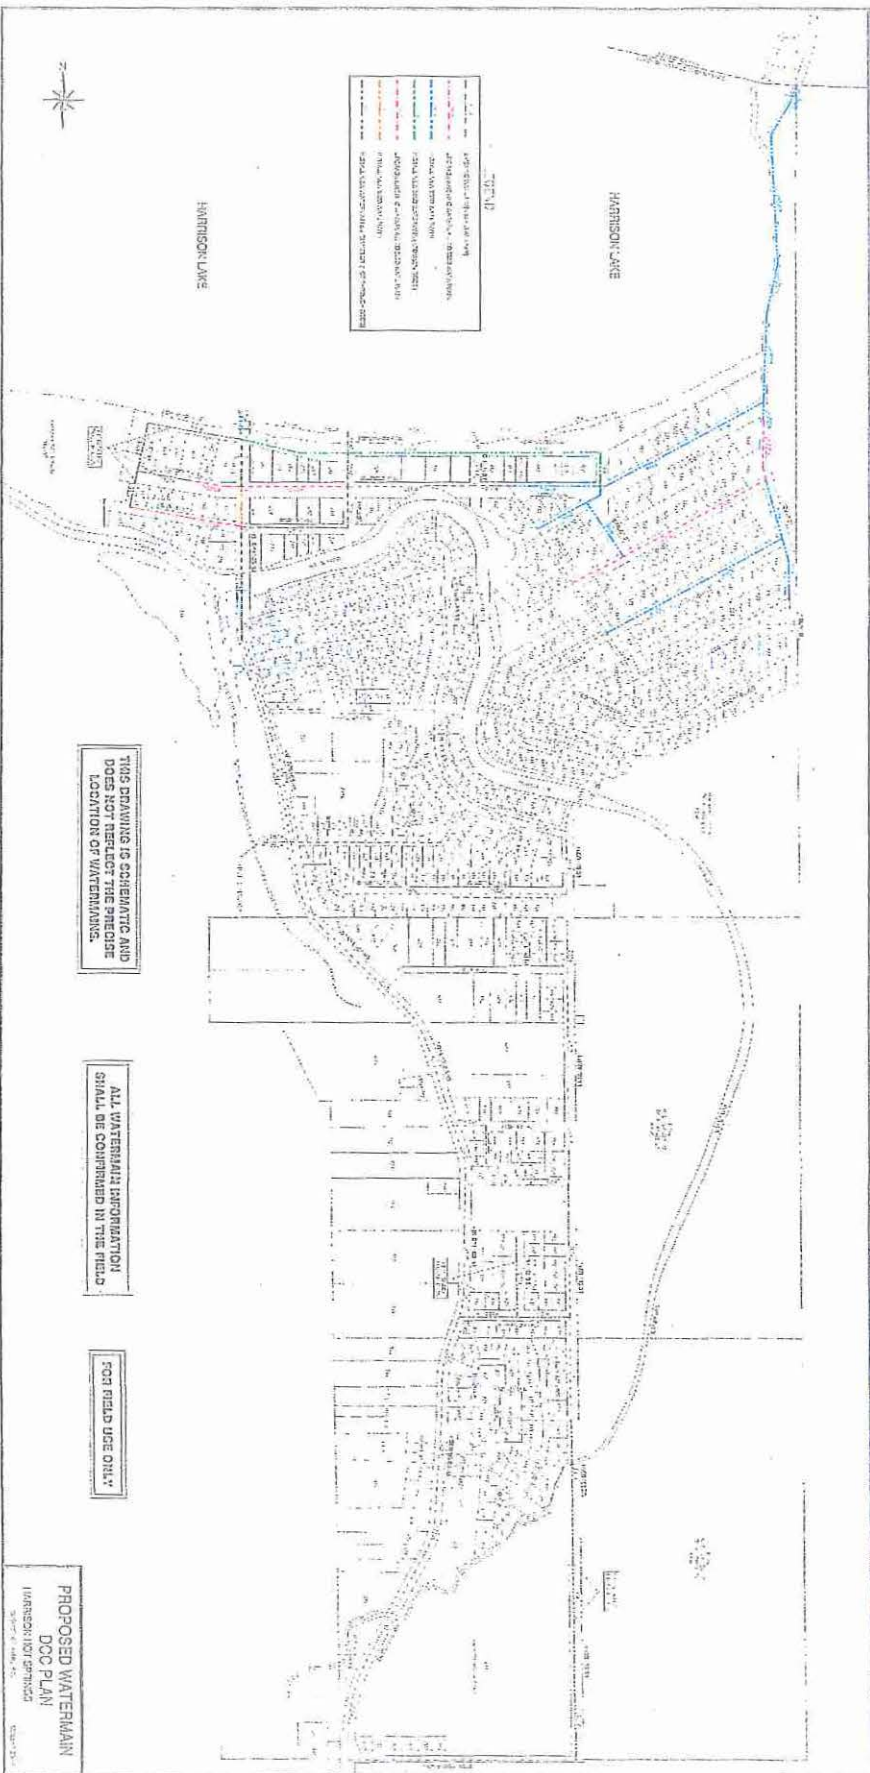

Water

Identified DCC Plan

- Proposed new water lines - \$2,300,000.00
- Upgrade existing water lines - \$745,000.00

Wastewater

- Liftstation #1 Kiosk upgrade (electrical/controls) - \$35,000.00
- Liftstation #2 Kiosk (kiosk, electrical/controls) - \$15,000.00
- Liftstation #4 Replacement - \$120,000.00
- Liftstation #5 Kiosk upgrade (kiosk, electrical/controls) - \$25,000.00
- Forcemain Replacement (LS#1 to Treatment Plant) - \$500,000.00

Wastewater

- * Overhead Power Supply Lines (Cedar to Flood Gates)
Replacement to Underground - \$500,000.00
- * Forcemain Upgrade (LS#4 to Hope Plc.) - \$150,000.00
- * S.C.A.D.A. Communication - \$60,000.00
- * Cross-Connection Elimination Storm Water
 1. Village Motel
 2. Rainbow Springs RV
- * Treatment Plant (office, washroom/shower) - \$15,000.00

Wastewater


* Identified DCC Plan

1. LS #3 Upgrade/Replacement - \$150,000.00
2. LS #6 Upgrade/Replacement - \$100,000.00
3. Collection Line Upgrades - \$750,000.00
4. New Liftstation & Forcemain (Siphon Replacement)
 - a) Liftstation - \$150,000.00
 - b) Forcemain - \$ 75,000.00

Drainage

- * Dike Pump Replacement-\$800,000.00
- * Emerald Rd Re-alignment- \$20,000.00
- * Manhole replacement - \$30,000.00
- * Drainage rites-of-way Registration, Angus Estates - \$180,000.00
- * Identify and revitalize ditches covered over/buried from development – \$100,000.00

Drainage Identified DCC Plan

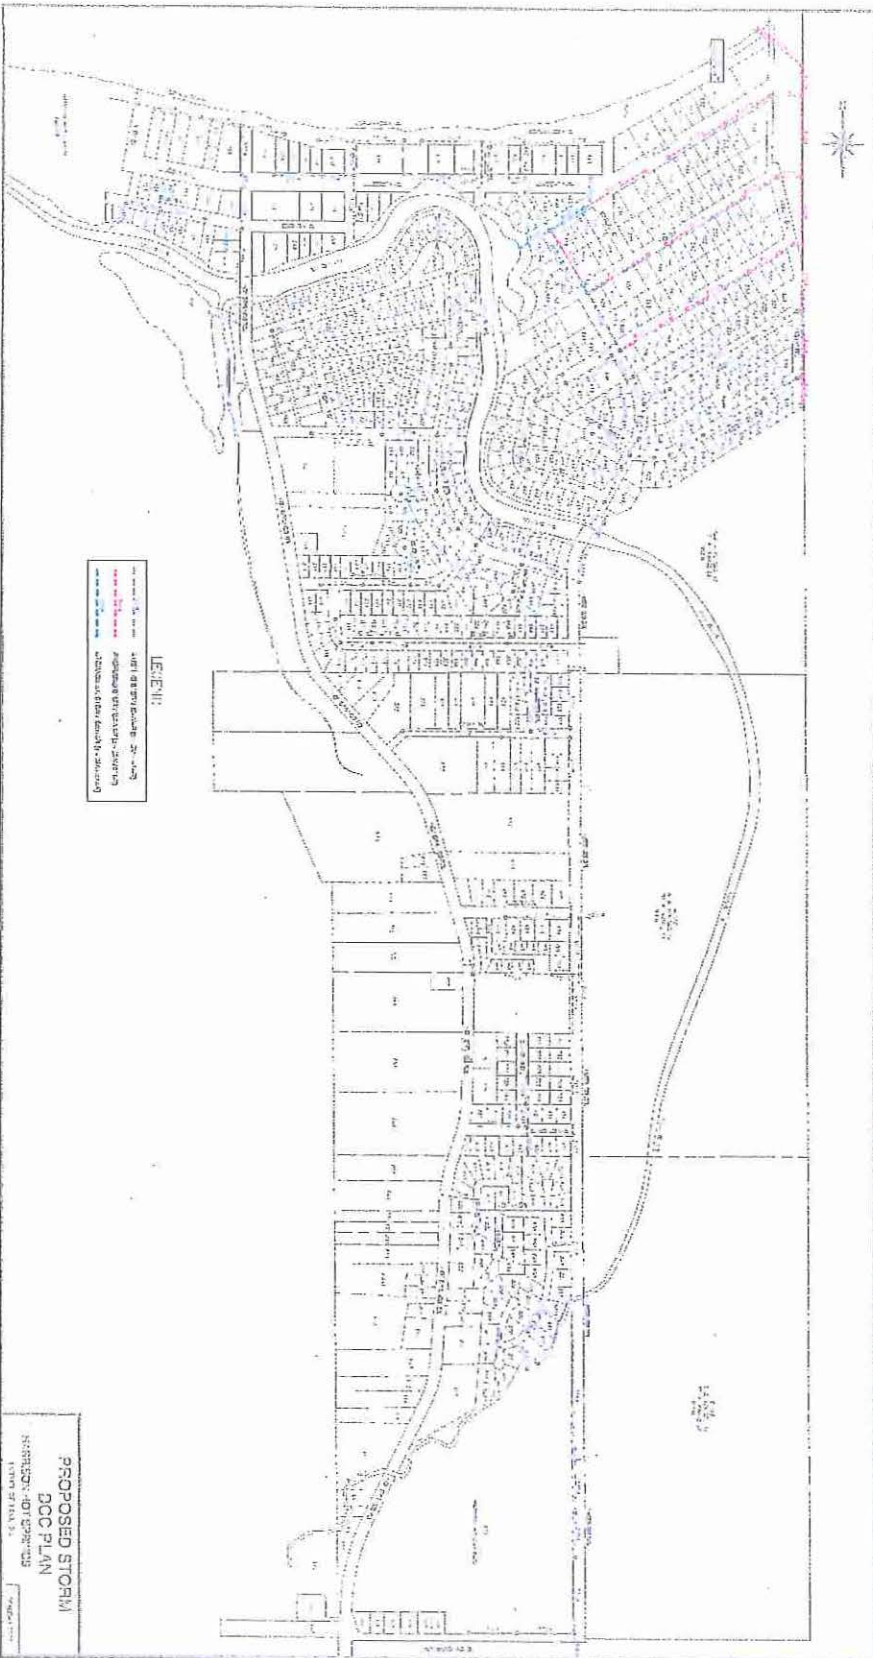

Drainage

Identified DCC Plan

1. Proposed new Drainage lines- \$550,000.00
2. Upgrade existing lines- \$ 70,000.00

Roads

* Esplanade Block 1 repaving- \$145,000.00

* Cedar West repaving- \$175,000.00

* Angus Estates

- Ramona - \$122,550.00

- Hadway - \$73,530.00

- Angus - \$56,840.00

- Myng - \$285,940.00

- Hope - \$114,380.00

Curbs, Sidewalks

Hot springs Road (curb, gutter, sidewalk)

1. Entrance to 1st Bridge - \$140,000.00
2. 1st Bridge to Ramona - \$210,000.00
3. Ramona to Emerald - \$72,800.00
4. Emerald to Alder - \$168,000.00
5. Alder to Pine - \$140,000.00
6. Pine to Balsam - \$140,000.00
7. Balsam to Walnut - \$112,000.00

Curbs, Sidewalks

Hot Springs Road cont'd

- 6. Walnut to Miami - \$70,000.00
- 7. Miami to 2nd Bridge - \$15,200.00
- 8. Re-alignment of storm drainage along Hot Springs - \$100,000.00
- 9. Lillooet, Maple to Hot Springs (new curb, gutter, sidewalk) - \$41,000.00. Storm Drainage Re-alignment - \$15,000.00
- 10. Lillooet, Eagle to Spruce (sidewalk replacement) - \$18,460.00
- 11. Lillooet, Spruce to Mount (sidewalk replacement) - \$49,000.00

Curbs, Sidewalks

* Angus Estates (curbs, gutter)

- 1 Ramona - \$73,000.00
- 2 Hadway - \$38,400.00
- 3 Angus - \$37,000.00
- 4 Myng - \$106,000.00
- 5 Hope - \$54,000.00

Street Lighting

Metal Pole and Lamp Replacement

- * Miami River Drive (16 units) -- \$40,000.00
- * Poplar (2 units) - \$5,000.00
- * Walnut (2 units) - \$5,000.00
- * Fern (1 unit) - \$2,500.00
- * Clover (1 unit) - \$2,500.00
- * Balsam (2 units) - \$5,000.00
- * Juniper (1 unit) - \$2,500.00
- * Chestnut (8 units) - \$20,000.00
- * Eagle (7 units) - \$17,500.00
- * Naismith (3 units) - \$7,000.00
- * Cottonwood (5 units) - \$12,500.00
- * Driftwood (7 units) - \$17,500.00

Street Lighting

Metal Pole and Lamp Replacement continued

* Angus Estates

1. Ramona (4 lamps, 1 unit) - \$4,500.00
2. Hadway (2 lamps, 1 unit) - \$3,500.00
3. Angus (1 lamp) - \$500.00
4. Myng (4 lamps) - \$2,000.00
5. Hope (2 lamps, 1 unit) - \$3,500.00

Parks

Randall Park Washrooms (new) - \$275,000.00

Beach

- * Beach Washroom Expansion - \$200,000.00
- * Electrical Upgrading - \$50,000.00

Structures

- * Fire hall

1. Facia board replacement - \$2500.00
2. Windows re-sealing - \$1200.00
3. Carpeting - Fire Escape - \$8500.00
4. Vehicle Exhaust Ventilation system - \$50,000.00

- * Public Works

- * Relocation of facility (new) - \$1,200,000.00

- * Civic Centre (new) - \$2,500,000.00

- * Ranger Station

- * Replacement - \$450,000.00

Summation

Deficiencies - Estimated Costing Totals

Total amounts less DCC Plans

* Water-----	\$ 4,081,000.00
* Wastewater-----	\$ 1,420,000.00
* Drainage-----	\$ 1,245,000.00
* Roads-----	\$ 973,240.00
* Curbs, Sidewalks---	\$1,500,060.00
* Street Lights-----	\$151,000.00
* Parks-----	\$275,000.00
* Beach-----	\$250,000.00
* Structures-----	\$4,212,200.00

Summation

Identified DCC Plans

Estimated Cost Totals

* Water - \$3,045,000.00

* Wastewater - \$1,225,000.00

* Drainage - \$820,000.00

Priorities

Next 3 Years

* Water -Culvert Crossing, Treatment Plant, Waterline Cleaning,
Rock face Structure, Angus Estates

- \$2,857,000.00

* Wastewater -- Siphon, LS#3, TP Forcemain/Power line, LS #4 &
Forcemain

- \$1,645,000.00

* Drainage -- Dike Pump

- \$800,000.00

Priorities

Next 3 Years

- * Roads – Esplanade Block #1, Angus Estates
- \$798,240.00
- * Curbs, Sidewalks – Angus Estates, Hot Springs #1,#2,#3
-\$1,076,040.00
- * Street Lights – All Identified
-\$151,000.00
- * Structures – Fire Hall, Public Works, Civic Centre
-\$3,812,200.00